

COOLING CAPACITY: 18,000 - 60,000 BTU/H

**ENERGY-EFFICIENT  
 SPLIT SYSTEM AIR CONDITIONER  
 UP TO 15 SEER & 12.5 EER**



**Contents**

Nomenclature ..... 2  
 Product Specifications ..... 3  
 Expanded Cooling Data ..... 5  
 Performance Data ..... 29  
 AHRI Ratings ..... 31  
 Wiring Diagram ..... 75  
 Dimensions ..... 76  
 Accessories ..... 76

**Standard Features**

- Energy-efficient scroll compressor
- High-density foam compressor sound blanket
- Copeland® ComfortAlert™ diagnostics
- Single-speed ECM condenser fan motor
- Factory-installed filter drier
- Copper tube / enhanced aluminum fin coil
- Sweat connection service valves with easy access to gauge ports
- Contactor with lug connection
- Ground lug connection
- AHRI Certified; ETL Listed

**Cabinet Features**

- Heavy-gauge, galvanized-steel cabinet with sound control top
- Attractive Architectural Gray powder-paint finish with 500-hour salt-spray approval
- Wire fan discharge grille
- Steel louver coil guard
- Compact footprint
- Top and side maintenance access
- Single-panel access to controls with space provided for field-installed accessories
- When properly anchored, meets the 2010 Florida Building Code unit integrity requirements for hurricane-type winds (Anchor bracket kits available.)



\* Complete warranty details available from your local dealer or at [www.amana-hac.com](http://www.amana-hac.com). To receive the 10-Year Parts Limited Warranty, online registration must be completed within 60 days of installation. Online registration is not required in California or Québec.

	A	S	X	14	036	1	AA		
	1	2	3	4,5	6,7,8	9	10,11		
<b>Brand</b>	A Amana® Brand						<b>Engineering *</b>		
							Major/ Minor Revisions		
							* Not used for order or inventory control		
<b>Product Category</b>	S Split System						<b>Electrical</b>		
	N Nominal Split System						1 - 208/230 V, 1 Phase, 60 Hz		
<b>Unit Type</b>	X Condenser R-410A						<b>Nominal Capacity</b>		
	Z Heat Pump R-410A						018 1½ Tons	030 2½ Tons	042 3½ Tons
							019 1½ Tons	031 2½ Tons	043 3½ Tons
							024 2 Tons	036 3 Tons	048 4 Tons
							025 2 Tons	037 3 Tons	060 5 Tons
<b>Efficiency</b>	13 13 SEER		16 16 SEER						
	14 14 SEER		18 18 SEER						

	ASX14 0181K*	ASX14 0191K*	ASX14 0241L*	ASX14 0251L*	ASX14 0301K*	ASX14 0311K*
<b>CAPACITIES</b>						
Nominal Cooling (BTU/h)	18,000	18,000	24,000	24,000	30,000	30,000
SEER / EER	14 / 12	14 / 12.2	14 / 12.2	14 / 12.2	14 / 12	14 / 12.2
Decibels	70	70	71	71	71	71
<b>COMPRESSOR</b>						
RLA	9.0	9.0	13.5	13.5	12.8	12.8
LRA	48	47.5	58.3	58.3	64	67.8
<b>CONDENSER FAN MOTOR</b>						
Horsepower	1/8	1/8	1/8	1/8	1/6	1/6
FLA	0.7	0.7	0.7	0.7	0.95	0.95
<b>REFRIGERATION SYSTEM</b>						
Refrigerant Line Size						
Liquid Line Size ("O.D.)	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"
Suction Line Size ("O.D.)	3/4"	3/4"	3/4"	3/4"	3/4"	3/4"
Refrigerant Connection Size						
Liquid Valve Size ("O.D.)	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"
Suction Valve Size ("O.D.) <sup>3 4</sup>	3/4"	3/4"	3/4"	3/4"	3/4"	3/4"
Valve Type	Sweat	Sweat	Sweat	Sweat	Sweat	Sweat
Refrigerant Charge	68	68	75	75	80	90
Shipped with Orifice Size	0.052	0.053	0.057	0.057	0.065	0.063
<b>ELECTRICAL DATA</b>						
Voltage-Phase (60 Hz)	208/230-1	208/230-1	208/230-1	208/230-1	208/230-1	208/230-1
Minimum Circuit Ampacity <sup>1</sup>	12	12	17.6	17.6	17.0	17.0
Max. Overcurrent Protection <sup>2</sup>	20 amps	20 amps	30 amps	30 amps	25 amps	25 amps
Min / Max Volts	197/253	197/253	197/253	197/253	197/253	197/253
Electrical Conduit Size	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"
Equipment Weight (lbs)	131	131	136	136	162	162
Ship Weight (lbs)	146	146	153	153	180	180

<sup>1</sup> Line sizes denoted for 25' line sets, tested and rated in accordance with AHRI Standard 210/240. For other line-set lengths or sizes, refer to the installation & Operating instructions and/or the long line-set guidelines.

<sup>2</sup> Wire size should be determined in accordance with National Electrical Codes; extensive wire runs will require larger wire sizes

<sup>3</sup> Must use time-delay fuses or HACR-type circuit breakers of the same size as noted.

<sup>4</sup> Installer will need to supply 3/4" to 7/8" adapters for suction line connections.

<sup>5</sup> Installer will need to supply 5/8" to 1 1/4" adapters for suction line connections.

**NOTES**

- Always check the S&R plate for electrical data on the unit being installed.
- Unit is charged with refrigerant for 15' of 3/8" liquid line. System charge must be adjusted per Installation Instructions Final Charge Procedure.

	ASX14 0361K*	ASX14 0371K*	ASX14 0421K*	ASX14 0431K*	ASX14 0481K*	ASX14 0601K*
<b>CAPACITIES</b>						
Nominal Cooling (BTU/h)	36,000	36,000	42,000	42,000	48,000	60,000
SEER / EER	14 / 12	14 / 12.2	14 / 12	14 / 12.2	14 / 11.7	14 / 11.7
Decibels	72	72	72	73	73	74
<b>COMPRESSOR</b>						
RLA	14.1	14.1	16.7	16.7	19.9	25.0
LRA	77	72.2	79	79	109	134
<b>CONDENSER FAN MOTOR</b>						
Horsepower	1/6	1/6	1/6	1/6	1/4	1/4
FLA	0.95	0.95	0.95	0.95	1.5	1.5
<b>REFRIGERATION SYSTEM</b>						
Refrigerant Line Size						
Liquid Line Size ("O.D.)	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"
Suction Line Size ("O.D.)	7/8"	7/8"	1 1/8"	1 1/8"	1 1/8"	1 1/8"
Refrigerant Connection Size						
Liquid Valve Size ("O.D.)	3/8"	3/8"	3/8"	3/8"	3/8"	3/8"
Suction Valve Size ("O.D.) <sup>3 4</sup>	3/4"	3/4"	7/8"	7/8"	7/8"	7/8"
Valve Type	Sweat	Sweat	Sweat	Sweat	Sweat	Sweat
Refrigerant Charge	64	64	76	76	101	120
Shipped with Orifice Size	0.068	0.071	0.074	0.074	0.078	0.088
<b>ELECTRICAL DATA</b>						
Voltage-Phase (60 Hz)	208/230-1	208/230-1	208/230-1	208/230-1	208/230-1	208/230-1
Minimum Circuit Ampacity <sup>1</sup>	18.6	18.6	21.8	21.8	26.4	32.8
Max. Overcurrent Protection <sup>2</sup>	30 amps	30 amps	35 amps	35 amps	45 amps	50 amps
Min / Max Volts	197/253	197/253	197/253	197/253	197/253	197/253
Electrical Conduit Size	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"	1/2" or 3/4"
Equipment Weight (lbs)	162	162	189	189	220	260
Ship Weight (lbs)	180	180	207	207	242	280

<sup>1</sup> Line sizes denoted for 25' line sets, tested and rated in accordance with AHRI Standard 210/240.

For other line-set lengths or sizes, refer to the installation & Operating instructions and/or the long line-set guidelines.

<sup>2</sup> Wire size should be determined in accordance with National Electrical Codes; extensive wire runs will require larger wire sizes.

<sup>3</sup> Must use time-delay fuses or HACR-type circuit breakers of the same size as noted.

<sup>4</sup> Installer will need to supply 3/4" to 7/8" adapters for suction line connections.

<sup>5</sup> Installer will need to supply 3/8" to 1 1/8" adapters for suction line connections.

**NOTES**

- Always check the S&R plate for electrical data on the unit being installed.
- Unit is charged with refrigerant for 15' of 3/8" liquid line. System charge must be adjusted per Installation Instructions Final Charge Procedure.

IDB		OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
70	AIRFLOW	18.3	18.6	19.1	-	18.1	18.4	19.0	-	17.7	17.9	18.5	-	16.8	17.1	17.7	-	15.8	16.1	16.6	-	14.9	15.2	15.7	-
	MBh	0.57	0.50	0.37	-	0.58	0.51	0.38	-	0.60	0.53	0.40	-	0.62	0.55	0.42	-	1.00	0.57	0.44	-	1.00	0.62	0.49	-
	S/T	20	18	15	-	20	18	15	-	20	19	15	-	20	18	15	-	20	18	15	-	21	19	16	-
	ΔT	1.09	1.09	1.09	-	1.22	1.22	1.21	-	1.36	1.36	1.35	-	1.51	1.51	1.50	-	1.68	1.68	1.67	-	1.87	1.87	1.87	-
	KW	4.0	4.0	4.0	-	4.6	4.6	4.6	-	5.2	5.2	5.2	-	5.9	5.9	5.9	-	6.7	6.7	6.7	-	7.6	7.6	7.6	-
	Amps	243	244	246	-	282	283	284	-	322	323	325	-	365	366	368	-	412	413	415	-	462	463	464	-
	HI PR	122	123	126	-	129	131	134	-	136	137	140	-	141	143	146	-	147	148	151	-	153	155	158	-
	LO PR	18.6	18.8	19.4	-	18.4	18.6	19.2	-	17.9	18.2	18.7	-	17.1	17.3	17.9	-	16.1	16.3	16.9	-	15.2	15.4	16.0	-
	MBh	0.63	0.56	0.43	-	0.64	0.57	0.44	-	0.66	0.59	0.46	-	0.68	0.61	0.48	-	1.00	0.63	0.50	-	1.00	0.68	0.55	-
	S/T	19	17	14	-	19	17	14	-	19	17	14	-	19	17	14	-	19	17	13	-	20	18	15	-
ΔT	1.10	1.10	1.10	-	1.22	1.22	1.22	-	1.36	1.36	1.36	-	1.51	1.51	1.51	-	1.68	1.68	1.68	-	1.88	1.88	1.88	-	
KW	4.0	4.0	4.0	-	4.6	4.6	4.6	-	5.2	5.2	5.2	-	5.9	5.9	5.9	-	6.7	6.7	6.7	-	7.6	7.6	7.6	-	
Amps	245	246	248	-	284	285	286	-	324	325	327	-	367	368	370	-	414	415	417	-	464	465	466	-	
HI PR	115	119	129	-	118	122	133	-	122	126	138	-	126	130	141	-	128	132	144	-	131	135	148	-	
LO PR	18.8	19.1	19.6	-	18.7	18.9	19.5	-	18.2	18.5	19.0	-	17.4	17.6	18.2	-	16.4	16.6	17.2	-	15.5	15.7	16.3	-	
MBh	0.66	0.59	0.46	-	0.67	0.60	0.47	-	0.69	0.62	0.49	-	1.00	0.64	0.51	-	1.00	0.66	0.53	-	1.00	0.71	0.58	-	
S/T	18	16	13	-	18	16	13	-	18	16	13	-	18	16	13	-	18	16	12	-	19	17	14	-	
ΔT	1.10	1.10	1.10	-	1.23	1.23	1.23	-	1.37	1.37	1.37	-	1.52	1.52	1.52	-	1.69	1.69	1.69	-	1.89	1.89	1.88	-	
KW	4.1	4.0	4.0	-	4.6	4.6	4.6	-	5.3	5.3	5.2	-	6.0	5.9	5.9	-	6.7	6.7	6.7	-	7.6	7.6	7.6	-	
Amps	247	248	250	-	286	287	288	-	326	327	329	-	369	370	372	-	416	417	419	-	466	467	468	-	
HI PR	126	127	130	-	133	134	138	-	139	141	144	-	145	146	150	-	150	152	155	-	157	159	162	-	
LO PR	75	18.3	18.6	19.1	20.0	18.2	18.4	19.0	19.8	17.7	17.9	18.5	19.3	16.9	17.1	17.7	18.5	15.9	16.1	16.7	17.5	14.9	15.2	15.7	16.6
MBh		0.70	0.62	0.50	0.36	0.70	0.63	0.50	0.37	1.00	0.65	0.53	0.39	1.00	0.67	0.54	0.41	1.00	0.69	0.57	0.43	1.00	1.00	0.61	0.48
S/T		24	22	19	15	24	22	19	15	25	23	19	16	24	22	19	15	24	22	19	15	25	23	20	16
ΔT		1.09	1.09	1.09	1.10	1.22	1.22	1.21	1.22	1.36	1.36	1.35	1.36	1.51	1.51	1.50	1.51	1.68	1.67	1.67	1.68	1.87	1.87	1.87	1.88
KW		4.0	4.0	4.0	4.0	4.6	4.6	4.6	4.6	5.2	5.2	5.2	5.2	5.9	5.9	5.9	5.9	6.7	6.7	6.7	6.7	7.6	7.6	7.6	7.6
Amps		243	244	246	250	282	283	285	289	322	323	325	329	365	366	368	372	412	413	415	419	462	463	465	469
HI PR		122	123	126	132	129	131	134	139	136	137	140	145	141	143	146	151	147	148	151	156	153	155	158	163
LO PR		18.6	18.8	19.4	20.2	18.4	18.7	19.2	20.0	17.9	18.2	18.7	19.6	17.1	17.4	17.9	18.7	16.1	16.4	16.9	17.7	15.2	15.4	16.0	16.8
MBh		0.75	0.68	0.55	0.42	0.76	0.69	0.56	0.42	1.00	0.71	0.58	0.45	1.00	0.73	0.60	0.47	1.00	0.75	0.62	0.49	1.00	1.00	0.67	0.54
S/T		23	21	18	14	23	21	18	14	23	22	18	14	23	21	18	14	23	21	18	14	24	22	19	15
ΔT	1.10	1.10	1.10	1.10	1.22	1.22	1.22	1.23	1.36	1.36	1.36	1.37	1.51	1.51	1.51	1.52	1.68	1.68	1.68	1.69	1.88	1.88	1.88	1.89	
KW	4.0	4.0	4.0	4.1	4.6	4.6	4.6	4.6	5.2	5.2	5.2	5.3	5.9	5.9	5.9	6.0	6.7	6.7	6.7	6.7	7.6	7.6	7.6	7.6	
Amps	246	247	248	253	284	285	287	291	324	325	327	331	367	368	370	374	414	415	417	421	464	465	467	471	
HI PR	124	125	128	133	131	132	136	141	137	139	142	147	143	144	148	153	148	150	153	158	155	157	160	165	
LO PR	18.9	19.1	19.7	20.5	18.7	18.9	19.5	20.3	18.2	18.5	19.0	19.9	17.4	17.6	18.2	19.0	16.4	16.6	17.2	18.0	15.5	15.7	16.3	17.1	
MBh	0.79	0.71	0.59	0.45	0.79	0.72	0.59	0.46	1.00	0.74	0.62	0.48	1.00	0.76	0.63	0.50	1.00	0.78	0.65	0.52	1.00	1.00	0.70	0.57	
S/T	22	20	17	13	22	20	17	13	23	21	17	14	22	20	17	13	22	20	17	13	23	21	18	14	
ΔT	1.10	1.10	1.10	1.11	1.23	1.23	1.23	1.24	1.37	1.37	1.37	1.37	1.52	1.52	1.52	1.53	1.69	1.69	1.68	1.69	1.89	1.88	1.88	1.89	
KW	4.0	4.0	4.0	4.1	4.6	4.6	4.6	4.7	5.3	5.3	5.2	5.3	6.0	5.9	5.9	6.0	6.7	6.7	6.7	6.8	7.6	7.6	7.6	7.7	
Amps	248	249	250	255	286	287	289	293	326	327	329	333	369	370	372	376	416	417	419	423	466	467	469	473	
HI PR	126	127	130	135	133	134	138	143	139	141	144	149	145	146	150	155	150	152	155	160	157	159	162	167	
LO PR	Shaded area reflects ACCA (TVA) conditions																								

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects ACCA (TVA) conditions  
 kW = Total system power  
 Amps = outdoor unit amps (comp.+fan)

IDB		OUTDOOR AMBIENT TEMPERATURE																													
		65					75					85					95					105					115				
		59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75
80	525	MBh	18.4	18.7	19.2	20.1	18.3	18.5	19.1	19.9	17.8	18.0	18.6	19.4	17.0	17.2	17.8	18.6	15.9	16.2	16.8	17.6	15.0	15.3	15.8	16.7	15.0	15.3	15.8	16.7	
		S/T	0.82	0.74	0.62	0.5	1.00	0.75	0.62	0.49	1.00	0.77	0.64	0.5	1.00	0.79	0.66	0.53	1.00	1.00	1.00	0.68	0.6	1.00	1.00	0.73	0.60	1.00	1.00	0.73	0.60
		ΔT	28	27	23	19	28	27	23	19	29	27	23	20	28	27	23	19	28	26	23	19	29	27	24	20	29	27	24	20	
		KW	1.09	1.09	1.09	1.1	1.22	1.22	1.21	1.22	1.36	1.36	1.36	1.35	1.4	1.51	1.51	1.50	1.51	1.68	1.68	1.67	1.7	1.87	1.87	1.87	1.88	1.87	1.87	1.87	1.88
		Amps	4.0	4.0	4.0	4.0	4.6	4.6	4.6	4.6	5.2	5.2	5.2	5.2	5.2	5.9	5.9	5.9	5.9	6.7	6.7	6.7	6.7	7.6	7.6	7.6	7.6	7.6	7.6	7.6	7.6
	600	HI PR	244	245	247	251	282	283	285	289	322	324	325	329	366	367	369	373	412	414	414	415	462	463	465	469	462	463	465	469	
		LO PR	122	124	127	132	130	131	134	140	136	138	141	146	142	143	146	151	147	149	149	152	157	154	155	158	154	155	158	164	
		MBh	18.7	18.9	19.5	20.3	18.5	18.8	19.3	20.1	18.0	18.3	18.8	19.7	17.2	17.5	18.0	18.8	16.2	16.4	17.0	17.8	15.3	15.5	16.1	16.9	15.3	15.5	16.1	16.9	
		S/T	1.00	0.80	0.67	0.5	1.00	0.81	0.68	0.54	1.00	0.83	0.70	0.6	1.00	0.85	0.72	0.58	1.00	1.00	1.00	0.74	0.6	1.00	1.00	0.79	0.65	1.00	1.00	0.79	0.65
		ΔT	27	25	22	18	27	25	22	18	28	26	22	19	27	25	22	18	27	25	22	18	28	26	23	19	28	26	23	19	
675	KW	1.10	1.10	1.10	1.1	1.22	1.22	1.22	1.23	1.36	1.36	1.36	1.4	1.51	1.51	1.51	1.52	1.68	1.68	1.68	1.7	1.88	1.88	1.88	1.89	1.88	1.88	1.88	1.89	1.89	
	Amps	4.0	4.0	4.0	4.1	4.6	4.6	4.6	4.6	5.2	5.2	5.2	5.3	5.9	5.9	5.9	5.9	6.7	6.7	6.7	6.7	7.6	7.6	7.6	7.6	7.6	7.6	7.6	7.6	7.6	
	HI PR	246	247	249	253	284	285	287	291	325	326	327	332	368	369	371	375	415	416	416	417	464	465	467	471	464	465	467	471		
	LO PR	124	126	129	134	132	133	136	141	138	140	143	148	143	145	148	153	149	150	152	155	157	156	157	160	156	157	160	165		
	MBh	18.9	19.2	19.8	20.6	18.8	19.0	19.6	20.4	18.3	18.6	19.1	19.9	17.5	17.7	18.3	19.1	16.5	16.7	17.3	18.1	15.6	15.8	16.4	17.2	15.6	15.8	16.4	17.2		

IDB		OUTDOOR AMBIENT TEMPERATURE																													
		65					75					85					95					105					115				
		59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75	59	63	67	71	75
85	525	MBh	18.7	19.0	19.5	20.4	18.6	18.8	19.4	20.2	18.1	18.3	18.9	19.7	17.3	17.5	18.1	18.9	16.3	16.5	17.1	17.9	15.3	15.6	16.1	17.0	15.3	15.6	16.1	17.0	
		S/T	1.00	0.84	0.71	0.58	1.00	0.85	0.72	0.58	1.00	0.80	0.74	0.61	1.00	1.00	0.76	0.62	1.00	1.00	0.78	0.64	1.00	1.00	0.73	0.69	1.00	1.00	0.73	0.69	
		ΔT	32	30	27	23	32	30	27	23	32	30	27	23	32	30	27	23	32	30	26	23	33	31	28	24	33	31	28	24	
		KW	1.09	1.09	1.09	1.10	1.22	1.22	1.22	1.23	1.36	1.36	1.36	1.37	1.51	1.51	1.51	1.52	1.68	1.68	1.68	1.69	1.88	1.88	1.87	1.88	1.88	1.88	1.87	1.88	1.88
		Amps	4.0	4.0	4.0	4.0	4.6	4.6	4.6	4.6	5.2	5.2	5.2	5.3	5.9	5.9	5.9	5.9	6.7	6.7	6.7	6.7	7.6	7.6	7.6	7.6	7.6	7.6	7.6	7.6	7.6
	600	HI PR	245	246	248	252	283	284	286	290	324	325	326	331	367	368	370	374	414	415	415	416	463	464	466	470	463	464	466	470	
		LO PR	124	126	129	134	132	133	136	141	138	140	143	148	144	145	148	153	149	150	152	155	157	156	157	160	156	157	160	165	
		MBh	19.0	19.2	19.8	20.6	18.8	19.1	19.6	20.4	18.3	18.6	19.1	20.0	17.5	17.8	18.3	19.1	16.5	16.8	17.3	18.1	15.6	15.8	16.4	17.2	15.6	15.8	16.4	17.2	
		S/T	1.00	0.90	0.77	0.63	1.00	0.90	0.77	0.64	1.00	0.80	0.80	0.66	1.00	1.00	0.82	0.68	1.00	1.00	0.84	0.70	1.00	1.00	0.73	0.75	1.00	1.00	0.73	0.75	
		ΔT	31	29	26	22	31	29	26	22	31	29	26	22	31	29	26	22	31	29	25	22	32	30	26	23	32	30	26	23	
675	KW	1.10	1.10	1.10	1.11	1.23	1.23	1.23	1.24	1.37	1.37	1.37	1.38	1.52	1.52	1.51	1.52	1.69	1.68	1.68	1.69	1.88	1.88	1.88	1.89	1.88	1.88	1.88	1.89	1.89	
	Amps	4.0	4.0	4.0	4.1	4.6	4.6	4.6	4.6	5.3	5.3	5.3	5.3	6.0	6.0	6.0	6.0	6.7	6.7	6.7	6.7	7.6	7.6	7.6	7.6	7.6	7.6	7.6	7.6	7.6	
	HI PR	247	248	250	254	285	287	288	292	326	327	328	333	369	370	372	376	416	417	418	423	465	467	468	472	465	467	468	472		
	LO PR	126	127	131	136	133	135	138	143	140	141	144	150	145	147	150	155	151	152	155	160	157	159	162	167	157	159	162	167		
	MBh	19.3	19.5	20.1	20.9	19.1	19.4	19.9	20.7	18.6	18.9	19.4	20.3	17.8	18.1	18.6	19.4	16.8	17.0	17.6	18.4	15.9	16.1	16.7	17.5	15.9	16.1	16.7	17.5		

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects AHRI conditions  
 kW = Total system power  
 Amps = outdoor unit amps (comp.+fan)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
550	MBh	18.1	18.4	18.9	-	18.0	18.2	18.8	-	17.5	17.8	18.3	-	16.7	17.0	17.5	-	15.7	16.0	16.5	-	14.8	15.1	15.6	-
	S/T	0.65	0.57	0.44	-	0.65	0.58	0.45	-	0.68	0.60	0.47	-	1.00	0.62	0.49	-	1.00	0.64	0.51	-	1.00	0.69	0.56	-
	ΔT	20	18	14	-	20	18	14	-	20	18	14	-	20	18	14	-	19	18	14	-	21	19	15	-
	KW	1.05	1.05	1.05	-	1.17	1.17	1.16	-	1.30	1.30	1.29	-	1.44	1.44	1.43	-	1.59	1.59	1.59	-	1.78	1.78	1.77	-
	Amps	3.9	3.9	3.9	-	4.4	4.4	4.4	-	5.0	5.0	5.0	-	5.7	5.7	5.6	-	6.4	6.4	6.4	-	7.2	7.2	7.2	-
HI PR	240	241	242	-	277	278	280	-	316	318	319	-	359	360	362	-	404	405	407	-	453	454	456	-	
LO PR	125	126	129	-	132	134	137	-	139	140	143	-	144	146	149	-	150	151	154	-	156	158	161	-	
600	MBh	18.3	18.6	19.1	-	18.2	18.4	19.0	-	17.7	18.0	18.5	-	16.9	17.2	17.7	-	15.9	16.2	16.7	-	15.0	15.3	15.8	-
	S/T	0.67	0.60	0.47	-	0.68	0.61	0.47	-	0.70	0.63	0.50	-	1.00	0.65	0.52	-	1.00	0.67	0.54	-	1.00	0.72	0.59	-
	ΔT	19	17	13	-	19	17	13	-	19	17	14	-	19	17	13	-	19	17	13	-	20	18	14	-
	KW	1.05	1.05	1.05	-	1.17	1.17	1.17	-	1.30	1.30	1.30	-	1.44	1.44	1.44	-	1.60	1.60	1.59	-	1.78	1.78	1.78	-
	Amps	3.9	3.9	3.9	-	4.4	4.4	4.4	-	5.0	5.0	5.0	-	5.7	5.7	5.7	-	6.4	6.4	6.4	-	7.2	7.2	7.2	-
HI PR	241	242	244	-	279	280	281	-	318	319	321	-	360	361	363	-	406	407	409	-	455	456	457	-	
LO PR	126	128	131	-	133	135	138	-	140	142	145	-	146	147	150	-	151	152	156	-	158	159	162	-	
675	MBh	18.7	18.9	19.5	-	18.5	18.8	19.3	-	18.1	18.3	18.9	-	17.3	17.5	18.1	-	16.3	16.5	17.1	-	15.4	15.6	16.2	-
	S/T	0.69	0.62	0.49	-	0.70	0.62	0.49	-	0.72	0.65	0.52	-	1.00	0.67	0.53	-	1.00	0.69	0.56	-	1.00	0.74	0.61	-
	ΔT	18	16	13	-	18	16	12	-	18	16	13	-	18	16	12	-	18	16	12	-	19	17	13	-
	KW	1.06	1.06	1.06	-	1.18	1.17	1.17	-	1.30	1.30	1.30	-	1.45	1.44	1.44	-	1.60	1.60	1.60	-	1.79	1.79	1.78	-
	Amps	3.9	3.9	3.9	-	4.5	4.5	4.5	-	5.1	5.1	5.0	-	5.7	5.7	5.7	-	6.4	6.4	6.4	-	7.3	7.3	7.2	-
HI PR	243	244	246	-	281	282	283	-	320	321	323	-	362	363	365	-	408	409	411	-	457	458	459	-	
LO PR	128	130	133	-	136	137	141	-	142	144	147	-	148	149	153	-	153	155	158	-	160	162	165	-	
75	MBh	18.2	18.4	18.9	19.8	18.0	18.2	18.8	19.6	17.5	17.8	18.3	19.1	16.7	17.0	17.5	18.3	15.7	16.0	16.5	17.3	14.8	15.1	15.6	16.4
	S/T	0.77	0.70	0.57	0.43	0.78	0.70	0.57	0.43	1.00	0.73	0.60	0.46	1.00	0.75	0.62	0.48	1.00	0.77	0.64	0.50	1.00	1.00	0.69	0.55
	ΔT	24	22	18	15	24	22	18	15	24	22	19	15	24	22	18	15	24	22	18	14	25	23	19	16
	KW	1.05	1.05	1.05	1.06	1.17	1.16	1.16	1.17	1.30	1.29	1.29	1.30	1.44	1.43	1.43	1.44	1.59	1.59	1.59	1.60	1.78	1.78	1.77	1.78
	Amps	3.9	3.9	3.9	3.9	4.4	4.4	4.4	4.4	5.0	5.0	5.0	5.0	5.7	5.6	5.6	5.7	6.4	6.4	6.4	6.4	7.2	7.2	7.2	7.2
HI PR	240	241	243	247	277	278	280	284	317	318	319	324	359	360	362	366	405	406	407	411	453	454	456	460	
LO PR	125	126	129	134	132	134	137	142	139	140	143	148	144	146	149	154	150	151	154	159	156	158	161	166	
600	MBh	18.4	18.6	19.1	20.0	18.2	18.4	19.0	19.8	17.7	18.0	18.5	19.3	16.9	17.2	17.7	18.5	15.9	16.2	16.7	17.5	15.0	15.3	15.8	16.6
	S/T	0.80	0.73	0.59	0.45	1.00	0.73	0.60	0.46	1.00	0.76	0.62	0.48	1.00	0.77	0.64	0.50	1.00	0.80	0.66	0.53	1.00	1.00	0.71	0.58
	ΔT	23	21	18	14	23	21	18	14	24	22	18	14	23	21	18	14	23	21	17	14	24	22	19	15
	KW	1.05	1.05	1.05	1.06	1.17	1.17	1.17	1.18	1.30	1.30	1.30	1.31	1.44	1.44	1.44	1.45	1.60	1.60	1.59	1.60	1.78	1.78	1.78	1.79
	Amps	3.9	3.9	3.9	3.9	4.4	4.4	4.4	4.5	5.0	5.0	5.0	5.1	5.7	5.7	5.7	5.7	6.4	6.4	6.4	6.4	7.2	7.2	7.2	7.3
HI PR	241	242	244	248	279	280	282	286	318	319	321	325	360	361	363	367	406	407	409	413	455	456	457	462	
LO PR	126	128	131	136	133	135	138	143	140	142	145	150	146	147	150	155	151	153	156	161	158	159	162	168	
675	MBh	18.7	19.0	19.5	20.3	18.5	18.8	19.3	20.2	18.1	18.3	18.9	19.7	17.3	17.5	18.1	18.9	16.3	16.5	17.1	17.9	15.4	15.6	16.2	17.0
	S/T	0.82	0.74	0.61	0.47	1.00	0.75	0.62	0.48	1.00	0.77	0.64	0.50	1.00	0.79	0.66	0.52	1.00	1.00	0.68	0.54	1.00	1.00	0.73	0.59
	ΔT	22	20	17	13	22	20	17	13	23	21	17	13	22	20	17	13	22	20	16	13	23	21	18	14
	KW	1.06	1.06	1.06	1.06	1.17	1.17	1.17	1.18	1.30	1.30	1.30	1.31	1.44	1.44	1.44	1.45	1.60	1.60	1.60	1.61	1.79	1.78	1.78	1.79
	Amps	3.9	3.9	3.9	4.0	4.5	4.5	4.4	4.5	5.1	5.0	5.0	5.1	5.7	5.7	5.7	5.7	6.4	6.4	6.4	6.4	7.3	7.3	7.2	7.3
HI PR	244	245	246	250	281	282	284	288	320	321	323	327	363	364	365	369	408	409	411	415	457	458	460	464	
LO PR	128	130	133	138	136	137	141	146	142	144	147	152	148	149	153	158	153	155	158	163	160	162	165	170	

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects ACCA (TVA) conditions  
 kW = Total system power  
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — ASX140191K\* + CA\*F3636\*6\*\* + EEP + TXV (CONT.)

IDB		OUTDOOR AMBIENT TEMPERATURE																							
		85					95					105					115								
		75				85				95				105				115							
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71				
<b>550</b>	MBh	18.2	18.5	19.0	19.8	18.1	18.3	18.9	19.7	17.6	17.9	18.4	19.2	16.8	17.1	17.6	18.4	15.8	16.1	16.6	17.4	14.9	15.2	15.7	16.5
	S/T	1.00	0.82	0.69	0.6	1.00	0.83	0.69	0.56	1.00	0.85	0.72	0.6	1.00	1.00	0.74	0.60	1.00	1.00	0.76	0.6	1.00	1.00	0.81	0.67
	ΔT	28	26	23	19	28	26	23	19	29	27	23	19	28	26	23	19	28	26	22	19	29	27	24	20
	KW	1.05	1.05	1.05	1.1	1.17	1.17	1.16	1.17	1.30	1.30	1.29	1.3	1.44	1.44	1.43	1.44	1.59	1.59	1.59	1.6	1.78	1.78	1.77	1.78
	Amps	3.9	3.9	3.9	3.9	4.4	4.4	4.4	4.5	5.0	5.0	5.0	5.0	5.7	5.7	5.6	5.7	6.4	6.4	6.4	6.4	7.2	7.2	7.2	7.2
<b>600</b>	HI PR	240	241	243	247	278	279	281	285	317	318	320	324	359	360	362	366	405	406	408	412	454	455	456	461
	LO PR	125	127	130	135	133	134	137	142	139	141	144	149	145	146	149	155	150	152	155	160	157	158	162	167
	MBh	18.4	18.7	19.2	20.0	18.3	18.5	19.1	19.9	17.8	18.1	18.6	19.4	17.0	17.3	17.8	18.6	16.0	16.3	16.8	17.6	15.1	15.4	15.9	16.7
	S/T	1.00	0.85	0.72	0.6	1.00	0.85	0.72	0.58	1.00	0.88	0.75	0.6	1.00	1.00	0.76	0.63	1.00	1.00	0.79	0.7	1.00	1.00	0.84	0.70
	ΔT	28	26	22	18	28	26	22	18	28	26	22	19	28	26	22	18	27	25	22	18	28	27	23	19
<b>675</b>	KW	1.06	1.06	1.06	1.1	1.17	1.17	1.17	1.18	1.30	1.30	1.30	1.3	1.44	1.44	1.44	1.45	1.60	1.60	1.59	1.6	1.78	1.78	1.78	1.79
	Amps	3.9	3.9	3.9	3.9	4.4	4.4	4.4	4.5	5.0	5.0	5.0	5.1	5.7	5.7	5.7	5.7	6.4	6.4	6.4	6.4	7.2	7.2	7.2	7.3
	HI PR	242	243	244	249	279	280	282	286	319	320	321	325	361	362	364	368	406	408	409	413	455	456	458	462
	LO PR	127	128	131	136	134	136	139	144	141	142	145	150	146	148	151	156	152	153	156	161	158	160	163	168
	MBh	18.8	19.1	19.6	20.4	18.6	18.9	19.4	20.2	18.2	18.4	19.0	19.8	17.4	17.6	18.2	19.0	16.4	16.6	17.2	18.0	15.5	15.7	16.3	17.1

IDB		OUTDOOR AMBIENT TEMPERATURE																							
		85					95					105					115								
		75				85				95				105				115							
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71				
<b>550</b>	MBh	18.5	18.8	19.3	20.2	18.4	18.6	19.2	20.0	17.9	18.2	18.7	19.5	17.1	17.4	17.9	18.7	16.1	16.4	16.9	17.7	15.2	15.5	16.0	16.8
	S/T	1.00	0.92	0.79	0.65	1.00	1.00	0.79	0.65	1.00	1.00	0.82	0.68	1.00	1.00	0.84	0.70	1.00	1.00	0.86	0.72	1.00	1.00	1.00	0.77
	ΔT	32	30	27	23	32	30	27	23	32	30	27	23	32	30	27	23	32	30	26	23	33	31	27	24
	KW	1.05	1.05	1.05	1.06	1.17	1.17	1.17	1.17	1.30	1.30	1.30	1.30	1.44	1.44	1.44	1.44	1.60	1.59	1.59	1.60	1.78	1.78	1.78	1.79
	Amps	3.9	3.9	3.9	3.9	4.4	4.4	4.4	4.5	5.0	5.0	5.0	5.1	5.7	5.7	5.7	5.7	6.4	6.4	6.4	6.4	7.2	7.2	7.2	7.3
<b>600</b>	HI PR	241	242	244	248	279	280	282	286	318	319	321	325	361	362	363	367	406	407	409	413	455	456	458	462
	LO PR	127	128	132	137	134	136	139	144	141	143	146	151	147	148	151	156	152	153	157	162	159	160	163	169
	MBh	18.7	19.0	19.5	20.4	18.6	18.8	19.4	20.2	18.1	18.4	18.9	19.7	17.3	17.6	18.1	18.9	16.3	16.6	17.1	17.9	15.4	15.7	16.2	17.0
	S/T	1.00	0.95	0.81	0.67	1.00	1.00	0.82	0.68	1.00	1.00	0.84	0.71	1.00	1.00	0.86	0.72	1.00	1.00	0.88	0.75	1.00	1.00	1.00	0.80
	ΔT	31	29	26	22	31	29	26	22	32	30	26	22	31	29	26	22	31	29	26	22	32	30	27	23
<b>675</b>	KW	1.06	1.06	1.06	1.07	1.17	1.17	1.17	1.18	1.30	1.30	1.30	1.31	1.44	1.44	1.44	1.45	1.60	1.60	1.60	1.61	1.78	1.78	1.78	1.79
	Amps	3.9	3.9	3.9	3.9	4.5	4.5	4.4	4.5	5.0	5.0	5.0	5.1	5.7	5.7	5.7	5.7	6.4	6.4	6.4	6.4	7.2	7.2	7.2	7.3
	HI PR	243	244	246	250	280	281	283	287	320	321	322	327	362	363	365	369	408	409	410	414	456	457	459	463
	LO PR	128	130	133	138	136	137	141	146	142	144	147	152	148	149	153	158	153	155	158	163	160	162	165	170
	MBh	19.1	19.4	19.9	20.7	18.9	19.2	19.7	20.5	18.5	18.7	19.3	20.1	17.7	17.9	18.5	19.3	16.7	16.9	17.5	18.3	15.8	16.0	16.6	17.4

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.

Shaded area reflects AHRI conditions  
 kW = Total system power  
 Amps = outdoor unit amps (comp.+fan)



		Outdoor Ambient Temperature												115																							
		65						75						85						95						105						115					
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71				
<b>70</b>	<b>Airflow</b>	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71				
	MBh	23.9	24.2	25.0	-	23.7	24.0	24.7	-	23.1	23.4	24.1	-	22.0	22.4	23.1	-	20.7	21.1	21.8	-	19.5	19.9	20.6	-												
	S/T	0.6	0.6	0.4	-	0.6	0.6	0.4	-	0.7	0.6	0.5	-	0.7	0.6	0.5	-	1.0	0.6	0.5	-	1.0	0.7	0.6	-												
	ΔT	20	18	14	-	20	18	14	-	20	18	15	-	20	18	14	-	20	18	14	-	21	19	15	-												
	KW	1.4	1.4	1.4	-	1.6	1.6	1.6	-	1.7	1.7	1.7	-	1.9	1.9	1.9	-	2.2	2.2	2.1	-	2.4	2.4	2.4	-												
	Amps	5.2	5.2	5.2	-	5.9	5.9	5.9	-	6.7	6.7	6.7	-	7.6	7.6	7.6	-	8.6	8.6	8.6	-	9.8	9.8	9.8	-												
	HI PR	254	255	257	-	294	295	297	-	335	337	338	-	380	381	383	-	429	430	431	-	480	481	483	-												
	LO PR	124	125	128	-	131	132	136	-	137	139	142	-	143	144	148	-	148	150	153	-	155	157	160	-												
	MBh	24.3	24.7	25.4	-	24.1	24.5	25.2	-	23.5	23.9	24.6	-	22.5	22.8	23.5	-	21.2	21.5	22.2	-	20.0	20.3	21.0	-												
	S/T	0.7	0.6	0.5	-	0.7	0.6	0.5	-	0.7	0.6	0.5	-	1.0	0.6	0.5	-	1.0	0.7	0.5	-	1.0	0.7	0.6	-												
ΔT	19	17	13	-	19	17	13	-	19	17	13	-	19	17	13	-	19	17	13	-	20	18	14	-													
KW	1.4	1.4	1.4	-	1.6	1.6	1.6	-	1.7	1.7	1.7	-	1.9	1.9	1.9	-	2.2	2.2	2.2	-	2.4	2.4	2.4	-													
Amps	5.2	5.2	5.2	-	6.0	5.9	5.9	-	6.8	6.8	6.8	-	7.7	7.7	7.7	-	8.7	8.7	8.7	-	9.9	9.8	9.8	-													
HI PR	256	257	259	-	296	297	299	-	338	339	341	-	383	384	385	-	431	432	434	-	483	484	485	-													
LO PR	126	127	130	-	133	135	138	-	140	141	144	-	145	147	150	-	151	152	155	-	157	159	162	-													
MBh	24.9	25.2	25.9	-	24.7	25.0	25.7	-	24.0	24.4	25.1	-	23.0	23.3	24.0	-	21.7	22.0	22.7	-	20.5	20.8	21.5	-													
S/T	0.7	0.6	0.5	-	0.7	0.6	0.5	-	0.7	0.6	0.5	-	1.0	0.7	0.5	-	1.0	0.7	0.5	-	1.0	0.7	0.6	-													
ΔT	18	16	12	-	18	16	12	-	18	16	13	-	18	16	12	-	18	16	12	-	19	17	13	-													
KW	1.4	1.4	1.4	-	1.6	1.6	1.6	-	1.8	1.8	1.8	-	1.9	1.9	1.9	-	2.2	2.2	2.2	-	2.4	2.4	2.4	-													
Amps	5.2	5.2	5.2	-	6.0	6.0	6.0	-	6.8	6.8	6.8	-	7.7	7.7	7.7	-	8.7	8.7	8.7	-	9.9	9.9	9.9	-													
HI PR	259	260	262	-	299	300	301	-	340	341	343	-	385	386	388	-	433	435	436	-	485	486	488	-													
LO PR	128	130	133	-	136	137	141	-	142	144	147	-	148	149	152	-	153	155	158	-	160	162	165	-													
<b>75</b>	<b>Airflow</b>	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71				
	MBh	23.9	24.3	25.0	26.0	23.7	24.0	24.8	25.8	23.1	23.4	24.1	25.2	22.0	22.4	23.1	24.2	20.7	21.1	21.8	22.9	19.6	19.9	20.6	21.7												
	S/T	0.8	0.7	0.6	0.4	0.8	0.7	0.6	0.4	1.0	0.7	0.6	0.4	1.0	0.7	0.6	0.5	1.0	0.8	0.6	0.5	1.0	1.0	0.7	0.5												
	ΔT	24	22	19	15	24	22	19	15	25	23	19	15	24	22	19	15	24	22	18	15	25	23	20	16												
	KW	1.4	1.4	1.4	1.4	1.6	1.6	1.6	1.6	1.7	1.7	1.7	1.7	1.9	1.9	1.9	1.9	2.2	2.2	2.1	2.2	2.4	2.4	2.4	2.4												
	Amps	5.2	5.2	5.2	5.2	5.9	5.9	5.9	6.0	6.7	6.7	6.7	6.8	7.6	7.6	7.6	7.7	8.6	8.6	8.6	8.7	9.8	9.8	9.8	9.9												
	HI PR	254	255	257	261	294	295	297	301	336	337	338	343	380	382	383	388	429	430	432	436	480	481	483	488												
	LO PR	124	125	128	133	131	132	136	141	137	139	142	147	143	144	148	153	148	150	153	158	155	157	160	165												
	MBh	24.4	24.7	25.4	26.5	24.1	24.5	25.2	26.3	23.5	23.9	24.6	25.6	22.5	22.8	23.5	24.6	21.2	21.5	22.2	23.3	20.0	20.3	21.0	22.1												
	S/T	0.8	0.7	0.6	0.5	1.0	0.7	0.6	0.5	1.0	0.8	0.6	0.5	1.0	0.8	0.6	0.5	1.0	0.8	0.7	0.5	1.0	1.0	0.7	0.6												
ΔT	23	21	18	14	23	21	18	14	23	21	18	14	23	21	18	14	23	21	17	13	24	22	18	15													
KW	1.4	1.4	1.4	1.4	1.6	1.6	1.6	1.6	1.7	1.7	1.7	1.8	1.9	1.9	1.9	2.0	2.2	2.2	2.2	2.2	2.4	2.4	2.4	2.4													
Amps	5.2	5.2	5.2	5.2	6.0	5.9	5.9	6.0	6.8	6.8	6.8	6.8	7.7	7.7	7.7	7.7	8.7	8.7	8.7	8.7	9.8	9.8	9.8	9.9													
HI PR	257	258	259	264	296	297	299	304	338	339	341	345	383	384	386	390	431	432	434	438	483	484	486	490													
LO PR	126	127	130	136	133	135	138	143	140	141	144	150	145	147	150	155	151	152	155	160	157	159	162	167													
MBh	24.9	25.2	25.9	27.0	24.7	25.0	25.7	26.8	24.1	24.4	25.1	26.2	23.0	23.3	24.0	25.1	21.7	22.0	22.7	23.8	20.5	20.9	21.6	22.6													
S/T	0.8	0.7	0.6	0.5	1.0	0.7	0.6	0.5	1.0	0.8	0.6	0.5	1.0	0.8	0.6	0.5	1.0	0.8	0.7	0.5	1.0	1.0	0.7	0.6													
ΔT	22	20	17	13	22	20	17	13	22	20	17	13	22	20	17	13	22	20	16	12	23	21	17	14													
KW	1.4	1.4	1.4	1.4	1.6	1.6	1.6	1.6	1.8	1.8	1.8	1.8	1.9	1.9	1.9	2.0	2.2	2.2	2.2	2.2	2.4	2.4	2.4	2.4													
Amps	5.2	5.2	5.2	5.3	6.0	6.0	6.0	6.0	6.8	6.8	6.8	6.8	7.7	7.7	7.7	7.7	8.7	8.7	8.7	8.7	9.9	9.9	9.9	9.9													
HI PR	259	260	262	266	299	300	302	306	340	342	343	348	385	386	388	393	434	435	437	441	485	486	488	492													
LO PR	129	130	133	138	136	137	141	146	142	144	147	152	148	149	153	158	153	155	158	163	160	162	165	170													

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects ACCA (TVA) conditions  
 kW = Total system power  
 Amps = outdoor unit amps (comp.+fan)

IDB		Outdoor Ambient Temperature														105														115																					
		65							75							85							95							105							115														
		59	63	67	71	75	79	83	59	63	67	71	75	79	83	59	63	67	71	75	79	83	59	63	67	71	75	79	83	59	63	67	71	75	79	83															
<b>700</b>		MBh	24.0	24.4	25.1	26.2	23.8	24.2	24.9	26.0	23.2	23.6	24.3	25.3	22.2	22.5	23.2	24.3	20.9	21.2	21.9	23.0	19.7	20.0	20.7	21.8	24.0	24.4	25.1	26.2	23.8	24.2	24.9	26.0	23.2	23.6	24.3	25.3	22.2	22.5	23.2	24.3	20.9	21.2	21.9	23.0	19.7	20.0	20.7	21.8	
<b>80</b>		S/T	1.0	0.8	0.7	0.5	1.0	0.8	0.7	0.5	1.0	0.8	0.7	0.6	1.0	0.9	0.7	0.6	1.0	1.0	1.0	0.8	0.6	1.0	1.0	0.8	0.7	1.0	0.8	0.7	0.5	1.0	0.8	0.7	0.6	1.0	0.9	0.7	0.6	1.0	1.0	1.0	0.8	0.6	1.0	1.0	1.0	0.8	0.7		
		ΔT	29	27	23	19	29	27	23	19	29	27	23	19	29	27	23	19	29	28	26	23	19	30	28	24	20	29	27	23	19	29	27	23	19	29	27	23	19	29	28	26	23	19	30	28	26	23	19		
		kW	1.4	1.4	1.4	1.4	1.6	1.6	1.6	1.6	1.7	1.7	1.7	1.7	1.9	1.9	1.9	1.9	1.9	2.2	2.2	2.1	2.2	2.4	2.4	2.4	2.4	1.4	1.4	1.4	1.4	1.6	1.6	1.6	1.6	1.7	1.7	1.7	1.7	1.9	1.9	1.9	1.9	2.2	2.2	2.1	2.2	2.4	2.4	2.4	2.4
		Amps	5.2	5.2	5.2	5.2	5.9	5.9	5.9	6.0	6.7	6.7	6.7	6.8	7.6	7.6	7.6	7.7	8.6	8.6	8.6	8.6	9.8	9.8	9.8	9.9	5.2	5.2	5.2	5.2	5.9	5.9	5.9	6.0	6.7	6.7	6.7	6.8	7.6	7.6	7.6	7.7	8.6	8.6	8.6	8.6	9.8	9.8	9.8	9.9	
		HI PR	255	256	258	262	294	296	297	302	336	337	339	343	381	382	384	388	429	430	432	437	481	482	484	488	255	256	258	262	294	296	297	302	336	337	339	343	381	382	384	388	429	430	432	437	481	482	484	488	
		LO PR	126	126	129	134	132	133	136	141	138	140	143	148	143	145	148	153	149	150	153	159	156	157	160	165	126	126	129	134	132	133	136	141	138	140	143	148	143	145	148	153	149	150	153	159	156	157	160	165	
<b>900</b>		MBh	24.5	24.8	25.5	26.6	24.3	24.6	25.3	26.4	23.7	24.0	24.7	25.8	22.6	22.9	23.6	24.7	21.3	21.6	22.3	23.4	20.1	20.4	21.2	22.2	24.5	24.8	25.5	26.6	24.3	24.6	25.3	26.4	23.7	24.0	24.7	25.8	22.6	22.9	23.6	24.7	21.3	21.6	22.3	23.4	20.1	20.4	21.2	22.2	
		S/T	1.0	0.8	0.7	0.6	1.0	0.8	0.7	0.6	1.0	0.9	0.7	0.6	1.0	1.0	1.0	0.8	0.6	1.0	1.0	1.0	0.8	0.6	1.0	1.0	0.8	0.7	1.0	0.8	0.7	0.6	1.0	0.9	0.7	0.6	1.0	1.0	1.0	0.8	0.6	1.0	1.0	1.0	0.8	0.6	1.0	1.0	1.0	0.8	0.7
		ΔT	28	26	22	18	28	26	22	18	28	26	22	18	27	26	22	18	27	25	22	18	28	26	23	19	28	26	22	18	28	26	22	18	27	26	22	18	27	25	22	18	27	25	22	18	28	26	23	19	
		kW	1.4	1.4	1.4	1.4	1.6	1.6	1.6	1.6	1.7	1.7	1.7	1.8	1.9	1.9	1.9	2.0	2.2	2.2	2.2	2.2	2.4	2.4	2.4	2.4	1.4	1.4	1.4	1.4	1.6	1.6	1.6	1.6	1.7	1.7	1.7	1.8	1.9	1.9	1.9	2.0	2.2	2.2	2.2	2.2	2.4	2.4	2.4	2.4	
		Amps	5.2	5.2	5.2	5.3	6.0	5.9	5.9	6.0	6.8	6.8	6.8	6.8	7.7	7.7	7.7	7.7	8.7	8.7	8.7	8.7	9.9	9.8	9.8	9.9	5.2	5.2	5.2	5.3	6.0	5.9	5.9	6.0	6.8	6.8	6.8	6.8	7.7	7.7	7.7	7.7	8.7	8.7	8.7	8.7	9.9	9.8	9.8	9.9	
		HI PR	257	258	260	264	297	298	300	304	338	340	341	346	383	384	386	391	432	433	435	439	483	484	486	490	257	258	260	264	297	298	300	304	338	340	341	346	383	384	386	391	432	433	435	439	483	484	486	490	
		LO PR	129	131	134	139	136	138	141	146	143	144	148	153	148	150	153	158	154	155	158	164	161	162	165	170	129	131	134	139	136	138	141	146	143	144	148	153	148	150	153	158	154	155	158	164	161	162	165	170	

IDB		Outdoor Ambient Temperature														105														115																						
		65							75							85							95							105							115															
		59	63	67	71	75	79	83	59	63	67	71	75	79	83	59	63	67	71	75	79	83	59	63	67	71	75	79	83	59	63	67	71	75	79	83																
<b>700</b>		MBh	24.4	24.8	25.5	26.6	24.2	24.6	25.3	26.4	23.6	24.0	24.7	25.7	22.6	22.9	23.6	24.7	21.3	21.6	22.3	23.4	20.1	20.4	21.1	22.2	24.4	24.8	25.5	26.6	24.2	24.6	25.3	26.4	23.6	24.0	24.7	25.7	22.6	22.9	23.6	24.7	21.3	21.6	22.3	23.4	20.1	20.4	21.1	22.2		
		S/T	1.0	0.9	0.8	0.6	1.0	0.9	0.8	0.6	1.0	1.0	0.8	0.7	1.0	1.0	1.0	0.8	0.7	1.0	1.0	1.0	0.8	0.7	1.0	1.0	0.8	0.7	1.0	0.9	0.8	0.6	1.0	0.9	0.8	0.7	1.0	1.0	1.0	0.8	0.7	1.0	1.0	1.0	0.8	0.7	1.0	1.0	1.0	0.8	0.7	
		ΔT	33	31	27	23	32	31	27	23	33	31	27	23	32	31	27	23	32	30	27	23	33	31	28	24	24	33	31	27	23	32	31	27	23	32	31	27	23	32	30	27	23	32	31	27	23	33	31	28	24	24
		kW	1.4	1.4	1.4	1.4	1.6	1.6	1.6	1.6	1.7	1.7	1.7	1.8	1.9	1.9	1.9	2.0	2.2	2.2	2.2	2.2	2.4	2.4	2.4	2.4	1.4	1.4	1.4	1.4	1.6	1.6	1.6	1.6	1.7	1.7	1.7	1.8	1.9	1.9	1.9	2.0	2.2	2.2	2.2	2.2	2.4	2.4	2.4	2.4		
		Amps	5.2	5.2	5.2	5.2	5.9	5.9	5.9	6.0	6.8	6.8	6.7	6.8	7.7	7.7	7.6	7.6	8.7	8.7	8.6	8.7	9.8	9.8	9.8	9.9	5.2	5.2	5.2	5.2	5.9	5.9	5.9	6.0	6.8	6.8	6.7	6.8	7.7	7.7	7.6	7.6	8.7	8.7	8.6	8.7	9.8	9.8	9.8	9.9		
		HI PR	256	257	259	263	296	297	299	303	337	338	340	345	382	383	385	389	430	432	433	438	482	483	485	489	256	257	259	263	296	297	299	303	337	338	340	345	382	383	385	389	430	432	433	438	482	483	485	489		
		LO PR	126	127	131	136	133	135	138	143	140	141	144	152	145	147	150	155	151	152	155	160	157	159	162	167	126	127	131	136	133	135	138	143	140	141	144	152	145	147	150	155	151	152	155	160	157	159	162	167		
<b>800</b>		MBh	24.9	25.2	25.9	27.0	24.7	25.0	25.7	26.8	24.1	24.4	25.1	26.2	23.0	23.3	24.0	25.1	21.7	22.0	22.7	23.8	20.5	20.8	21.5	22.6	24.9	25.2	25.9	27.0	24.7	25.0	25.7	26.8	24.1	24.4	25.1	26.2	23.0	23.3	24.0	25.1	21.7	22.0	22.7	23.8	20.5	20.8	21.5	22.6		
		S/T	1.0	0.9	0.8	0.7	1.0	1.0	0.8	0.7	1.0	1.0	0.8	0.7	1.0	1.0	1.0	0.9	0.7	1.0	1.0	1.0	0.9	0.7	1.0	1.0	0.8	0.7	1.0	0.9	0.8	0.7	1.0	1.0	1.0	0.9	0.7	1.0	1.0	1.0	0.9	0.7	1.0	1.0	1.0	0.9	0.7	1.0	1.0	1.0	0.8	0.7
		ΔT	31	29	26	22	31	29	26	22	32	30	26	22	31	29	26	22	31	29	25	22	32	30	27	23	23	31	29	26	22	31	29	26	22	31	29	26	22	31	29	25	22	31	29	25	22	32	30	27	23	
		kW	1.4	1.4	1.4	1.4	1.6	1.6	1.6	1.6	1.8	1.8	1.7	1.8	1.9	1.9	1.9	2.0	2.2	2.2	2.2	2.2	2.4	2.4	2.4	2.4	1.4	1.4	1.4	1.4	1.6	1.6	1.6	1.6	1.8	1.8	1.7	1.8	1.9	1.9	1.9	2.0	2.2	2.2	2.2	2.2	2.4	2.4	2.4	2.4		
		Amps	5.2	5.2	5.2	5.3	6.0	6.0	6.0	6.0	6.8	6.8	6.8	6.8	7.7	7.7	7.7	7.7	8.7	8.7	8.7	8.7	9.9	9.9	9.9	9.9	5.2	5.2	5.2	5.3	6.0	6.0	6.0	6.0	6.8	6.8	6.8	6.8	7.7	7.7	7.7	7.7	8.7	8.7	8.7	8.7	9.9	9.9	9.9	9.9		
		HI PR	258	259	261	266	298	299	301	305	340	341	343	347	384	386	387	392	433	434	436	440	484	486	487	492	258	259	261	266	298	299	301	305	340	341	343	347	384	386	387	392	433	434	436	440	484	486	487	492		
		LO PR	128	130	133	138	136	137	140	145	142	144	147	152	148	149	152	157	153	154	158	163	160	161	164	170	128	130	133	138	136	137	140	145	142	144	147	152	148	149	152	157										

IDB		OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE																																										
		65						75						85						95						105						115																								
		59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79																			
700	MBh	24.5	24.9	25.6	-	-	24.3	24.7	25.4	-	-	23.7	24.0	24.7	-	-	22.6	22.9	23.7	-	-	21.3	21.6	22.3	-	-	20.1	20.4	21.1	-	-	1.00	0.67	0.55	-	-	2.43	2.43	2.43	-	-	10.0	10.0	10.0	-	-	478	480	481	-	-	152	153	156	-	-
	S/T	0.63	0.56	0.43	-	-	0.63	0.56	0.43	-	-	0.66	0.59	0.46	-	-	0.68	0.60	0.48	-	-	1.00	0.62	0.50	-	-	1.00	0.67	0.55	-	-	2.43	2.43	2.43	-	-	10.0	10.0	10.0	-	-	478	480	481	-	-	152	153	156	-	-					
	ΔT	20	18	15	-	-	20	18	15	-	-	21	19	15	-	-	20	18	15	-	-	20	18	14	-	-	21	19	16	-	-	2.43	2.43	2.43	-	-	10.0	10.0	10.0	-	-	478	480	481	-	-	152	153	156	-	-					
	KW	1.41	1.40	1.40	-	-	1.57	1.57	1.57	-	-	1.75	1.75	1.75	-	-	1.95	1.95	1.95	-	-	2.17	2.17	2.17	-	-	2.43	2.43	2.43	-	-	10.0	10.0	10.0	-	-	478	480	481	-	-	152	153	156	-	-										
	Amps	5.3	5.3	5.2	-	-	6.0	6.0	6.0	-	-	6.9	6.8	6.8	-	-	7.8	7.8	7.7	-	-	8.8	8.8	8.8	-	-	10.0	10.0	10.0	-	-	478	480	481	-	-	152	153	156	-	-															
	HI PR	253	254	256	-	-	293	294	296	-	-	334	335	337	-	-	379	380	382	-	-	427	428	430	-	-	478	480	481	-	-	152	153	156	-	-																				
	LO PR	121	123	126	-	-	128	130	133	-	-	135	136	139	-	-	140	142	145	-	-	145	147	150	-	-	152	153	156	-	-																									
	MBh	25.0	25.3	26.0	-	-	24.1	24.5	25.2	-	-	23.0	23.4	24.1	-	-	21.7	22.1	22.8	-	-	20.5	20.8	21.6	-	-	1.00	0.71	0.58	-	-	2.44	2.44	2.44	-	-	10.0	10.0	10.0	-	-	481	482	484	-	-	154	156	159	-	-					
	S/T	0.66	0.59	0.46	-	-	0.67	0.60	0.47	-	-	0.69	0.62	0.49	-	-	0.71	0.64	0.51	-	-	1.00	0.66	0.53	-	-	1.00	0.71	0.58	-	-	2.44	2.44	2.44	-	-	10.0	10.0	10.0	-	-	481	482	484	-	-	154	156	159	-	-					
	ΔT	19	17	14	-	-	19	17	13	-	-	19	17	14	-	-	19	17	13	-	-	19	17	13	-	-	20	18	14	-	-	2.44	2.44	2.44	-	-	10.0	10.0	10.0	-	-	481	482	484	-	-	154	156	159	-	-					
KW	1.42	1.42	1.42	-	-	1.59	1.58	1.58	-	-	1.77	1.77	1.76	-	-	1.97	1.97	1.96	-	-	2.19	2.19	2.19	-	-	2.45	2.45	2.45	-	-	10.0	10.0	10.0	-	-	483	484	486	-	-	157	158	161	-	-											
Amps	5.3	5.3	5.3	-	-	6.1	6.1	6.1	-	-	6.9	6.9	6.9	-	-	7.8	7.8	7.8	-	-	8.8	8.8	8.8	-	-	10.0	10.0	10.0	-	-	483	484	486	-	-	157	158	161	-	-																
HI PR	258	259	261	-	-	298	299	300	-	-	339	340	342	-	-	384	385	387	-	-	432	433	435	-	-	483	484	486	-	-	157	158	161	-	-																					
LO PR	126	127	130	-	-	133	135	138	-	-	140	141	144	-	-	145	146	149	-	-	150	152	155	-	-	157	158	161	-	-																										

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects ACCA (TVA) conditions  
 kW = Total system power  
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — ASX140251L\* + CA\*F3636\*6\*\* + EEP (CONT.)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																							
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
<b>80</b>	MBh	24.7	25.0	25.7	26.8	24.5	24.8	25.5	26.6	23.8	24.2	24.9	26.0	22.7	23.1	<b>23.8</b>	24.9	21.4	21.7	22.5	23.6	20.2	20.5	21.3	22.4
	S/T	0.87	0.80	0.67	0.5	1.00	0.80	0.67	0.54	1.00	0.83	0.70	0.6	1.00	0.84	<b>0.72</b>	0.58	1.00	1.00	0.74	0.6	1.00	1.00	0.79	0.65
	ΔT	29	27	23	20	29	27	23	20	29	27	24	20	29	27	<b>23</b>	20	29	27	23	19	30	28	24	21
	KW	1.41	1.40	1.40	1.4	1.57	1.57	1.57	1.58	1.75	1.75	1.75	1.8	1.95	1.95	<b>1.95</b>	1.96	2.17	2.17	2.17	2.2	2.43	2.43	2.43	2.44
	Amps	5.3	5.3	5.2	5.3	6.0	6.0	6.0	6.1	6.9	6.8	6.8	6.9	7.8	7.8	<b>7.7</b>	7.8	8.8	8.8	8.8	8.8	10.0	10.0	10.0	10.0
	HI PR	254	255	257	261	293	294	296	301	335	336	338	342	380	381	<b>382</b>	387	428	429	431	435	479	480	482	486
	LO PR	122	123	126	131	129	130	133	139	135	137	140	145	141	142	<b>145</b>	150	146	147	150	156	153	154	157	162
	MBh	25.1	25.5	26.2	27.3	24.9	25.2	26.0	27.1	24.3	24.6	25.3	26.4	23.2	23.5	24.2	25.3	21.8	22.2	22.9	24.0	20.6	21.0	21.7	22.8
	S/T	1.00	0.83	0.70	0.6	1.00	0.84	0.71	0.57	1.00	0.86	0.73	0.6	1.00	0.88	0.75	0.62	1.00	1.00	0.77	0.6	1.00	1.00	0.82	0.69
	ΔT	28	26	22	18	28	26	22	18	28	26	23	19	28	26	22	18	28	26	22	18	29	27	23	19
KW	1.41	1.41	1.41	1.4	1.58	1.58	1.57	1.59	1.76	1.76	1.76	1.8	1.96	1.96	1.96	1.97	2.18	2.18	2.18	2.2	2.44	2.44	2.44	2.45	
Amps	5.3	5.3	5.3	5.3	6.0	6.0	6.0	6.1	6.9	6.9	6.9	6.9	7.8	7.8	7.8	7.8	8.8	8.8	8.8	8.9	10.0	10.0	10.0	10.0	
HI PR	256	257	259	263	296	297	299	303	337	338	340	344	382	383	385	389	430	431	433	437	481	483	484	489	
LO PR	124	125	128	133	131	133	136	141	138	139	142	147	143	144	147	152	148	150	153	158	155	156	159	164	
MBh	25.7	26.0	26.7	27.8	25.4	25.8	26.5	27.6	24.8	25.2	25.9	27.0	23.7	24.1	24.8	25.9	22.4	22.7	23.5	24.6	21.2	21.5	22.2	23.3	
S/T	1.00	0.84	0.71	0.6	1.00	0.84	0.72	0.58	1.00	0.87	0.74	0.6	1.00	1.00	0.76	0.62	1.00	1.00	0.78	0.6	1.00	1.00	0.83	0.69	
ΔT	27	25	21	17	27	25	21	17	27	25	22	18	27	25	21	17	27	25	21	17	28	26	22	18	
KW	1.42	1.42	1.42	1.4	1.58	1.58	1.58	1.59	1.77	1.77	1.76	1.8	1.97	1.97	1.96	1.98	2.19	2.19	2.19	2.2	2.45	2.45	2.45	2.46	
Amps	5.3	5.3	5.3	5.4	6.1	6.1	6.1	6.1	6.9	6.9	6.9	7.0	7.8	7.8	7.8	7.9	8.8	8.8	8.8	8.9	10.0	10.0	10.0	10.1	
HI PR	259	260	261	266	298	299	301	305	340	341	343	347	384	385	387	392	433	434	435	440	484	485	487	491	
LO PR	126	128	131	136	134	135	138	143	140	142	145	150	145	147	150	155	151	152	155	160	157	159	162	167	

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																							
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
<b>85</b>	MBh	25.1	25.4	26.1	27.2	24.9	25.2	25.9	27.0	24.2	24.6	25.3	26.4	23.1	23.5	24.2	25.3	21.8	22.2	22.9	24.0	20.6	20.9	21.7	22.8
	S/T	1.00	0.89	0.76	0.63	1.00	0.90	0.77	0.63	1.00	1.00	0.79	0.66	1.00	1.00	0.81	0.68	1.00	1.00	0.83	0.70	1.00	1.00	1.00	0.75
	ΔT	33	31	27	24	33	31	27	23	33	31	28	24	33	31	27	23	33	31	27	23	34	32	28	24
	KW	1.41	1.41	1.40	1.42	1.57	1.57	1.57	1.58	1.76	1.76	1.75	1.76	1.96	1.95	1.95	1.96	2.18	2.18	2.17	2.19	2.44	2.44	2.43	2.45
	Amps	5.3	5.3	5.3	5.3	6.0	6.0	6.0	6.1	6.9	6.9	6.8	6.9	7.8	7.8	7.8	7.8	8.8	8.8	8.8	8.8	10.0	10.0	10.0	10.0
	HI PR	255	256	258	262	295	296	297	302	336	337	339	343	381	382	384	388	429	430	432	436	480	481	483	488
	LO PR	123	125	128	133	131	132	135	140	137	139	142	147	142	144	147	152	148	149	152	157	154	156	159	164
	MBh	25.5	25.9	26.6	27.7	25.3	25.6	26.4	27.5	24.7	25.0	25.7	26.8	23.6	23.9	24.7	25.8	22.3	22.6	23.3	24.4	21.0	21.4	22.1	23.2
	S/T	1.00	0.93	0.80	0.66	1.00	0.93	0.80	0.67	1.00	1.00	0.83	0.69	1.00	1.00	0.85	0.71	1.00	1.00	0.87	0.73	1.00	1.00	1.00	0.78
	ΔT	32	30	26	22	32	30	26	22	32	30	26	23	32	30	26	22	32	30	26	22	33	31	27	23
KW	1.42	1.42	1.41	1.42	1.58	1.58	1.58	1.59	1.76	1.76	1.76	1.77	1.96	1.96	1.96	1.97	2.19	2.18	2.18	2.19	2.45	2.44	2.44	2.45	
Amps	5.3	5.3	5.3	5.3	6.1	6.1	6.0	6.1	6.9	6.9	6.9	6.9	7.8	7.8	7.8	7.9	8.8	8.8	8.8	8.9	10.0	10.0	10.0	10.1	
HI PR	257	258	260	265	297	298	300	304	338	339	341	346	383	384	386	390	431	432	434	438	483	484	485	490	
LO PR	126	127	130	135	133	134	137	143	139	141	144	149	145	146	149	154	150	151	154	160	157	158	161	166	
MBh	26.1	26.4	27.1	28.2	25.9	26.2	26.9	28.0	25.2	25.6	26.3	27.4	24.1	24.5	25.2	26.3	22.8	23.1	23.9	25.0	21.6	21.9	22.7	23.8	
S/T	1.00	0.93	0.81	0.67	1.00	1.00	0.81	0.68	1.00	1.00	0.84	0.70	1.00	1.00	0.85	0.72	1.00	1.00	0.87	0.74	1.00	1.00	1.00	0.79	
ΔT	31	29	25	21	31	29	25	21	31	29	25	22	31	29	25	21	31	29	25	21	32	30	26	22	
KW	1.42	1.42	1.42	1.43	1.59	1.59	1.58	1.60	1.77	1.77	1.77	1.78	1.97	1.97	1.97	1.98	2.19	2.19	2.19	2.20	2.45	2.45	2.45	2.46	
Amps	5.3	5.3	5.3	5.4	6.1	6.1	6.1	6.1	6.9	6.9	6.9	7.0	7.8	7.8	7.8	7.9	8.9	8.9	8.8	8.9	10.1	10.0	10.0	10.1	
HI PR	260	261	263	267	299	300	302	307	341	342	344	348	386	387	388	393	434	435	437	441	485	486	488	492	
LO PR	128	130	133	138	136	137	140	145	142	143	146	151	147	149	152	157	153	154	157	162	159	161	164	169	

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects AHRI conditions  
 kW = Total system power  
 Amps = outdoor unit amps (comp.+fan)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE													
		65				75				85				95				105				115					
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71		
<b>70</b>	875	MBh	29.3	29.7	30.6	30.6	29.0	29.5	30.3	30.3	28.3	28.7	29.6	29.6	27.0	27.4	28.2	28.2	25.3	25.8	26.6	26.6	23.9	24.3	25.2	25.2	
		S/T	0.59	0.52	0.38	-	0.60	0.52	0.39	-	0.62	0.55	0.42	-	1.00	0.57	0.43	-	1.00	0.59	0.46	-	1.00	0.64	0.51	-	
		ΔT	20	18	15	-	20	18	15	-	20	18	15	-	20	18	15	-	20	18	14	-	21	19	15	-	
	1000	KW	1.76	1.75	1.75	-	1.95	1.95	1.95	-	2.17	2.17	2.17	-	2.41	2.41	2.41	-	2.68	2.68	2.67	-	2.99	2.99	2.99	-	
		Amps	6.4	6.4	6.4	-	7.3	7.3	7.3	-	8.3	8.3	8.3	-	9.4	9.4	9.4	-	10.6	10.6	10.6	-	12.0	12.0	12.0	-	
		HI PR	250	251	252	-	289	290	292	-	330	331	333	-	375	376	377	-	422	424	425	-	474	475	476	-	
	1125	LO PR	124	125	128	-	131	133	136	-	138	139	142	-	143	145	148	-	149	150	154	-	156	157	160	-	
		MBh	29.7	30.1	31.0	31.0	29.4	29.8	30.7	30.7	28.7	29.1	29.9	29.9	27.3	27.8	28.6	28.6	25.7	26.1	27.0	27.0	24.3	24.7	25.6	25.6	
		S/T	0.65	0.58	0.44	-	0.66	0.58	0.45	-	0.68	0.61	0.47	-	1.00	0.63	0.49	-	1.00	0.65	0.51	-	1.00	0.70	0.56	-	
	<b>75</b>	875	ΔT	19	17	13	-	19	17	13	-	19	17	14	-	19	17	13	-	18	17	13	-	20	18	14	-
			KW	1.78	1.77	1.77	-	1.96	1.96	1.96	-	2.18	2.18	2.18	-	2.42	2.42	2.42	-	2.69	2.69	2.68	-	3.00	3.00	3.00	-
			Amps	6.4	6.4	6.4	-	7.3	7.3	7.3	-	8.3	8.3	8.3	-	9.4	9.4	9.4	-	10.6	10.6	10.6	-	12.1	12.1	12.1	-
1000		HI PR	252	253	254	-	291	292	294	-	332	333	335	-	377	378	379	-	425	426	427	-	476	477	478	-	
		LO PR	125	127	130	-	133	135	138	-	140	141	144	-	145	147	150	-	151	152	155	-	157	159	162	-	
		MBh	30.1	30.6	31.4	31.4	29.9	30.3	31.2	31.2	29.1	29.5	30.4	30.4	27.8	28.2	29.1	29.1	26.2	26.6	27.5	27.5	24.7	25.1	26.0	26.0	
1125		S/T	0.68	0.61	0.48	-	0.69	0.61	0.48	-	0.71	0.64	0.51	-	1.00	0.66	0.53	-	1.00	0.68	0.55	-	1.00	0.73	0.60	-	
		ΔT	18	16	13	-	18	16	12	-	18	16	13	-	18	16	12	-	17	16	12	-	19	17	13	-	
		KW	1.78	1.77	1.77	-	1.97	1.97	1.97	-	2.19	2.19	2.19	-	2.43	2.43	2.43	-	2.70	2.70	2.69	-	3.01	3.01	3.01	-	
<b>85</b>		875	Amps	6.5	6.5	6.4	-	7.4	7.4	7.3	-	8.4	8.4	8.3	-	9.5	9.5	9.4	-	10.7	10.7	10.7	-	12.1	12.1	12.1	-
			HI PR	254	255	257	-	293	294	296	-	334	335	337	-	379	380	382	-	427	428	429	-	478	479	481	-
			LO PR	128	129	132	-	135	137	140	-	142	143	146	-	147	149	152	-	153	154	157	-	160	161	164	-
	1000	MBh	29.7	30.1	31.0	31.7	29.1	29.5	30.3	31.7	28.3	28.7	29.6	30.9	27.0	27.4	28.3	29.6	25.4	25.8	26.7	28.0	23.9	24.3	25.2	26.5	
		S/T	0.72	0.64	0.51	0.37	0.72	0.65	0.52	0.38	1.00	0.67	0.54	0.40	1.00	0.69	0.56	0.42	1.00	0.71	0.58	0.44	1.00	1.00	0.63	0.49	
		ΔT	24	22	19	15	24	22	19	15	24	22	19	15	24	22	19	15	24	22	18	15	25	23	19	16	
	1125	KW	1.76	1.75	1.75	1.77	1.95	1.95	1.95	1.96	2.17	2.17	2.17	2.18	2.41	2.41	2.41	2.42	2.68	2.68	2.67	2.69	2.99	2.99	2.99	3.00	
		Amps	6.4	6.4	6.3	6.4	7.3	7.3	7.2	7.3	8.3	8.3	8.3	8.3	9.4	9.4	9.3	9.4	10.6	10.6	10.6	10.6	12.0	12.0	12.0	12.1	
		HI PR	250	251	253	257	289	290	292	296	330	331	333	338	375	376	378	382	423	424	425	430	474	475	477	481	
	<b>95</b>	875	LO PR	124	125	128	134	131	133	136	141	138	139	142	148	143	145	148	153	149	150	154	159	156	157	160	166
			MBh	29.7	30.1	31.0	32.3	29.4	29.9	30.7	32.1	28.7	29.1	30.0	31.3	27.4	27.8	28.6	30.0	25.8	26.2	27.0	28.4	24.3	24.7	25.6	26.9
			S/T	0.78	0.70	0.57	0.43	0.78	0.71	0.58	0.44	1.00	0.73	0.60	0.46	1.00	0.75	0.62	0.48	1.00	0.77	0.64	0.50	1.00	1.00	0.69	0.55
1000		ΔT	23	21	17	14	23	21	17	14	23	21	18	14	23	21	17	14	22	21	17	14	24	22	18	15	
		KW	1.77	1.76	1.76	1.78	1.96	1.96	1.96	1.97	2.18	2.18	2.18	2.19	2.42	2.42	2.42	2.43	2.69	2.69	2.68	2.70	3.00	3.00	3.00	3.01	
		Amps	6.4	6.4	6.4	6.5	7.3	7.3	7.3	7.4	8.3	8.3	8.3	8.4	9.4	9.4	9.4	9.5	10.6	10.6	10.6	10.7	12.1	12.1	12.0	12.1	
1125		HI PR	252	253	255	259	291	292	294	298	332	334	335	340	377	378	380	384	425	426	428	432	476	477	479	483	
		LO PR	126	127	130	135	133	135	138	143	140	141	144	150	145	147	150	155	151	152	155	161	158	159	162	167	
		MBh	30.2	30.6	31.5	32.8	29.9	30.3	31.2	32.5	29.1	29.6	30.4	31.8	27.8	28.2	29.1	30.4	26.2	26.6	27.5	28.8	24.7	25.2	26.0	27.4	
<b>105</b>		875	S/T	0.81	0.73	0.60	0.46	1.00	0.74	0.61	0.47	1.00	0.77	0.63	0.49	1.00	0.78	0.65	0.51	1.00	0.81	0.67	0.53	1.00	1.00	0.72	0.58
			ΔT	22	20	17	13	22	20	17	13	22	20	17	13	22	20	16	13	21	20	16	13	23	21	17	14
			KW	1.77	1.77	1.77	1.78	1.97	1.97	1.97	1.98	2.19	2.19	2.19	2.20	2.43	2.43	2.43	2.44	2.70	2.70	2.69	2.71	3.01	3.01	3.00	3.02
	1125	Amps	6.5	6.4	6.4	6.5	7.4	7.4	7.3	7.4	8.4	8.4	8.3	8.4	9.5	9.5	9.4	9.5	10.7	10.7	10.7	10.7	12.1	12.1	12.1	12.2	
		HI PR	254	255	257	261	293	294	296	300	335	336	337	342	379	380	382	386	427	428	430	434	478	479	481	485	
		LO PR	128	129	132	137	135	137	140	145	142	143	146	152	147	149	152	157	153	154	157	163	160	161	164	169	

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects ACCA (TVA) conditions  
 kW = Total system power  
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — ASX140301K\* + CA\*F3642\*6\*\* + EEP (CONT.)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
<b>80</b>	MBh	29.5	29.9	30.8	32.1	29.2	29.6	30.5	31.8	28.4	28.9	29.7	31.1	27.1	27.5	28.4	29.8	25.5	25.9	26.8	28.1	24.0	24.5	25.3	26.7
	S/T	1.00	0.77	0.63	0.5	1.00	0.77	0.64	0.50	1.00	0.80	0.66	0.5	1.00	1.00	0.68	0.54	1.00	1.00	0.70	0.6	1.00	1.00	0.75	0.61
	ΔT	28	26	23	19	28	26	23	19	28	26	23	19	28	26	23	19	28	26	22	19	29	27	23	20
	KW	1.76	1.75	1.75	1.8	1.95	1.95	1.95	1.96	2.17	2.17	2.17	2.2	2.41	2.41	2.41	2.42	2.68	2.68	2.67	2.7	2.99	2.99	2.99	3.00
	Amps	6.4	6.4	6.3	6.4	7.3	7.3	7.3	7.3	8.3	8.3	8.3	8.3	9.4	9.4	9.4	9.4	10.6	10.6	10.6	10.6	12.0	12.0	12.0	12.1
	HI PR	250	251	253	257	290	291	292	297	331	332	334	338	375	376	378	382	423	424	426	430	474	475	477	481
	LO PR	124	126	129	134	132	133	136	142	138	140	143	148	144	145	149	154	149	151	154	159	156	158	161	166
	MBh	29.9	30.3	31.1	32.5	29.6	30.0	30.9	32.2	28.8	29.2	30.1	31.5	27.5	27.9	28.8	30.1	25.9	26.3	27.2	28.5	24.4	24.8	25.7	27.1
	S/T	1.00	0.82	0.69	0.6	1.00	0.83	0.70	0.56	1.00	0.85	0.72	0.6	1.00	1.00	0.74	0.60	1.00	1.00	0.76	0.6	1.00	1.00	0.81	0.67
	ΔT	27	25	22	18	27	25	21	18	27	25	22	18	27	25	21	18	26	25	21	18	28	26	22	19
KW	1.77	1.76	1.76	1.8	1.96	1.96	1.96	1.97	2.18	2.18	2.18	2.2	2.42	2.42	2.42	2.43	2.69	2.69	2.68	2.7	3.00	3.00	3.00	3.01	
Amps	6.4	6.4	6.4	6.5	7.3	7.3	7.3	7.4	8.3	8.3	8.3	8.4	9.4	9.4	9.4	9.5	10.6	10.6	10.6	10.7	12.1	12.1	12.0	12.1	
HI PR	252	253	255	259	292	293	295	299	333	334	336	340	377	378	380	385	425	426	428	432	476	477	479	484	
LO PR	126	128	131	136	134	135	138	144	140	142	145	150	146	147	150	156	151	153	156	161	158	160	163	168	
MBh	30.3	30.7	31.6	32.9	30.1	30.5	31.3	32.7	29.3	29.7	30.6	31.9	28.0	28.4	29.3	30.6	26.4	26.8	27.7	29.0	24.9	25.3	26.2	27.5	
S/T	1.00	0.86	0.72	0.6	1.00	0.86	0.73	0.59	1.00	0.89	0.76	0.6	1.00	1.00	0.77	0.63	1.00	1.00	0.80	0.7	1.00	1.00	0.85	0.71	
ΔT	26	24	21	17	26	24	21	17	26	24	21	17	26	24	21	17	26	24	20	17	27	25	21	18	
KW	1.78	1.77	1.77	1.8	1.97	1.97	1.97	1.98	2.19	2.19	2.19	2.2	2.43	2.43	2.43	2.44	2.70	2.70	2.69	2.7	3.01	3.01	3.01	3.02	
Amps	6.5	6.5	6.4	6.5	7.4	7.4	7.3	7.4	8.4	8.4	8.3	8.4	9.5	9.5	9.4	9.5	10.7	10.7	10.7	10.7	12.1	12.1	12.1	12.2	
HI PR	254	255	257	262	294	295	297	301	335	336	338	342	379	380	382	387	427	428	430	434	478	479	481	486	
LO PR	128	130	133	138	136	137	140	146	142	144	147	152	148	149	152	158	153	155	158	163	160	162	165	170	

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE											
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
<b>85</b>	MBh	30.0	30.4	31.3	32.6	29.7	30.1	31.0	32.3	28.9	29.3	30.2	31.6	27.6	28.0	28.9	30.2	26.0	26.4	27.3	28.6	24.5	25.0	25.8	27.2
	S/T	1.00	0.86	0.73	0.59	1.00	0.87	0.74	0.60	1.00	1.00	0.76	0.62	1.00	1.00	0.78	0.64	1.00	1.00	0.80	0.66	1.00	1.00	1.00	0.71
	ΔT	31	30	26	23	31	30	26	23	32	30	26	23	31	30	26	23	31	29	26	22	32	30	27	24
	KW	1.76	1.76	1.76	1.77	1.96	1.96	1.95	1.97	2.18	2.18	2.17	2.19	2.42	2.41	2.41	2.43	2.68	2.68	2.68	2.69	3.00	2.99	2.99	3.01
	Amps	6.4	6.4	6.4	6.4	7.3	7.3	7.3	7.3	8.3	8.3	8.3	8.3	9.4	9.4	9.4	9.4	10.6	10.6	10.6	10.7	12.0	12.0	12.0	12.1
	HI PR	251	252	254	259	291	292	294	298	332	333	335	339	376	377	379	384	424	425	427	431	475	476	478	483
	LO PR	126	128	131	136	134	135	138	144	140	142	145	150	146	147	150	156	151	153	156	161	158	160	163	168
	MBh	30.0	31.0	32.0	33.0	30.0	30.0	31.0	33.0	29.0	30.0	31.0	32.0	28.0	28.0	29.0	31.0	26.0	27.0	28.0	29.0	25.0	25.0	26.0	28.0
	S/T	1.00	0.92	0.79	0.65	1.00	1.00	0.80	0.66	1.00	1.00	0.82	0.68	1.00	1.00	0.84	0.70	1.00	1.00	0.86	0.72	1.00	1.00	1.00	0.77
	ΔT	30	29	25	22	30	29	25	22	31	29	25	22	30	28	25	22	30	28	25	21	31	29	26	22
KW	1.77	1.77	1.77	1.78	1.97	1.97	1.96	1.98	2.19	2.19	2.18	2.20	2.43	2.42	2.42	2.44	2.69	2.69	2.69	2.70	3.01	3.00	3.00	3.02	
Amps	6.4	6.4	6.4	6.5	7.3	7.3	7.3	7.4	8.3	8.3	8.3	8.4	9.4	9.4	9.4	9.5	10.7	10.7	10.6	10.7	12.1	12.1	12.1	12.1	
HI PR	253	255	256	261	293	294	296	300	334	335	337	341	379	380	381	386	426	427	429	434	477	479	480	485	
LO PR	128	129	133	138	135	137	140	145	142	144	147	152	148	149	152	158	153	155	158	163	160	161	165	170	
MBh	31.0	31.0	32.0	33.0	31.0	31.0	32.0	33.0	30.0	30.0	31.0	32.0	28.0	29.0	30.0	31.0	27.0	27.0	28.0	29.0	25.0	26.0	27.0	28.0	
S/T	1.00	0.96	0.82	0.68	1.00	1.00	0.83	0.69	1.00	1.00	0.85	0.71	1.00	1.00	0.87	0.73	1.00	1.00	1.00	0.76	1.00	1.00	1.00	0.81	
ΔT	29	28	24	21	29	28	24	21	30	28	24	21	29	28	24	21	29	27	24	20	30	28	25	22	
KW	1.78	1.78	1.77	1.79	1.98	1.97	1.97	1.99	2.20	2.20	2.19	2.21	2.44	2.43	2.43	2.45	2.70	2.70	2.70	2.71	3.01	3.01	3.01	3.02	
Amps	6.5	6.5	6.5	6.5	7.4	7.4	7.4	7.4	8.4	8.4	8.4	8.4	9.5	9.5	9.5	9.5	10.7	10.7	10.7	10.7	12.1	12.1	12.1	12.2	
HI PR	256	257	258	263	295	296	298	302	336	337	339	343	381	382	383	388	428	430	431	436	480	481	482	487	
LO PR	130	131	135	140	137	139	142	147	144	146	149	154	150	151	154	160	155	157	160	165	162	163	167	172	

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects AHRI conditions  
 kW = Total system power  
 Amps = outdoor unit amps (comp.+fan)

IDB		OUTDOOR AMBIENT TEMPERATURE																								
		65				75				85				95				105				115				
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
		ENTERING INDOOR WET BULB TEMPERATURE																								
		AIRFLOW																								
70	875	MBh	29.1	29.5	30.4	-	28.8	29.2	30.1	-	28.1	28.5	29.4	-	26.8	27.2	28.0	-	25.2	25.6	26.5	-	23.7	24.1	25.0	-
		S/T	0.63	0.55	0.41	-	0.63	0.56	0.42	-	0.66	0.58	0.44	-	0.68	0.60	0.46	-	1.00	0.62	0.48	-	1.00	0.68	0.54	-
		ΔT	20	18	15	-	20	18	15	-	20	19	15	-	20	18	15	-	20	18	15	-	21	19	16	-
		KW	1.72	1.72	1.72	-	1.91	1.91	1.91	-	2.13	2.12	2.12	-	2.36	2.35	2.35	-	2.61	2.61	2.61	-	2.92	2.92	2.91	-
		Amps	6.2	6.2	6.2	-	7.1	7.1	7.1	-	8.1	8.0	8.0	-	9.1	9.1	9.1	-	10.3	10.3	10.3	-	11.7	11.7	11.7	-
	1000	HI PR	244	245	247	-	282	283	285	-	323	324	325	-	366	367	369	-	413	414	416	-	463	464	466	-
		LO PR	123	124	127	-	130	132	135	-	137	138	141	-	142	144	147	-	148	149	152	-	154	156	159	-
		MBh	29.5	29.9	30.8	-	29.2	29.6	30.5	-	28.5	28.9	29.7	-	27.2	27.6	28.4	-	25.6	26.0	26.8	-	24.1	24.5	25.4	-
		S/T	0.69	0.61	0.47	-	0.70	0.62	0.48	-	0.72	0.64	0.50	-	1.00	0.66	0.52	-	1.00	0.69	0.55	-	1.00	0.74	0.60	-
		ΔT	19	17	14	-	19	17	14	-	19	17	14	-	19	17	14	-	19	17	13	-	20	18	15	-
1125	KW	1.73	1.73	1.73	-	1.92	1.92	1.92	-	2.14	2.13	2.13	-	2.37	2.36	2.36	-	2.62	2.62	2.62	-	2.93	2.93	2.92	-	
	Amps	6.2	6.2	6.2	-	7.1	7.1	7.1	-	8.1	8.1	8.1	-	9.2	9.2	9.1	-	10.3	10.3	10.3	-	11.7	11.7	11.7	-	
	HI PR	246	247	249	-	284	286	287	-	325	326	328	-	368	369	371	-	415	416	418	-	465	466	468	-	
	LO PR	124	126	129	-	132	133	136	-	138	140	143	-	144	145	149	-	149	151	154	-	156	158	161	-	
	MBh	29.9	30.3	31.2	-	29.7	30.1	31.0	-	28.9	29.3	30.2	-	27.6	28.0	28.9	-	26.0	26.4	27.3	-	24.6	25.0	25.8	-	
75	875	S/T	0.73	0.65	0.51	-	0.73	0.65	0.51	-	0.76	0.68	0.54	-	1.00	0.70	0.56	-	1.00	0.72	0.58	-	1.00	0.78	0.63	-
		ΔT	18	16	13	-	18	16	13	-	18	16	13	-	18	16	13	-	18	16	12	-	19	17	14	-
		KW	1.74	1.74	1.73	-	1.93	1.93	1.92	-	2.14	2.14	2.14	-	2.37	2.37	2.37	-	2.63	2.63	2.63	-	2.94	2.93	2.93	-
		Amps	6.3	6.3	6.3	-	7.2	7.2	7.1	-	8.1	8.1	8.1	-	9.2	9.2	9.2	-	10.4	10.4	10.4	-	11.8	11.8	11.7	-
		HI PR	248	249	251	-	286	288	289	-	327	328	330	-	370	371	373	-	417	418	420	-	467	468	470	-
	1000	LO PR	126	128	131	-	134	135	138	-	140	142	145	-	146	147	151	-	151	153	156	-	158	160	163	-
		MBh	29.1	29.5	30.4	31.7	28.9	29.3	30.1	31.5	28.1	28.5	29.4	30.7	26.8	27.2	28.1	29.4	25.2	25.6	26.5	27.8	23.7	24.1	25.0	26.3
		S/T	0.76	0.68	0.54	0.39	0.77	0.69	0.55	0.40	1.00	0.72	0.57	0.43	1.00	0.74	0.60	0.45	1.00	0.76	0.62	0.47	1.00	1.00	0.67	0.52
		ΔT	24	22	19	15	24	22	19	15	25	23	19	16	24	22	19	15	24	22	19	15	25	23	20	16
		KW	1.72	1.72	1.71	1.73	1.91	1.91	1.91	1.92	2.12	2.12	2.12	2.13	2.36	2.35	2.35	2.36	2.61	2.61	2.61	2.62	2.92	2.92	2.91	2.93
1125	Amps	6.2	6.2	6.2	6.2	7.1	7.1	7.1	7.1	8.0	8.0	8.0	8.1	9.1	9.1	9.1	9.2	10.3	10.3	10.3	10.3	11.7	11.7	11.7	11.7	
	HI PR	244	245	247	251	283	284	285	290	323	324	326	330	366	367	369	373	413	414	416	420	463	464	466	470	
	LO PR	123	124	127	132	130	132	135	140	137	138	141	146	142	144	147	152	148	149	152	157	154	156	159	164	
	MBh	29.5	29.9	30.8	32.1	29.2	29.6	30.5	31.8	28.5	28.9	29.8	31.1	27.2	27.6	28.4	29.8	25.6	26.0	26.9	28.2	24.1	24.5	25.4	26.7	
	S/T	0.82	0.75	0.60	0.46	0.83	0.75	0.61	0.46	1.00	0.78	0.64	0.49	1.00	0.80	0.66	0.51	1.00	0.82	0.68	0.53	1.00	1.00	0.73	0.59	
75	1000	ΔT	23	21	18	14	23	21	18	14	23	22	18	14	23	21	18	14	23	21	18	14	24	22	19	15
		KW	1.73	1.73	1.72	1.74	1.92	1.92	1.92	1.93	2.13	2.13	2.13	2.14	2.37	2.36	2.36	2.37	2.62	2.62	2.62	2.63	2.93	2.92	2.92	2.94
		Amps	6.2	6.2	6.2	6.3	7.1	7.1	7.1	7.2	8.1	8.1	8.1	8.1	9.2	9.1	9.1	9.2	10.3	10.3	10.3	10.4	11.7	11.7	11.7	11.8
		HI PR	246	247	249	253	285	286	287	292	325	326	328	332	368	369	371	375	415	416	418	422	465	466	468	472
		LO PR	124	126	129	134	132	133	137	142	138	140	143	148	144	145	149	154	149	151	154	159	156	158	161	166
	1125	MBh	30.0	30.4	31.2	32.6	29.7	30.1	31.0	32.3	28.9	29.3	30.2	31.5	27.6	28.0	28.9	30.2	26.0	26.4	27.3	28.6	24.6	25.0	25.9	27.2
		S/T	0.86	0.78	0.64	0.49	1.00	0.79	0.65	0.50	1.00	0.81	0.67	0.52	1.00	0.83	0.69	0.54	1.00	0.86	0.72	0.57	1.00	1.00	0.77	0.62
		ΔT	22	20	17	13	22	20	17	13	22	21	17	13	22	20	17	13	22	20	17	13	23	21	18	14
		KW	1.74	1.74	1.73	1.75	1.93	1.93	1.92	1.94	2.14	2.14	2.14	2.15	2.37	2.37	2.37	2.38	2.63	2.63	2.63	2.64	2.93	2.93	2.93	2.94
		Amps	6.3	6.3	6.3	6.3	7.2	7.1	7.1	7.2	8.1	8.1	8.1	8.2	9.2	9.2	9.2	9.2	10.4	10.4	10.4	10.4	11.8	11.8	11.7	11.8
HI PR	248	249	251	255	287	288	289	294	327	328	330	334	370	371	373	377	417	418	420	424	467	468	470	474		
LO PR	126	128	131	136	134	135	139	144	140	142	145	150	146	147	151	156	151	153	156	161	158	160	163	168		

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects ACCA (TVA) conditions  
 kW = Total system power  
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — ASX140311K\* + CA\*F3137\*6\*\* + EEP (CONT.)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																								
		65				75				85				95				105				115				
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
<b>80</b>	<b>875</b>	MBh	29.3	29.7	30.5	31.9	29.0	29.4	30.3	31.6	28.2	28.7	29.5	30.9	26.9	27.3	28.2	29.5	25.3	25.8	26.6	27.9	23.9	24.3	25.2	26.5
		S/T	1.00	0.81	0.67	0.5	1.00	0.82	0.68	0.53	1.00	0.85	0.70	0.6	1.00	0.87	0.73	0.58	1.00	1.00	0.75	0.6	1.00	1.00	0.80	0.65
		ΔT	28	27	23	19	28	27	23	19	29	27	23	20	28	27	23	19	28	26	23	19	29	27	24	20
		KW	1.72	1.72	1.72	1.7	1.91	1.91	1.91	1.92	2.12	2.12	2.12	2.1	2.36	2.35	2.35	2.37	2.61	2.61	2.61	2.6	2.92	2.92	2.91	2.93
		Amps	6.2	6.2	6.2	6.2	7.1	7.1	7.1	7.1	8.1	8.0	8.0	8.1	9.1	9.1	9.1	9.2	10.3	10.3	10.3	10.3	11.7	11.7	11.7	11.7
	<b>1000</b>	HI PR	245	246	247	252	283	284	286	290	323	324	326	330	367	368	370	374	414	415	416	421	464	465	466	471
		LO PR	123	125	128	133	131	132	135	140	137	139	142	147	143	144	147	153	148	150	153	158	155	156	160	165
		MBh	29.6	30.1	30.9	32.3	29.4	29.8	30.7	32.0	28.6	29.0	29.9	31.2	27.3	27.7	28.6	29.9	25.7	26.1	27.0	28.3	24.3	24.7	25.5	26.9
		S/T	1.00	0.88	0.73	0.6	1.00	0.88	0.74	0.59	1.00	0.91	0.77	0.6	1.00	1.00	0.79	0.64	1.00	1.00	0.81	0.7	1.00	1.00	0.86	0.72
		ΔT	27	25	22	18	27	25	22	18	28	26	22	19	27	25	22	18	27	25	22	18	28	26	23	19
<b>1125</b>	KW	1.73	1.73	1.72	1.7	1.92	1.92	1.92	1.93	2.13	2.13	2.13	2.1	2.37	2.36	2.36	2.38	2.62	2.62	2.62	2.6	2.93	2.93	2.92	2.94	
	Amps	6.2	6.2	6.2	6.3	7.1	7.1	7.1	7.2	8.1	8.1	8.1	8.1	9.2	9.2	9.2	9.2	10.3	10.3	10.3	10.4	11.7	11.7	11.7	11.8	
	HI PR	247	248	249	254	285	286	288	292	325	326	328	332	369	370	372	376	416	417	418	423	466	467	468	473	
	LO PR	125	126	130	135	132	134	137	142	139	140	144	149	144	146	149	154	150	151	155	160	157	158	161	167	
	MBh	30.1	30.5	31.4	32.7	29.8	30.3	31.1	32.5	29.1	29.5	30.4	31.7	27.8	28.2	29.1	30.4	26.2	26.6	27.5	28.8	24.7	25.1	26.0	27.3	

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																								
		65				75				85				95				105				115				
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
<b>85</b>	<b>875</b>	MBh	29.8	30.2	31.0	32.4	29.5	29.9	30.8	32.1	28.7	29.1	30.0	31.3	27.4	27.8	28.7	30.0	25.8	26.2	27.1	28.4	24.4	24.8	25.7	27.0
		S/T	1.00	0.92	0.78	0.63	1.00	0.92	0.78	0.64	1.00	1.00	0.81	0.66	1.00	1.00	0.83	0.68	1.00	1.00	0.85	0.70	1.00	1.00	1.00	0.76
		ΔT	32	30	27	23	32	30	27	23	32	30	27	23	32	30	27	23	32	30	26	23	33	31	28	24
		KW	1.72	1.72	1.72	1.73	1.91	1.91	1.91	1.92	2.13	2.13	2.12	2.14	2.36	2.36	2.36	2.37	2.62	2.62	2.61	2.63	2.92	2.92	2.92	2.93
		Amps	6.2	6.2	6.2	6.3	7.1	7.1	7.1	7.1	8.1	8.1	8.0	8.1	9.1	9.1	9.1	9.2	10.3	10.3	10.3	10.4	11.7	11.7	11.7	11.7
	<b>1000</b>	HI PR	246	247	248	253	284	285	287	291	325	326	327	332	368	369	371	375	415	416	417	422	465	466	467	472
		LO PR	125	127	130	135	132	134	137	142	139	141	144	149	145	146	149	154	150	151	155	160	157	158	161	167
		MBh	30.1	30.5	31.4	32.7	29.9	30.3	31.2	32.5	29.1	29.5	30.4	31.7	27.8	28.2	29.1	30.4	26.2	26.6	27.5	28.8	24.8	25.2	26.0	27.4
		S/T	1.00	0.98	0.84	0.69	1.00	1.00	0.85	0.70	1.00	1.00	0.87	0.72	1.00	1.00	0.89	0.74	1.00	1.00	0.92	0.77	1.00	1.00	1.00	0.82
		ΔT	31	29	26	22	31	29	26	22	31	29	26	22	31	29	26	22	31	29	25	22	32	30	26	23
<b>1125</b>	KW	1.73	1.73	1.73	1.74	1.92	1.92	1.92	1.93	2.14	2.14	2.13	2.15	2.37	2.37	2.36	2.38	2.63	2.63	2.62	2.64	2.93	2.93	2.93	2.94	
	Amps	6.3	6.3	6.2	6.3	7.1	7.1	7.1	7.2	8.1	8.1	8.1	8.2	9.2	9.2	9.2	9.2	10.4	10.4	10.3	10.4	11.7	11.7	11.7	11.8	
	HI PR	248	249	251	255	286	287	289	293	327	328	329	334	370	371	373	377	417	418	420	424	467	468	470	474	
	LO PR	127	128	131	137	134	136	139	144	141	142	145	151	146	148	151	156	152	153	156	162	159	160	163	168	
	MBh	30.6	31.0	31.9	33.2	30.3	30.7	31.6	32.9	29.6	30.0	30.9	32.2	28.3	28.7	29.5	30.9	26.7	27.1	28.0	29.3	25.2	25.6	26.5	27.8	

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects AHRI conditions  
 kW = Total system power  
 Amps = outdoor unit amps (comp.+fan)



IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE												ENTERING INDOOR WET BULB TEMPERATURE												
		65				75				85				95				105				115				
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
70	1050	MBh	34.8	35.3	36.3	-	34.5	35.0	36.0	-	33.6	34.1	35.1	-	32.0	32.5	33.5	-	30.1	30.6	31.6	-	28.4	28.8	29.9	-
		S/T	0.59	0.52	0.38	-	0.60	0.52	0.39	-	0.62	0.55	0.42	-	0.64	0.57	0.43	-	1.00	0.59	0.46	-	1.00	0.64	0.51	-
		ΔT	19	17	14	-	19	17	14	-	19	18	14	-	19	17	14	-	19	17	14	-	20	18	15	-
	1200	KW	2.09	2.09	2.09	-	2.32	2.32	2.32	-	2.58	2.58	2.58	-	2.87	2.86	2.86	-	3.18	3.18	3.17	-	3.55	3.55	3.54	-
		Amps	7.6	7.6	7.5	-	8.6	8.6	8.6	-	9.8	9.8	9.8	-	11.1	11.1	11.1	-	12.5	12.5	12.5	-	14.2	14.2	14.2	-
		HI PR	254	255	257	-	294	295	297	-	336	337	339	-	381	382	384	-	430	431	433	-	482	483	485	-
	1350	LO PR	121	123	126	-	129	130	133	-	135	137	140	-	141	142	145	-	146	147	151	-	153	154	157	-
		MBh	35.3	35.7	36.8	-	34.9	35.4	36.5	-	34.0	34.5	35.6	-	32.5	33.0	34.0	-	30.6	31.0	32.1	-	28.8	29.3	30.3	-
		S/T	0.65	0.58	0.44	-	0.66	0.58	0.45	-	0.68	0.61	0.47	-	0.70	0.63	0.49	-	1.00	0.65	0.51	-	1.00	0.70	0.56	-
75	1050	ΔT	18	16	13	-	18	16	13	-	18	17	13	-	18	16	13	-	18	16	13	-	19	17	14	-
		KW	2.10	2.10	2.10	-	2.34	2.33	2.33	-	2.60	2.59	2.59	-	2.88	2.88	2.87	-	3.19	3.19	3.19	-	3.56	3.56	3.55	-
		Amps	7.6	7.6	7.6	-	8.7	8.7	8.7	-	9.9	9.9	9.9	-	11.2	11.2	11.1	-	12.6	12.6	12.6	-	14.3	14.3	14.3	-
	1200	HI PR	256	257	259	-	296	297	299	-	338	339	341	-	384	385	386	-	432	433	435	-	484	485	487	-
		LO PR	123	125	128	-	130	132	135	-	137	138	141	-	142	144	147	-	148	149	152	-	154	156	159	-
		MBh	35.8	36.3	37.3	-	35.5	36.0	37.0	-	34.6	35.1	36.1	-	33.0	33.5	34.5	-	31.1	31.6	32.6	-	29.4	29.9	30.9	-
	1350	S/T	0.68	0.61	0.48	-	0.69	0.61	0.48	-	0.71	0.64	0.51	-	1.00	0.66	0.53	-	1.00	0.68	0.55	-	1.00	0.73	0.60	-
		ΔT	17	15	12	-	17	15	12	-	17	16	12	-	17	15	12	-	17	15	12	-	18	16	13	-
		KW	2.11	2.11	2.11	-	2.35	2.34	2.34	-	2.61	2.60	2.60	-	2.89	2.89	2.88	-	3.20	3.20	3.20	-	3.57	3.57	3.56	-
75	1050	Amps	7.7	7.7	7.6	-	8.7	8.7	8.7	-	9.9	9.9	9.9	-	11.2	11.2	11.2	-	12.7	12.6	12.6	-	14.3	14.3	14.3	-
		HI PR	258	259	261	-	298	300	301	-	340	342	343	-	386	387	389	-	434	435	437	-	486	488	489	-
		LO PR	125	127	130	-	132	134	137	-	139	140	143	-	144	146	149	-	150	151	154	-	156	158	161	-
	1200	MBh	34.8	35.3	36.3	37.9	34.5	35.0	36.0	37.6	33.6	34.1	35.1	36.7	32.0	32.5	33.6	35.2	30.1	30.6	31.7	33.2	28.4	28.9	29.9	31.5
		S/T	0.72	0.64	0.51	0.37	0.72	0.65	0.52	0.38	1.00	0.67	0.54	0.40	1.00	0.69	0.56	0.42	1.00	0.71	0.58	0.44	1.00	0.76	0.63	0.49
		ΔT	23	21	18	15	23	21	18	15	23	22	18	15	23	21	18	15	23	21	18	14	24	22	19	15
	1350	KW	2.09	2.09	2.08	2.10	2.32	2.32	2.32	2.33	2.58	2.58	2.58	2.59	2.86	2.86	2.86	2.88	3.18	3.18	3.17	3.19	3.55	3.54	3.54	3.56
		Amps	7.6	7.6	7.5	8.0	8.6	8.6	8.6	8.7	9.8	9.8	9.8	10.0	11.1	11.1	11.1	11.2	12.5	12.5	12.5	13.0	14.2	14.2	14.2	14.3
		HI PR	254	255	257	262	294	295	297	302	336	337	339	344	382	383	384	389	430	431	433	438	482	484	485	490
75	1200	LO PR	121	123	126	131	129	130	133	138	135	137	140	145	141	142	145	150	146	147	151	156	152	154	157	162
		MBh	35.3	35.8	36.8	38.4	35.0	35.5	36.5	38.1	34.1	34.5	35.6	37.2	32.5	33.0	34.0	35.6	30.6	31.1	32.1	33.7	28.8	29.3	30.4	32.0
		S/T	0.78	0.70	0.57	0.43	0.78	0.71	0.58	0.44	1.00	0.73	0.60	0.46	1.00	0.75	0.62	0.48	1.00	0.77	0.64	0.50	1.00	1.00	0.69	0.55
	1350	ΔT	22	20	17	14	22	20	17	13	22	20	17	14	22	20	17	13	22	20	17	13	23	21	18	14
		KW	2.10	2.10	2.10	2.11	2.33	2.33	2.33	2.35	2.59	2.59	2.59	2.61	2.88	2.87	2.87	2.89	3.19	3.19	3.18	3.20	3.56	3.56	3.55	3.57
		Amps	7.6	7.6	7.6	8.0	8.7	8.7	8.7	9.0	9.9	9.9	9.8	10.0	11.2	11.1	11.1	11.0	12.6	12.6	12.6	13.0	14.3	14.3	14.3	14.0
	1350	HI PR	256	258	259	264	297	298	299	304	339	340	341	346	384	385	387	391	433	434	435	440	485	486	487	492
		LO PR	123	125	128	133	130	132	135	140	137	138	141	147	142	144	147	152	148	149	152	157	154	156	159	164
		MBh	35.8	36.3	37.4	38.9	35.5	36.0	37.0	38.6	34.6	35.1	36.1	37.7	33.0	33.5	34.6	36.2	31.1	31.6	32.7	34.2	29.4	29.9	30.9	32.5
1350	S/T	0.81	0.73	0.60	0.46	0.82	0.74	0.61	0.47	1.00	0.77	0.63	0.49	1.00	0.78	0.65	0.51	1.00	0.81	0.67	0.53	1.00	1.00	0.72	0.58	
	ΔT	21	19	16	13	21	19	16	13	21	20	16	13	21	19	16	13	21	19	16	12	22	20	17	13	
	KW	2.11	2.11	2.11	2.12	2.34	2.34	2.34	2.36	2.60	2.60	2.60	2.62	2.89	2.88	2.88	2.90	3.20	3.20	3.19	3.21	3.57	3.57	3.56	3.58	
1350	Amps	7.7	7.7	7.6	8.0	8.7	8.7	8.7	9.0	9.9	9.9	9.9	10.0	11.2	11.2	11.2	11.0	12.6	12.6	12.6	13.0	14.3	14.3	14.3	14.0	
	HI PR	259	260	261	266	299	300	302	306	341	342	344	348	386	387	389	393	435	436	438	442	487	488	490	494	
	LO PR	125	127	130	135	132	134	137	142	139	140	143	149	144	146	149	154	150	151	154	159	156	158	161	166	

Shaded area reflects ACCA (TVA) conditions

IDB: Entering Indoor Dry Bulb Temperature

High and low pressures are measured at the liquid and suction service valves.

kW = Total system power  
Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — ASX140361K\* + CA\*F3642\*D6 + EEP (CONT.)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																								
		65				75				85				95				105				115				
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
80	1050	MBh	35.0	35.5	36.5	38.1	34.7	35.2	36.2	37.8	33.8	34.3	35.3	36.9	32.2	32.7	33.7	35.3	30.3	30.8	31.8	33.4	28.6	29.0	30.1	31.7
		S/T	0.84	0.77	0.63	0.5	1.00	0.77	0.64	0.50	1.00	0.80	0.66	0.5	1.00	0.82	0.68	0.54	1.00	1.00	0.70	0.6	1.00	1.00	0.75	0.61
		ΔT	27	25	22	19	27	25	22	18	27	25	22	19	27	25	22	18	27	25	22	18	28	26	23	19
		KW	2.09	2.09	2.09	2.1	2.32	2.32	2.32	2.34	2.58	2.58	2.58	2.6	2.86	2.86	2.86	2.88	3.18	3.18	3.17	3.2	3.55	3.55	3.54	3.56
		Amps	7.6	7.6	7.5	8.0	8.6	8.6	8.6	9.0	9.8	9.8	9.8	10.0	11.1	11.1	11.1	11.0	12.5	12.5	12.5	13.0	14.2	14.2	14.2	14.0
	1200	HI PR	255	256	258	262	295	296	298	302	337	338	340	344	382	383	385	389	431	432	434	438	483	484	486	490
		LO PR	122	123	126	132	129	131	134	139	136	137	140	145	141	143	146	151	146	148	151	156	153	155	158	163
		MBh	35.5	35.9	37.0	38.6	35.1	35.6	36.7	38.3	34.2	34.7	35.8	37.4	32.7	33.2	34.2	35.8	30.8	31.2	32.3	33.9	29.0	29.5	30.5	32.1
		S/T	1.00	0.82	0.69	0.6	1.00	0.83	0.70	0.56	1.00	0.85	0.72	0.6	1.00	0.87	0.74	0.60	1.00	1.00	0.76	0.6	1.00	1.00	0.81	0.67
		ΔT	26	24	21	17	26	24	21	17	26	24	21	18	26	24	21	17	26	24	21	17	27	25	22	18
1350	KW	2.10	2.10	2.10	2.1	2.34	2.33	2.33	2.35	2.60	2.59	2.59	2.6	2.88	2.87	2.87	2.89	3.19	3.19	3.19	3.2	3.56	3.56	3.55	3.57	
	Amps	7.6	7.6	7.6	8.0	8.7	8.7	8.7	9.0	9.9	9.9	9.9	10.0	11.2	11.2	11.1	11.0	12.6	12.6	12.6	13.0	14.3	14.3	14.3	14.0	
	HI PR	257	258	260	264	297	298	300	304	339	340	342	346	384	385	387	392	433	434	436	440	485	486	488	492	
	LO PR	124	125	128	133	131	132	136	141	137	139	142	147	143	144	147	153	148	150	153	158	155	156	160	165	
	MBh	36.0	36.5	37.5	39.1	35.7	36.2	37.2	38.8	34.8	35.3	36.3	37.9	33.2	33.7	34.7	36.3	31.3	31.8	32.8	34.4	29.6	30.1	31.1	32.7	

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																								
		65				75				85				95				105				115				
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
85	1050	MBh	35.6	36.1	37.1	38.7	35.3	35.8	36.8	38.4	34.4	34.9	35.9	37.5	32.8	33.3	34.3	35.9	30.9	31.4	32.4	34.0	29.1	29.6	30.7	32.3
		S/T	1.00	0.86	0.73	0.59	1.00	0.87	0.74	0.60	1.00	1.00	0.76	0.62	1.00	1.00	0.78	0.64	1.00	1.00	0.80	0.66	1.00	1.00	1.00	0.71
		ΔT	31	29	25	22	30	29	25	22	31	29	26	22	30	29	25	22	30	28	25	22	31	30	26	23
		KW	2.10	2.09	2.09	2.11	2.33	2.33	2.32	2.34	2.59	2.59	2.58	2.60	2.87	2.87	2.86	2.88	3.18	3.18	3.18	3.20	3.55	3.55	3.55	3.56
		Amps	7.6	7.6	7.6	8.0	8.7	8.6	8.6	9.0	9.8	9.8	9.8	10.0	11.1	11.1	11.1	11.0	12.6	12.6	12.5	13.0	14.3	14.2	14.2	14.0
	1200	HI PR	256	257	259	263	296	297	299	303	338	339	341	345	383	384	386	391	432	433	435	439	484	485	487	491
		LO PR	124	125	128	133	131	133	136	141	137	139	142	147	143	144	148	153	148	150	153	158	155	157	160	165
		MBh	36.0	36.5	37.6	39.2	35.7	36.2	37.3	38.8	34.8	35.3	36.3	37.9	33.3	33.7	34.8	36.4	31.3	31.8	32.9	34.5	29.6	30.1	31.1	32.7
		S/T	1.00	0.92	0.79	0.65	1.00	0.93	0.80	0.66	1.00	1.00	0.82	0.68	1.00	1.00	0.84	0.70	1.00	1.00	0.86	0.72	1.00	1.00	1.00	0.77
		ΔT	29	28	24	21	29	28	24	21	30	28	25	21	29	28	24	21	29	27	24	21	30	28	25	22
1350	KW	2.11	2.11	2.10	2.12	2.34	2.34	2.33	2.35	2.60	2.60	2.59	2.61	2.88	2.88	2.88	2.89	3.20	3.19	3.19	3.21	3.56	3.56	3.56	3.58	
	Amps	7.6	7.6	7.6	8.0	8.7	8.7	8.7	9.0	9.9	9.9	9.9	10.0	11.2	11.2	11.2	11.0	12.6	12.6	12.6	13.0	14.3	14.3	14.3	14.0	
	HI PR	258	259	261	265	298	299	301	306	340	341	343	348	385	387	388	393	434	435	437	442	486	487	489	494	
	LO PR	125	127	130	135	133	134	137	143	139	141	144	149	145	146	149	154	150	152	155	160	157	158	161	167	
	MBh	36.6	37.1	38.1	39.7	36.3	36.8	37.8	39.4	35.4	35.9	36.9	38.5	33.8	34.3	35.3	36.9	31.9	32.4	33.4	35.0	30.1	30.6	31.7	33.3	

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects AHRI conditions  
 kW = Total system power  
 Amps = outdoor unit amps (comp.+fan)



EXPANDED COOLING DATA — ASX140371K\* + CA\*F3137\*6\*\* + EEP (CONT.)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																							
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
<b>80</b>	MBh	35.2	35.7	36.8	38.3	34.9	35.4	36.5	38.0	34.0	34.5	35.6	37.1	32.5	33.0	34.0	35.6	30.6	31.1	32.1	33.7	30.6	31.1	32.1	33.7
	S/T	0.92	0.84	0.71	0.6	1.00	0.85	0.71	0.57	1.00	0.87	0.74	0.6	1.00	0.89	0.76	0.61	1.00	1.00	0.78	0.6	1.00	1.00	0.78	0.6
	ΔT	28	26	23	19	28	26	22	19	28	26	23	19	28	26	22	19	28	26	22	18	29	27	23	20
	KW	2.03	2.03	2.02	2.0	2.26	2.26	2.26	2.28	2.53	2.53	2.52	2.5	2.81	2.81	2.81	2.83	3.13	3.13	3.13	3.1	3.51	3.50	3.50	3.52
	Amps	7.4	7.4	7.4	7.5	8.5	8.5	8.5	8.6	9.7	9.7	9.7	9.8	11.0	11.0	11.0	11.1	12.5	12.5	12.5	12.6	14.2	14.2	14.2	14.3
	HI PR	256	257	259	263	296	297	298	303	337	339	340	345	382	384	385	390	431	432	434	438	483	484	486	490
	LO PR	122	124	127	132	130	131	134	139	136	137	140	146	141	143	146	151	147	148	151	156	153	155	158	163
	MBh	35.6	36.1	37.2	38.7	35.3	35.8	36.8	38.4	34.4	34.9	35.9	37.5	32.9	33.4	34.4	36.0	31.0	31.5	32.5	34.1	29.2	29.7	30.8	32.3
	S/T	1.00	0.87	0.73	0.6	1.00	0.87	0.74	0.60	1.00	0.90	0.76	0.6	1.00	0.92	0.78	0.64	1.00	1.00	0.81	0.7	1.00	1.00	0.86	0.72
	ΔT	27	25	22	18	27	25	22	18	27	26	22	18	27	25	22	18	27	25	21	18	28	26	23	19
KW	2.04	2.03	2.03	2.1	2.27	2.27	2.27	2.28	2.54	2.53	2.53	2.6	2.82	2.82	2.81	2.83	3.14	3.14	3.13	3.2	3.51	3.51	3.51	3.53	
Amps	7.5	7.5	7.5	7.5	8.6	8.6	8.5	8.6	9.8	9.8	9.7	9.8	11.1	11.1	11.0	11.1	12.5	12.5	12.5	12.6	14.2	14.2	14.2	14.3	
HI PR	257	258	260	265	297	298	300	304	339	340	342	346	384	385	387	391	432	434	435	440	484	485	487	492	
LO PR	124	125	128	133	131	132	135	141	137	139	142	147	143	144	147	152	148	150	153	158	155	156	159	164	
MBh	36.3	36.8	37.8	39.4	36.0	36.5	37.5	39.1	35.1	35.6	36.6	38.2	33.6	34.0	35.1	36.7	31.7	32.1	33.2	34.8	29.9	30.4	31.4	33.0	
S/T	1.00	0.89	0.75	0.6	1.00	0.89	0.76	0.61	1.00	0.92	0.78	0.6	1.00	1.00	0.80	0.66	1.00	1.00	0.82	0.7	1.00	1.00	0.88	0.73	
ΔT	26	24	21	17	26	24	21	17	27	25	21	17	26	24	21	17	26	24	20	17	27	25	22	18	
KW	2.05	2.04	2.04	2.1	2.28	2.28	2.28	2.29	2.55	2.54	2.54	2.6	2.83	2.83	2.83	2.84	3.15	3.15	3.14	3.2	3.52	3.52	3.52	3.54	
Amps	7.5	7.5	7.5	7.6	8.6	8.6	8.6	8.7	9.8	9.8	9.8	9.9	11.1	11.1	11.1	11.2	12.6	12.6	12.6	12.6	14.3	14.3	14.3	14.3	
HI PR	260	261	262	267	299	301	302	307	341	342	344	349	386	387	389	394	435	436	438	442	487	488	489	494	
LO PR	126	127	131	136	133	135	138	143	140	141	144	149	145	147	150	155	150	152	155	160	157	159	162	167	

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																							
		65				75				85				95				105				115			
		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71
<b>85</b>	MBh	35.8	36.3	37.3	38.9	35.5	36.0	37.0	38.6	34.6	35.1	36.1	37.7	33.1	33.5	34.6	36.2	31.2	31.7	32.7	34.3	29.4	29.9	30.9	32.5
	S/T	1.00	0.94	0.81	0.67	1.00	0.95	0.81	0.67	1.00	1.00	0.84	0.70	1.00	1.00	0.86	0.72	1.00	1.00	0.88	0.74	1.00	1.00	1.00	0.79
	ΔT	32	30	26	23	32	30	26	23	32	30	26	23	32	30	26	22	31	30	26	22	33	31	27	23
	KW	2.03	2.03	2.03	2.04	2.27	2.27	2.26	2.28	2.53	2.53	2.53	2.54	2.82	2.82	2.81	2.83	3.14	3.13	3.13	3.15	3.51	3.51	3.50	3.52
	Amps	7.5	7.5	7.4	7.5	8.5	8.5	8.5	8.6	9.8	9.7	9.7	9.8	11.1	11.1	11.0	11.1	12.5	12.5	12.5	12.6	14.2	14.2	14.2	14.3
	HI PR	257	258	260	264	297	298	300	304	339	340	341	346	384	385	386	391	432	433	435	439	484	485	487	491
	LO PR	124	126	129	134	131	133	136	141	138	139	142	147	143	145	148	153	148	150	153	158	155	157	160	165
	MBh	36.2	36.7	37.7	39.3	35.9	36.4	37.4	39.0	35.0	35.5	36.5	38.1	33.4	33.9	35.0	36.5	31.5	32.0	33.1	34.6	29.8	30.3	31.3	32.9
	S/T	1.00	0.97	0.83	0.69	1.00	0.98	0.84	0.70	1.00	1.00	0.87	0.72	1.00	1.00	0.89	0.74	1.00	1.00	0.91	0.76	1.00	1.00	1.00	0.82
	ΔT	31	29	26	22	31	29	25	22	31	29	26	22	31	29	25	22	31	29	25	22	32	30	26	23
KW	2.04	2.04	2.03	2.05	2.28	2.27	2.27	2.29	2.54	2.54	2.53	2.55	2.83	2.82	2.82	2.84	3.14	3.14	3.14	3.16	3.52	3.52	3.51	3.53	
Amps	7.5	7.5	7.5	7.6	8.6	8.6	8.6	8.6	9.8	9.8	9.8	9.8	11.1	11.1	11.1	11.2	12.6	12.5	12.5	12.6	14.3	14.3	14.2	14.3	
HI PR	258	260	261	266	298	299	301	306	340	341	343	347	385	386	388	392	434	435	437	441	485	487	488	493	
LO PR	125	127	130	135	133	134	137	142	139	141	144	149	145	146	149	154	150	151	154	159	156	158	161	166	
MBh	36.9	37.4	38.4	40.0	36.6	37.1	38.1	39.7	35.7	36.2	37.2	38.8	34.1	34.6	35.7	37.2	32.2	32.7	33.8	35.3	30.5	31.0	32.0	33.6	
S/T	1.00	0.99	0.85	0.71	1.00	1.00	0.86	0.72	1.00	1.00	0.88	0.74	1.00	1.00	0.90	0.76	1.00	1.00	0.92	0.78	1.00	1.00	1.00	0.83	
ΔT	30	28	25	21	30	28	25	21	30	28	25	21	30	28	25	21	30	28	24	21	31	29	25	22	
KW	2.05	2.05	2.04	2.06	2.29	2.28	2.28	2.30	2.55	2.55	2.54	2.56	2.84	2.83	2.83	2.85	3.15	3.15	3.15	3.17	3.53	3.53	3.52	3.54	
Amps	7.5	7.5	7.5	7.6	8.6	8.6	8.6	8.7	9.8	9.8	9.8	9.9	11.1	11.1	11.1	11.2	12.6	12.6	12.6	12.7	14.3	14.3	14.3	14.4	
HI PR	261	262	264	268	301	302	304	308	342	344	345	350	387	389	390	395	436	437	439	443	488	489	491	495	
LO PR	128	129	132	137	135	137	140	145	141	143	146	151	147	148	151	157	152	154	157	162	159	160	163	168	

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects AHRI conditions  
 kW = Total system power  
 Amps = outdoor unit amps (comp.+fan)

		OUTDOOR AMBIENT TEMPERATURE																								
		65				75				85				95				105				115				
IDB	AIRFLOW	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
<b>70</b>	<b>1225</b>	MBh	39.7	40.2	41.4	-	39.3	39.9	41.1	-	38.3	38.8	40.0	-	36.5	37.1	38.2	-	34.3	34.9	36.1	-	32.3	32.9	34.1	-
		S/T	0.63	0.55	0.41	-	0.64	0.56	0.42	-	0.66	0.58	0.44	-	1.00	0.60	0.46	-	1.00	0.63	0.49	-	1.00	0.68	0.54	-
		ΔT	20	18	15	-	20	18	15	-	20	18	15	-	20	18	15	-	20	18	14	-	21	19	15	-
		KW	2.32	2.32	2.31	-	2.59	2.59	2.58	-	2.89	2.89	2.88	-	3.21	3.21	3.21	-	3.58	3.57	3.57	-	4.00	4.00	4.00	-
		Amps	8.3	8.3	8.3	-	9.5	9.5	9.5	-	10.9	10.9	10.9	-	12.4	12.4	12.3	-	14.0	14.0	14.0	-	16.0	16.0	16.0	-
	<b>1400</b>	HI PR	264	266	267	-	306	307	309	-	350	351	353	-	397	398	400	-	448	449	451	-	502	503	505	-
		LO PR	126	128	131	-	134	135	139	-	140	142	145	-	146	148	151	-	152	153	157	-	159	160	163	-
		MBh	40.2	40.8	41.9	-	39.8	40.4	41.6	-	38.8	39.4	40.6	-	37.0	37.6	38.8	-	34.8	35.4	36.6	-	32.9	33.4	34.6	-
		S/T	0.69	0.61	0.47	-	0.70	0.62	0.48	-	0.73	0.65	0.51	-	1.00	0.67	0.53	-	1.00	0.69	0.55	-	1.00	0.74	0.60	-
		ΔT	19	17	13	-	19	17	13	-	19	17	14	-	19	17	13	-	18	17	13	-	20	18	14	-
<b>1575</b>	KW	2.34	2.33	2.33	-	2.60	2.60	2.60	-	2.90	2.90	2.90	-	3.23	3.23	3.22	-	3.59	3.59	3.58	-	4.02	4.01	4.01	-	
	Amps	8.4	8.3	8.3	-	9.6	9.6	9.6	-	11.0	10.9	10.9	-	12.4	12.4	12.4	-	14.1	14.1	14.1	-	16.0	16.0	16.0	-	
	HI PR	267	268	270	-	308	309	311	-	352	353	355	-	399	400	402	-	450	451	453	-	504	505	507	-	
	LO PR	128	130	133	-	136	137	140	-	142	144	147	-	148	150	153	-	154	155	158	-	161	162	165	-	
	MBh	40.8	41.4	42.6	-	40.5	41.0	42.2	-	39.4	40.0	41.2	-	37.7	38.2	39.4	-	35.5	36.0	37.2	-	33.5	34.0	35.2	-	
<b>75</b>	<b>1225</b>	MBh	39.7	40.3	41.4	43.3	39.3	39.9	41.1	42.9	38.3	38.9	40.1	41.9	36.5	37.1	38.3	40.1	34.3	34.9	36.1	37.9	32.4	32.9	34.1	35.9
		S/T	0.77	0.69	0.55	0.40	1.00	0.69	0.55	0.40	1.00	0.72	0.58	0.43	1.00	0.74	0.60	0.45	1.00	0.76	0.62	0.47	1.00	1.00	0.67	0.53
		ΔT	24	22	19	15	24	22	19	15	24	22	19	15	24	22	19	15	24	22	18	15	25	23	19	16
		KW	2.32	2.32	2.31	2.33	2.59	2.59	2.58	2.60	2.89	2.89	2.88	2.90	3.21	3.21	3.21	3.23	3.58	3.57	3.57	3.59	4.00	4.00	3.99	4.01
		Amps	8.3	8.3	8.3	8.0	9.5	9.5	9.5	9.6	10.9	10.9	10.9	11.0	12.4	12.4	12.3	12.4	14.0	14.0	14.0	14.0	16.0	16.0	15.9	16.0
	<b>1400</b>	HI PR	265	266	268	272	306	307	309	314	350	351	353	358	397	398	400	405	448	449	451	455	502	503	505	510
		LO PR	126	128	131	136	134	135	139	144	141	142	145	151	146	148	151	156	152	153	157	162	159	160	164	169
		MBh	40.2	40.8	42.0	43.8	39.9	40.4	41.6	43.4	38.8	39.4	40.6	42.4	37.0	37.6	38.8	40.6	34.9	35.4	36.6	38.4	32.9	33.4	34.6	36.4
		S/T	0.83	0.75	0.61	0.46	1.00	0.76	0.61	0.47	1.00	0.78	0.64	0.49	1.00	0.80	0.66	0.51	1.00	1.00	0.68	0.53	1.00	1.00	0.74	0.59
		ΔT	23	21	17	14	23	21	17	14	23	21	18	14	23	21	17	14	22	21	17	14	24	22	18	15
<b>1575</b>	KW	2.33	2.33	2.33	2.35	2.60	2.60	2.60	2.62	2.90	2.90	2.90	2.92	3.23	3.22	3.22	3.24	3.59	3.59	3.58	3.60	4.01	4.01	4.01	4.03	
	Amps	8.3	8.3	8.3	8.0	9.6	9.6	9.5	10.0	10.9	10.9	10.9	11.0	12.4	12.4	12.4	12.0	14.1	14.1	14.1	14.0	16.0	16.0	16.0	16.1	
	HI PR	267	268	270	274	309	310	312	316	352	353	355	360	399	400	402	407	450	451	453	458	504	505	507	512	
	LO PR	128	130	133	138	136	137	140	146	142	144	147	153	148	150	153	158	154	155	158	164	161	162	165	171	
	MBh	40.8	41.4	42.6	44.4	40.5	41.1	42.2	44.0	39.5	40.0	41.2	43.0	37.7	38.2	39.4	41.2	35.5	36.1	37.2	39.1	33.5	34.1	35.3	37.1	

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects ACCA (TVA) conditions  
 kW = Total system power  
 Amps = outdoor unit amps (comp.+fan)



		75										85										95										105										115																			
IDB	AIRFLOW	65										75										85										95										105										115									
		59		63		67		71		75		79		83		87		91		95		99		103		107		111		115																															
		Wet Bulb	Temperature	Wet Bulb	Temperature	Wet Bulb	Temperature	Wet Bulb	Temperature	Wet Bulb	Temperature	Wet Bulb	Temperature	Wet Bulb	Temperature	Wet Bulb	Temperature	Wet Bulb	Temperature	Wet Bulb	Temperature	Wet Bulb	Temperature	Wet Bulb	Temperature	Wet Bulb	Temperature	Wet Bulb	Temperature	Wet Bulb	Temperature																														
<b>70</b>	<b>1225</b>	MBh	39.7	40.2	41.4	-	39.3	39.9	41.1	-	38.3	38.8	40.0	-	36.5	37.1	38.2	-	34.3	34.9	36.1	-	32.3	32.9	34.1	-	34.3	34.9	36.1	-	32.3	32.9	34.1	-	32.3	32.9	34.1	-																							
		S/T	0.63	0.55	0.41	-	0.64	0.56	0.42	-	0.66	0.58	0.44	-	1.00	0.60	0.46	-	1.00	0.63	0.49	-	1.00	0.68	0.54	-	1.00	0.63	0.49	-	1.00	0.68	0.54	-	1.00	0.68	0.54	-																							
		ΔT	20	18	15	-	20	18	15	-	20	18	15	-	20	18	15	-	20	18	14	-	21	19	15	-	20	18	14	-	21	19	15	-	21	19	15	-																							
	<b>1400</b>	KW	2.32	2.32	2.31	-	2.59	2.59	2.58	-	2.89	2.89	2.88	-	3.21	3.21	3.21	-	3.58	3.57	3.57	-	4.00	4.00	4.00	-	3.58	3.57	3.57	-	4.00	4.00	4.00	-	4.00	4.00	4.00	-																							
		Amps	8.3	8.3	8.3	-	9.5	9.5	9.5	-	10.9	10.9	10.9	-	12.4	12.4	12.3	-	14.0	14.0	14.0	-	16.0	16.0	16.0	-	14.0	14.0	14.0	-	16.0	16.0	16.0	-	16.0	16.0	16.0	-																							
		HI PR	264	266	267	-	306	307	309	-	350	351	353	-	397	398	400	-	448	449	451	-	502	503	505	-	448	449	451	-	502	503	505	-	502	503	505	-																							
	<b>1575</b>	LO PR	126	128	131	-	134	135	139	-	140	142	145	-	146	148	151	-	152	153	157	-	159	160	163	-	152	153	157	-	159	160	163	-	159	160	163	-																							
		MBh	40.2	40.8	41.9	-	39.8	40.4	41.6	-	38.8	39.4	40.6	-	37.0	37.6	38.8	-	34.8	35.4	36.6	-	32.9	33.4	34.6	-	34.8	35.4	36.6	-	32.9	33.4	34.6	-	32.9	33.4	34.6	-																							
		S/T	0.69	0.61	0.47	-	0.70	0.62	0.48	-	0.73	0.65	0.51	-	1.00	0.67	0.53	-	1.00	0.69	0.55	-	1.00	0.74	0.60	-	1.00	0.69	0.55	-	1.00	0.74	0.60	-	1.00	0.74	0.60	-																							
	<b>75</b>	ΔT	19	17	13	-	19	17	13	-	19	17	14	-	19	17	13	-	18	17	13	-	20	18	14	-	18	17	13	-	20	18	14	-	20	18	14	-																							
		KW	2.34	2.33	2.33	-	2.60	2.60	2.60	-	2.90	2.90	2.90	-	3.23	3.23	3.22	-	3.59	3.59	3.58	-	4.02	4.01	4.01	-	3.59	3.59	3.58	-	4.02	4.01	4.01	-	4.02	4.03	4.02	-																							
		Amps	8.4	8.3	8.3	-	9.6	9.6	9.6	-	11.0	10.9	10.9	-	12.4	12.4	12.4	-	14.1	14.1	14.1	-	16.0	16.0	16.0	-	14.1	14.1	14.1	-	16.0	16.0	16.0	-	16.0	16.1	16.1	-																							
<b>1225</b>	HI PR	267	268	270	-	308	309	311	-	352	353	355	-	399	400	402	-	450	451	453	-	504	505	507	-	450	451	453	-	504	505	507	-	504	505	507	-																								
	LO PR	130	132	135	-	138	139	142	-	144	146	149	-	150	152	155	-	156	157	160	-	163	164	167	-	156	157	160	-	163	164	167	-	163	164	167	-																								
	MBh	40.8	41.4	42.6	-	40.5	41.0	42.2	-	39.4	40.0	41.2	-	37.7	38.2	39.4	-	35.5	36.0	37.2	-	33.5	34.0	35.2	-	35.5	36.0	37.2	-	33.5	34.0	35.2	-	33.5	34.0	35.2	-																								
<b>1400</b>	S/T	0.73	0.65	0.51	-	0.74	0.66	0.52	-	1.00	0.68	0.54	-	1.00	0.70	0.56	-	1.00	0.73	0.58	-	1.00	1.00	0.64	-	1.00	0.73	0.58	-	1.00	1.00	0.64	-	1.00	1.00	0.64	-																								
	ΔT	18	16	13	-	18	16	12	-	18	16	13	-	18	16	12	-	17	16	12	-	19	17	13	-	17	16	12	-	19	17	13	-	19	17	13	-																								
	KW	2.35	2.34	2.34	-	2.62	2.61	2.61	-	2.92	2.91	2.91	-	3.24	3.24	3.23	-	3.60	3.60	3.60	-	4.03	4.03	4.02	-	3.60	3.60	3.60	-	4.03	4.03	4.02	-	4.03	4.03	4.02	-																								
<b>1575</b>	Amps	8.4	8.4	8.4	-	9.6	9.6	9.6	-	11.0	11.0	11.0	-	12.5	12.5	12.5	-	14.2	14.1	14.1	-	16.1	16.1	16.1	-	14.2	14.1	14.1	-	16.1	16.1	16.1	-	16.1	16.1	16.1	-																								
	HI PR	269	270	272	-	311	312	314	-	354	355	357	-	401	402	404	-	452	453	455	-	506	507	509	-	452	453	455	-	506	507	509	-	506	507	509	-																								
	LO PR	130	132	135	-	138	139	142	-	144	146	149	-	150	152	155	-	156	157	160	-	163	164	167	-	156	157	160	-	163	164	167	-	163	164	167	-																								

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects ACCA (TVA) conditions  
 kW = Total system power  
 Amps = outdoor unit amps (comp.+fan)

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																																			
		65						75						85						95						105						115					
		59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79						
80	1225	MBh	39.9	40.5	41.7	43.5	39.6	40.1	41.3	43.1	43.1	38.5	39.1	40.3	42.1	36.7	37.3	38.5	40.3	40.3	34.6	35.1	36.3	38.1	32.6	33.1	34.3	36.1									
		S/T	1.00	0.82	0.68	0.5	1.00	0.82	0.68	0.53	0.53	1.00	0.85	0.71	0.6	1.00	1.00	0.73	0.58	0.58	1.00	1.00	0.75	0.6	1.00	1.00	0.81	0.66									
		ΔT	28	26	23	19	28	26	23	19	28	26	23	19	28	26	23	19	28	23	28	26	22	19	29	27	23	20									
		KW	2.32	2.32	2.31	2.3	2.59	2.59	2.58	2.60	2.60	2.89	2.89	2.88	2.9	3.21	3.21	3.21	3.23	3.23	3.58	3.57	3.57	3.6	4.00	4.00	4.00	4.02									
		Amps	8.3	8.3	8.3	8.0	9.5	9.5	9.5	10.0	10.0	10.9	10.9	10.9	11.0	12.4	12.4	12.4	12.0	12.0	14.0	14.0	14.0	14.0	16.0	16.0	16.0	16.0									
	1400	HI PR	265	266	268	273	307	308	310	314	314	351	352	354	358	398	399	401	405	405	448	449	451	456	502	504	505	510									
		LO PR	127	128	131	137	134	136	139	144	144	141	143	146	151	147	148	152	157	157	152	154	157	162	159	161	164	169									
		MBh	40.4	41.0	42.2	44.0	40.1	40.6	41.8	43.6	43.6	39.0	39.6	40.8	42.6	37.3	37.8	39.0	40.8	40.8	35.1	35.6	36.8	38.6	33.1	33.6	34.8	36.6									
		S/T	1.00	0.88	0.74	0.6	1.00	0.89	0.74	0.60	0.60	1.00	0.91	0.77	0.6	1.00	1.00	0.79	0.64	0.64	1.00	1.00	0.81	0.7	1.00	1.00	0.87	0.72									
		ΔT	27	25	22	18	27	25	21	18	27	25	22	18	27	25	22	18	27	21	26	25	21	18	28	26	22	19									
1575	KW	2.33	2.33	2.33	2.4	2.60	2.60	2.60	2.62	2.62	2.90	2.90	2.90	2.9	3.23	3.23	3.23	3.24	3.24	3.60	3.59	3.58	3.6	4.02	4.01	4.01	4.03										
	Amps	8.4	8.3	8.3	8.0	9.6	9.6	9.6	10.0	10.0	11.0	11.0	10.9	11.0	12.4	12.4	12.4	12.0	12.0	14.1	14.1	14.1	14.0	16.0	16.0	16.0	16.1										
	HI PR	267	268	270	275	309	310	312	317	317	353	354	356	360	400	401	403	407	407	451	452	454	458	505	506	508	512										
	LO PR	129	130	133	139	136	138	141	146	146	143	144	148	153	149	150	152	155	155	154	156	158	161	161	163	165	171										
	MBh	41.1	41.6	42.8	44.6	40.7	41.3	42.4	44.3	44.3	39.7	40.2	41.4	43.2	37.9	38.4	39.6	41.4	41.4	35.7	36.3	37.4	39.3	33.7	34.3	35.5	37.3										

IDB	AIRFLOW	OUTDOOR AMBIENT TEMPERATURE																																			
		65						75						85						95						105						115					
		59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79	59	63	67	71	75	79						
85	1225	MBh	40.6	41.1	42.3	44.1	40.2	40.8	42.0	43.8	43.8	39.2	39.7	40.9	42.7	37.4	38.0	39.1	41.0	41.0	35.2	35.8	37.0	38.8	33.2	33.8	35.0	36.8									
		S/T	1.00	0.92	0.78	0.63	1.00	1.00	0.79	0.64	0.64	1.00	1.00	0.81	0.67	1.00	1.00	0.83	0.69	0.69	1.00	1.00	0.75	0.71	1.00	1.00	0.76										
		ΔT	31	30	26	23	31	30	26	23	31	30	26	23	31	30	26	23	31	26	31	29	26	22	32	30	27	24									
		KW	2.33	2.32	2.32	2.34	2.59	2.59	2.59	2.61	2.61	2.89	2.89	2.89	2.91	3.22	3.22	3.22	3.23	3.23	3.60	3.58	3.58	3.60	4.01	4.01	4.00	4.02									
		Amps	8.3	8.3	8.3	8.0	9.5	9.5	9.5	10.0	10.0	10.9	10.9	10.9	11.0	12.4	12.4	12.4	12.0	12.0	14.1	14.0	14.0	14.0	16.0	16.0	16.0	16.1									
	1400	HI PR	266	267	269	274	308	309	311	316	316	352	353	355	359	399	400	402	406	406	450	451	453	457	504	505	507	511									
		LO PR	129	130	133	139	136	138	141	146	146	143	145	148	153	149	150	153	159	159	154	156	158	164	161	163	166	171									
		MBh	41.1	41.7	42.8	44.7	40.7	41.3	42.5	44.3	44.3	39.7	40.3	41.5	43.3	37.9	38.5	39.7	41.5	41.5	35.7	36.3	37.5	39.3	33.8	34.3	35.5	37.3									
		S/T	1.00	0.99	0.84	0.69	1.00	1.00	0.85	0.70	0.70	1.00	1.00	0.88	0.73	1.00	1.00	0.90	0.75	0.75	1.00	1.00	0.77	0.77	1.00	1.00	0.82										
		ΔT	30	29	25	22	30	28	25	22	30	28	25	22	30	28	25	22	30	25	30	28	25	21	31	29	26	22									
1575	KW	2.34	2.34	2.33	2.35	2.61	2.61	2.60	2.62	2.62	2.91	2.91	2.90	2.92	3.23	3.23	3.23	3.25	3.25	3.60	3.59	3.59	3.61	4.02	4.02	4.01	4.04										
	Amps	8.4	8.4	8.3	8.0	9.6	9.6	9.6	10.0	10.0	11.0	11.0	10.9	11.0	12.5	12.5	12.5	13.0	13.0	14.1	14.1	14.1	14.0	16.1	16.1	16.0	16.1										
	HI PR	269	270	272	276	310	311	313	318	318	354	355	357	362	401	402	404	409	409	452	453	455	459	506	507	509	514										
	LO PR	130	132	135	141	138	140	143	148	148	145	146	150	155	150	152	155	161	161	156	158	161	166	161	163	165	168	173									
	MBh	41.7	42.3	43.5	45.3	41.4	41.9	43.1	44.9	44.9	40.3	40.9	42.1	43.9	38.5	39.1	40.3	42.1	42.1	36.4	36.9	38.1	39.9	34.4	34.9	36.1	37.9										

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects AHRI conditions  
 kW = Total system power  
 Amps = outdoor unit amps (comp.+fan)



IDB	OUTDOOR AMBIENT TEMPERATURE																								
	65				75				85				95				105				115				
	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	
<b>70</b>	<b>1400</b>																								
	MBh	46.4	47.1	48.5	-	46.0	46.7	48.0	-	44.8	45.4	46.8	-	42.7	43.4	44.8	-	40.2	40.8	42.2	-	37.9	38.5	39.9	-
	S/T	0.61	0.54	0.41	-	0.62	0.55	0.41	-	0.65	0.57	0.44	-	0.66	0.59	0.46	-	1.00	0.61	0.48	-	1.00	0.66	0.53	-
	ΔT	19	17	14	-	19	17	14	-	19	18	14	-	19	17	14	-	19	17	14	-	20	18	15	-
	KW	2.77	2.77	2.76	-	3.09	3.08	3.08	-	3.44	3.44	3.43	-	3.83	3.82	3.82	-	4.26	4.25	4.25	-	4.76	4.76	4.75	-
	Amps	10.1	10.1	10.0	-	11.5	11.5	11.5	-	13.2	13.2	13.1	-	14.9	14.9	14.9	-	16.9	16.9	16.9	-	19.2	19.2	19.2	-
	HI PR	259	259	260	-	298	299	301	-	341	342	343	-	386	387	389	-	436	437	438	-	488	489	491	-
	LO PR	123	125	128	-	131	132	136	-	137	139	142	-	143	145	148	-	148	150	153	-	155	157	160	-
	<b>1550</b>																								
	MBh	46.9	47.6	48.9	-	46.5	47.1	48.5	-	45.3	45.9	47.3	-	43.2	43.9	45.2	-	40.7	41.3	42.7	-	38.3	39.0	40.4	-
	S/T	0.66	0.58	0.45	-	0.66	0.59	0.45	-	0.69	0.61	0.48	-	1.00	0.63	0.50	-	1.00	0.65	0.52	-	1.00	0.71	0.57	-
	ΔT	18	17	13	-	18	17	13	-	19	17	13	-	18	17	13	-	18	16	13	-	19	17	14	-
	KW	2.78	2.78	2.77	-	3.10	3.10	3.09	-	3.45	3.45	3.45	-	3.84	3.84	3.83	-	4.27	4.27	4.26	-	4.77	4.77	4.76	-
	Amps	10.1	10.1	10.1	-	11.6	11.6	11.6	-	13.2	13.2	13.2	-	15.0	15.0	14.9	-	16.9	16.9	16.9	-	19.3	19.2	19.2	-
	HI PR	259	260	262	-	300	301	303	-	342	343	345	-	388	389	391	-	437	438	440	-	490	491	493	-
	LO PR	127	126	129	-	132	134	137	-	139	140	144	-	144	146	149	-	150	151	154	-	157	158	161	-
	<b>1800</b>																								
	MBh	47.9	48.5	49.9	-	47.5	48.1	49.5	-	46.2	46.9	48.3	-	44.2	44.8	46.2	-	41.6	42.3	43.7	-	39.3	40.0	41.3	-
	S/T	0.70	0.62	0.49	-	0.70	0.63	0.49	-	0.73	0.65	0.52	-	1.00	0.67	0.54	-	1.00	0.69	0.56	-	1.00	0.74	0.61	-
	ΔT	17	15	12	-	17	15	12	-	17	16	12	-	17	15	12	-	17	15	12	-	18	16	13	-
KW	2.80	2.80	2.79	-	3.12	3.11	3.11	-	3.47	3.47	3.46	-	3.86	3.85	3.85	-	4.29	4.28	4.28	-	4.79	4.79	4.78	-	
Amps	10.2	10.2	10.2	-	11.7	11.7	11.6	-	13.3	13.3	13.3	-	15.1	15.0	15.0	-	17.0	17.0	17.0	-	19.3	19.3	19.3	-	
HI PR	262	263	265	-	302	304	305	-	345	346	348	-	391	392	394	-	440	441	443	-	493	494	496	-	
LO PR	127	129	132	-	135	136	140	-	141	143	146	-	147	149	152	-	152	154	157	-	159	161	164	-	
<b>75</b>	<b>1400</b>																								
	MBh	46.4	47.1	48.5	50.6	46.0	46.7	48.1	50.2	44.8	45.5	46.9	49.0	42.7	<b>43.4</b>	44.8	46.9	40.2	40.9	42.2	44.4	37.9	38.5	39.9	42.0
	S/T	0.74	0.67	0.53	0.39	0.75	0.67	0.54	0.40	1.00	0.70	0.56	0.42	1.00	<b>0.72</b>	0.58	0.44	1.00	0.74	0.60	0.46	1.00	1.00	0.66	0.51
	ΔT	23	21	18	15	23	21	18	14	23	22	18	15	23	<b>21</b>	18	14	23	21	18	14	24	22	19	15
	KW	2.77	2.76	2.76	2.78	3.08	3.08	3.08	3.10	3.44	3.44	3.43	3.46	3.82	<b>3.82</b>	3.82	3.84	4.25	4.25	4.25	4.27	4.76	4.76	4.75	4.77
	Amps	10.1	10.1	10.0	10.1	11.5	11.5	11.5	11.6	13.2	13.1	13.1	13.2	14.9	<b>14.9</b>	14.9	15.0	16.9	16.9	16.8	17.0	19.2	19.2	19.1	19.3
	HI PR	258	259	261	265	298	299	301	306	341	342	344	348	386	<b>388</b>	389	394	436	437	439	443	488	490	491	496
	LO PR	123	125	128	133	131	132	136	141	137	139	142	147	143	<b>145</b>	148	153	148	150	153	158	155	157	160	165
	<b>1550</b>																								
	MBh	46.9	47.6	49.0	51.1	46.5	47.2	48.5	50.7	45.3	46.0	47.3	49.5	43.2	<b>43.9</b>	45.3	47.4	40.7	41.3	42.7	44.8	38.4	39.0	40.4	42.5
	S/T	0.79	0.71	0.58	0.44	0.79	0.72	0.58	0.44	1.00	0.74	0.61	0.47	1.00	<b>0.76</b>	0.63	0.49	1.00	0.78	0.65	0.51	1.00	1.00	0.70	0.56
	ΔT	22	21	17	14	22	20	17	14	23	21	17	14	22	<b>20</b>	17	14	22	20	17	13	23	21	18	15
	KW	2.78	2.78	2.77	2.80	3.10	3.09	3.09	3.11	3.45	3.45	3.44	3.47	3.84	<b>3.83</b>	3.83	3.85	4.27	4.26	4.26	4.28	4.77	4.77	4.76	4.79
	Amps	10.1	10.1	10.1	10.2	11.6	11.6	11.5	11.7	13.2	13.2	13.2	13.3	15.0	<b>15.0</b>	14.9	15.0	16.9	16.9	16.9	17.0	19.2	19.2	19.2	19.3
	HI PR	259	260	262	267	300	301	303	307	342	344	345	350	388	<b>389</b>	391	396	437	439	440	445	490	491	493	498
	LO PR	125	126	129	135	132	134	137	142	139	140	144	149	144	<b>146</b>	149	154	150	151	155	160	157	158	161	167
	<b>1800</b>																								
	MBh	47.9	48.5	49.9	52.0	47.5	48.1	49.5	51.6	46.3	46.9	48.3	50.4	44.2	<b>44.8</b>	46.2	48.3	41.7	42.3	43.7	45.8	39.3	40.0	41.4	43.5
	S/T	0.82	0.75	0.62	0.47	1.00	0.76	0.62	0.48	1.00	0.78	0.65	0.50	1.00	<b>0.80</b>	0.67	0.52	1.00	0.82	0.69	0.55	1.00	1.00	0.74	0.60
	ΔT	21	19	16	13	21	19	16	12	21	20	16	13	21	<b>19</b>	16	12	21	19	16	12	22	20	17	13
KW	2.80	2.79	2.79	2.81	3.11	3.11	3.11	3.13	3.47	3.47	3.46	3.49	3.85	<b>3.85</b>	3.85	3.87	4.28	4.28	4.28	4.30	4.79	4.79	4.78	4.80	
Amps	10.2	10.2	10.2	10.3	11.7	11.7	11.6	11.7	13.3	13.3	13.3	13.4	15.1	<b>15.0</b>	15.0	15.1	17.0	17.0	17.0	17.1	19.3	19.3	19.3	19.4	
HI PR	262	263	265	270	303	304	306	310	345	346	348	353	391	<b>392</b>	394	398	440	441	443	448	493	494	496	500	
LO PR	127	129	132	137	135	136	140	145	142	143	146	151	147	<b>149</b>	152	157	152	154	157	162	159	161	164	169	

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects ACCA (TVRA) conditions  
 kW = Total system power  
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — ASX140481K\* + CA\*F4860\*6\*\* + EEP (CONT.)

IDB	OUTDOOR AMBIENT TEMPERATURE																									
	65				75				85				95													
	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71										
<b>1400</b>	MBh	46.7	47.3	48.7	50.8	46.3	46.9	48.3	50.4	45.1	45.7	47.1	49.2	43.0	43.6	45.0	47.1	40.4	41.1	42.5	44.6	38.1	38.8	40.2	42.3	
	S/T	1.00	0.79	0.66	0.5	1.00	0.80	0.66	0.52	1.00	0.82	0.69	0.6	1.00	0.84	0.71	0.57	1.00	1.00	1.00	0.73	0.6	1.00	1.00	0.78	0.64
	$\Delta T$	27	25	22	19	27	25	22	18	27	26	22	19	27	25	22	18	27	25	22	18	28	26	23	19	
	KW	2.77	2.77	2.76	2.8	3.09	3.08	3.08	3.10	3.44	3.44	3.43	3.5	3.83	3.82	3.82	3.84	4.26	4.25	4.25	4.3	4.76	4.76	4.75	4.78	
	Amps	10.1	10.1	10.0	10.2	11.5	11.5	11.5	11.6	13.2	13.1	13.1	13.2	14.9	14.9	14.9	15.0	16.9	16.9	16.9	17.0	19.2	19.2	19.2	19.3	
	HI PR	258	259	261	266	299	300	302	306	341	342	344	349	387	388	390	394	436	437	439	444	489	490	492	496	
	LO PR	124	125	129	134	131	133	136	141	138	140	143	148	144	145	148	153	149	151	154	159	156	157	160	166	
<b>80</b>	MBh	47.2	47.8	49.2	51.3	46.8	47.4	48.8	50.9	45.5	46.2	47.6	49.7	43.5	44.1	45.5	47.6	40.9	41.6	43.0	45.1	38.6	39.3	40.6	42.8	
	S/T	1.00	0.83	0.70	0.6	1.00	0.84	0.71	0.57	1.00	0.86	0.73	0.6	1.00	1.00	0.75	0.61	1.00	1.00	1.00	0.77	0.6	1.00	1.00	0.82	0.68
	$\Delta T$	26	25	21	18	26	24	21	18	27	25	21	18	26	24	21	18	26	24	21	17	27	25	22	18	
	KW	2.78	2.78	2.77	2.8	3.10	3.10	3.09	3.12	3.45	3.45	3.45	3.5	3.84	3.84	3.83	3.86	4.27	4.27	4.26	4.3	4.77	4.77	4.76	4.79	
	Amps	10.1	10.1	10.1	10.2	11.6	11.6	11.6	11.7	13.2	13.2	13.2	13.3	15.0	15.0	14.9	15.1	16.9	16.9	16.9	17.0	19.3	19.3	19.2	19.3	
	HI PR	260	261	263	267	300	302	303	308	343	344	346	350	389	390	392	396	438	439	441	445	491	492	493	498	
	LO PR	125	127	130	135	133	134	138	143	139	141	144	149	145	146	150	155	150	152	155	160	157	159	162	167	
	MBh	48.1	48.8	50.2	52.3	47.7	48.4	49.8	51.9	46.5	47.2	48.5	50.7	44.4	45.1	46.5	48.6	41.9	42.5	43.9	46.0	39.6	40.2	41.6	43.7	
	S/T	1.00	0.87	0.74	0.6	1.00	0.88	0.75	0.60	1.00	0.90	0.77	0.6	1.00	1.00	0.79	0.65	1.00	1.00	1.00	0.81	0.7	1.00	1.00	0.86	0.72
	$\Delta T$	25	23	20	17	25	23	20	16	25	24	20	17	25	23	20	16	25	23	20	16	26	24	21	17	
	KW	2.80	2.80	2.79	2.8	3.12	3.11	3.11	3.13	3.47	3.47	3.46	3.5	3.86	3.85	3.85	3.87	4.29	4.28	4.28	4.3	4.79	4.79	4.78	4.81	
	Amps	10.2	10.2	10.2	10.3	11.7	11.7	11.6	11.7	13.3	13.3	13.3	13.4	15.1	15.0	15.0	15.1	17.0	17.0	17.0	17.1	19.3	19.3	19.3	19.4	
	HI PR	263	264	266	270	303	304	306	311	346	347	349	353	391	392	394	399	441	442	444	448	493	494	496	501	
	LO PR	128	130	133	138	136	137	140	145	142	144	147	152	148	149	152	157	153	155	158	163	160	161	165	170	

IDB	OUTDOOR AMBIENT TEMPERATURE																								
	65				75				85				95												
	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71									
<b>1400</b>	MBh	47.5	48.1	49.5	51.6	47.1	47.7	49.1	51.2	45.8	46.5	47.9	50.0	43.8	44.4	45.8	47.9	41.2	41.9	43.3	45.4	38.9	39.6	40.9	43.0
	S/T	1.00	0.89	0.76	0.62	1.00	0.90	0.76	0.62	1.00	1.00	0.79	0.65	1.00	1.00	0.81	0.67	1.00	1.00	0.83	0.69	1.00	1.00	1.00	0.74
	$\Delta T$	31	29	26	22	31	29	25	22	31	29	26	22	31	29	25	22	30	29	25	22	31	30	26	23
	KW	2.77	2.77	2.77	2.79	3.09	3.09	3.08	3.11	3.45	3.45	3.44	3.46	3.83	3.83	3.82	3.85	4.26	4.26	4.25	4.28	4.77	4.76	4.76	4.78
	Amps	10.1	10.1	10.1	10.2	11.6	11.6	11.5	11.6	13.2	13.2	13.2	13.3	14.9	14.9	14.9	15.0	16.9	16.9	16.9	17.0	19.2	19.2	19.2	19.3
	HI PR	259	261	262	267	300	301	303	307	342	344	345	350	388	389	391	396	437	439	440	445	490	491	493	498
	LO PR	126	127	130	136	133	135	138	143	140	141	145	150	145	147	150	155	151	152	155	161	158	159	162	168
<b>1550</b>	MBh	47.9	48.6	50.0	52.1	47.5	48.2	49.6	51.7	46.3	47.0	48.4	50.5	44.2	44.9	46.3	48.4	41.7	42.4	43.7	45.9	39.4	40.0	41.4	43.5
	S/T	1.00	0.93	0.80	0.66	1.00	1.00	0.81	0.67	1.00	1.00	0.83	0.69	1.00	1.00	0.85	0.71	1.00	1.00	0.87	0.73	1.00	1.00	1.00	0.78
	$\Delta T$	30	28	25	21	30	28	25	21	30	28	25	21	30	28	25	21	30	28	24	21	31	29	26	22
	KW	2.79	2.78	2.78	2.80	3.10	3.10	3.10	3.12	3.46	3.46	3.45	3.48	3.84	3.84	3.84	3.86	4.27	4.27	4.27	4.29	4.78	4.78	4.77	4.79
	Amps	10.2	10.2	10.1	10.2	11.6	11.6	11.6	11.7	13.2	13.2	13.2	13.3	15.0	15.0	15.0	15.1	17.0	17.0	16.9	17.0	19.3	19.3	19.2	19.4
	HI PR	261	262	264	268	302	303	305	309	344	345	347	351	390	391	393	397	439	440	442	447	492	493	495	499
	LO PR	127	129	132	137	135	136	139	145	141	143	146	151	147	148	151	157	152	154	157	162	159	161	164	169
<b>1800</b>	MBh	48.9	49.6	51.0	53.1	48.5	49.2	50.5	52.6	47.3	47.9	49.3	51.4	45.2	45.9	47.2	49.4	42.7	43.3	44.7	46.8	40.3	41.0	42.4	44.5
	S/T	1.00	0.97	0.84	0.70	1.00	1.00	0.85	0.70	1.00	1.00	0.87	0.73	1.00	1.00	0.89	0.75	1.00	1.00	1.00	0.77	1.00	1.00	1.00	0.82
	$\Delta T$	29	27	24	20	29	27	23	20	29	27	24	20	29	27	23	20	28	27	23	20	30	28	24	21
	KW	2.80	2.80	2.80	2.82	3.12	3.12	3.11	3.14	3.48	3.48	3.47	3.49	3.86	3.86	3.85	3.88	4.29	4.29	4.28	4.31	4.80	4.79	4.79	4.81
	Amps	10.2	10.2	10.2	10.3	11.7	11.7	11.7	11.8	13.3	13.3	13.3	13.4	15.1	15.1	15.0	15.2	17.1	17.0	17.0	17.1	19.4	19.3	19.3	19.4
	HI PR	264	265	267	271	304	305	307	312	347	348	350	354	393	394	395	400	442	443	445	449	495	496	497	502
	LO PR	130	131	135	140	137	139	142	147	144	145	149	154	149	151	154	159	155	156	160	165	162	163	166	172

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects AHRI conditions  
 kW = Total system power  
 Amps = outdoor unit amps (comp.+fan)

IDB		OUTDOOR AMBIENT TEMPERATURE																																																	
		65						75						85						95						105						115																			
		AIRFLOW				59				63				67				71				59				63				67				71				59				63				67				71	
		ENTERING INDOOR WET BULB TEMPERATURE												ENTERING INDOOR DRY BULB TEMPERATURE																																					
<b>70</b>	<b>1550</b>	MBh	58.8	59.6	61.3	-	58.2	59.1	60.8	-	56.7	57.5	59.3	-	54.1	54.9	56.7	-	50.9	51.7	53.5	-	48.0	48.8	50.6	-																									
		S/T	0.62	0.55	0.42	-	0.62	0.55	0.43	-	0.65	0.58	0.45	-	0.66	0.59	0.47	-	0.69	0.61	0.49	-	1.00	0.66	0.54	-																									
		ΔT	21	19	15	-	21	19	15	-	21	19	15	-	21	19	15	-	21	19	15	-	22	20	16	-																									
		KW	3.43	3.42	3.42	-	3.85	3.85	3.84	-	4.33	4.33	4.32	-	4.84	4.84	4.83	-	5.42	5.42	5.41	-	6.09	6.09	6.08	-																									
		Amps	13.2	13.2	13.1	-	15.1	15.1	15.1	-	17.3	17.3	17.3	-	19.7	19.6	19.6	-	22.3	22.3	22.2	-	25.4	25.4	25.3	-																									
	<b>1750</b>	HI PR	270	271	273	-	312	313	315	-	356	358	359	-	404	405	407	-	455	457	459	-	510	511	513	-																									
		LO PR	117	118	121	-	124	125	128	-	130	131	134	-	135	136	139	-	140	141	144	-	146	148	151	-																									
		MBh	59.7	60.5	62.3	-	59.2	60.0	61.7	-	57.7	58.5	60.2	-	55.1	55.9	57.6	-	51.9	52.7	54.4	-	49.0	49.8	51.5	-																									
		S/T	0.65	0.58	0.45	-	0.66	0.58	0.46	-	0.68	0.61	0.48	-	0.70	0.63	0.50	-	0.72	0.65	0.52	-	1.00	0.69	0.57	-																									
		ΔT	20	18	14	-	20	18	14	-	20	18	14	-	20	18	14	-	19	17	14	-	21	19	15	-																									
<b>2000</b>	KW	3.45	3.44	3.43	-	3.87	3.87	3.86	-	4.35	4.34	4.34	-	4.86	4.86	4.85	-	5.44	5.43	5.43	-	6.11	6.11	6.10	-																										
	Amps	13.3	13.3	13.2	-	15.2	15.2	15.2	-	17.4	17.4	17.3	-	19.8	19.7	19.7	-	22.4	22.4	22.3	-	25.5	25.5	25.4	-																										
	HI PR	272	273	275	-	314	316	318	-	359	360	362	-	406	408	409	-	458	459	461	-	513	514	516	-																										
	LO PR	118	120	123	-	125	127	130	-	132	133	136	-	137	138	141	-	142	143	146	-	148	150	153	-																										
	MBh	61.2	62.0	63.7	-	60.6	61.5	63.2	-	59.1	60.0	61.7	-	56.5	57.3	59.1	-	53.3	54.2	55.9	-	50.4	51.3	53.0	-																										
<b>75</b>	<b>1550</b>	S/T	0.74	0.67	0.54	0.41	0.74	0.67	0.55	0.41	0.77	0.70	0.57	0.44	1.00	<b>0.71</b>	0.59	0.46	1.00	0.73	0.61	0.48	1.00	0.78	0.66	0.52																									
		ΔT	25	23	20	16	25	23	19	16	26	24	20	16	25	<b>23</b>	19	16	25	23	19	15	26	24	20	17																									
		KW	3.42	3.42	3.41	3.45	3.85	3.85	3.84	3.87	4.33	4.32	4.32	4.35	4.84	<b>4.84</b>	4.83	4.86	5.42	5.41	5.41	5.44	6.09	6.09	6.08	6.11																									
		Amps	13.2	13.1	13.1	13.3	15.1	15.1	15.1	15.2	17.3	17.3	17.2	17.4	19.7	<b>19.6</b>	19.6	19.8	22.3	22.3	22.2	22.4	25.4	25.4	25.3	25.5																									
		HI PR	270	271	273	278	312	314	315	320	357	358	360	364	404	<b>405</b>	407	412	456	457	459	463	511	512	514	518																									
	<b>1750</b>	LO PR	117	118	121	126	124	125	128	133	130	131	134	139	135	<b>136</b>	139	144	140	141	144	149	146	148	151	155																									
		MBh	59.7	60.6	62.3	64.9	59.2	60.0	61.8	64.4	57.7	58.5	60.3	62.9	55.1	<b>55.9</b>	57.6	60.3	51.9	52.7	54.5	57.1	49.0	49.8	51.6	54.2																									
		S/T	0.77	0.70	0.57	0.44	0.78	0.70	0.58	0.45	0.80	0.73	0.60	0.47	1.00	<b>0.75</b>	0.62	0.49	1.00	0.77	0.64	0.51	1.00	0.81	0.69	0.56																									
		ΔT	24	22	18	15	24	22	18	14	25	23	19	15	24	<b>22</b>	18	14	24	22	18	14	25	23	19	15																									
		KW	3.44	3.44	3.43	3.46	3.87	3.87	3.86	3.89	4.34	4.34	4.33	4.37	4.86	<b>4.86</b>	4.85	4.88	5.44	5.43	5.42	5.46	6.11	6.11	6.10	6.13																									
<b>2000</b>	Amps	13.3	13.2	13.2	13.4	15.2	15.2	15.2	15.3	17.4	17.4	17.3	17.5	19.7	<b>19.7</b>	19.7	19.8	22.4	22.4	22.3	22.5	25.5	25.4	25.4	25.6																										
	HI PR	272	274	276	280	315	316	318	322	359	360	362	367	407	<b>408</b>	410	414	458	459	461	466	513	514	516	521																										
	LO PR	118	120	123	128	125	127	130	135	132	133	136	141	137	<b>138</b>	141	146	142	143	146	151	148	150	153	157																										
	MBh	61.2	62.0	63.8	66.4	60.7	61.5	63.2	65.9	59.2	60.0	61.7	64.4	56.6	<b>57.4</b>	59.1	61.8	53.4	54.2	55.9	58.6	50.5	51.3	53.0	55.7																										
	S/T	0.78	0.71	0.58	0.45	0.78	0.71	0.59	0.46	1.00	0.74	0.61	0.48	1.00	<b>0.75</b>	0.63	0.50	1.00	0.78	0.65	0.52	1.00	0.82	0.70	0.56																										
<b>2000</b>	ΔT	23	21	17	13	23	21	17	13	23	21	18	14	23	<b>21</b>	17	13	23	21	17	13	24	22	18	14																										
	KW	3.46	3.46	3.45	3.49	3.89	3.89	3.88	3.91	4.37	4.36	4.36	4.39	4.88	<b>4.88</b>	4.87	4.90	5.46	5.45	5.45	5.48	6.13	6.13	6.12	6.15																										
	Amps	13.3	13.3	13.3	13.4	15.3	15.3	15.3	15.4	17.5	17.5	17.4	17.6	19.8	<b>19.8</b>	19.8	19.9	22.5	22.5	22.4	22.6	25.6	25.5	25.5	25.7																										
	HI PR	275	277	278	283	318	319	321	325	362	363	365	370	410	<b>411</b>	413	417	461	462	464	469	516	517	519	523																										
	LO PR	121	123	126	131	128	130	133	138	134	136	139	144	140	<b>141</b>	144	149	145	146	149	154	151	152	155	160																										

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects ACCA (TVA) conditions  
 kW = Total system power  
 Amps = outdoor unit amps (comp.+fan)

EXPANDED COOLING DATA — ASX140601K\* +CA\*F4961\*6\*\*\* + EEP + TXV (CONT.)

IDB		OUTDOOR AMBIENT TEMPERATURE																																																																																																																																																																															
		65				75				85				95				105				115																																																																																																																																																											
AIRFLOW		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71																																																																																																																																																				
		ENTERING INDOOR WET BULB TEMPERATURE																																																																																																																																																																															
80	1550	MBh	59.1	59.9	61.6	64.3	58.6	59.4	61.1	63.8	57.1	57.9	59.6	62.3	54.4	55.3	57.0	59.6	51.3	52.1	53.8	56.5	48.4	49.2	50.9	53.6	S/T	0.85	0.78	0.66	0.5	1.00	0.79	0.66	0.53	1.00	0.83	0.70	0.57	1.00	0.85	0.72	0.6	1.00	1.00	0.77	0.64	ΔT	30	28	24	20	30	28	24	20	30	28	24	20	30	29	25	21	KW	3.43	3.42	3.42	3.5	3.85	3.85	3.84	3.87	4.33	4.32	4.32	4.4	4.84	4.84	4.83	4.87	5.42	5.42	5.41	5.4	6.09	6.09	6.08	6.12	Amps	13.2	13.2	13.1	13.3	15.1	15.1	15.1	15.2	17.3	17.3	17.3	17.4	19.7	19.6	19.6	19.8	22.3	22.3	22.2	22.4	25.4	25.4	25.3	25.5	HI PR	271	272	274	278	313	314	316	321	357	358	360	365	405	406	408	413	456	457	459	464	511	512	514	519	LO PR	117	118	121	126	124	125	128	133	130	132	135	139	135	137	140	145	140	142	145	150	147	148	151	156													
		1750	MBh	60.0	60.9	62.6	65.2	59.5	60.3	62.1	64.7	58.0	58.8	60.6	63.2	55.4	56.2	57.9	60.6	52.2	53.0	54.8	57.4	49.3	50.1	51.9	54.5	S/T	0.89	0.81	0.69	0.6	1.00	0.82	0.70	0.56	1.00	0.84	0.72	0.6	1.00	0.86	0.74	0.60	1.00	0.88	0.76	0.6	1.00	1.00	0.80	0.67	ΔT	29	27	23	19	29	27	23	19	29	27	23	19	29	26	23	19	30	28	24	20	KW	3.44	3.44	3.43	3.5	3.87	3.87	3.86	3.89	4.35	4.34	4.34	4.4	4.86	4.86	4.85	4.88	5.44	5.43	5.43	5.5	6.11	6.11	6.10	6.13	Amps	13.3	13.2	13.2	13.4	15.2	15.2	15.2	15.3	17.4	17.4	17.3	17.5	19.7	19.7	19.7	19.8	22.4	22.4	22.3	22.5	25.5	25.5	25.4	25.6	HI PR	273	274	276	281	315	316	318	323	359	361	362	367	407	408	410	415	458	460	462	466	513	514	516	521	LO PR	119	120	123	128	126	127	130	135	132	134	136	141	137	139	142	146	142	144	147	152	149	150	153	158				
		2000	MBh	61.5	62.3	64.1	66.7	61.0	61.8	63.5	66.2	59.5	60.3	62.0	64.7	56.9	57.7	59.4	62.1	53.7	54.5	56.2	58.9	50.8	51.6	53.3	56.0	S/T	0.89	0.82	0.70	0.6	1.00	0.83	0.70	0.57	1.00	0.85	0.73	0.6	1.00	0.87	0.75	0.61	1.00	1.00	0.77	0.6	1.00	1.00	0.81	0.68	ΔT	28	26	22	18	28	26	22	18	28	26	22	18	27	25	21	18	29	27	23	19	30	28	24	20	KW	3.47	3.46	3.46	3.5	3.89	3.89	3.88	3.91	4.37	4.36	4.36	4.4	4.88	4.88	4.87	4.90	5.46	5.46	5.45	5.5	6.13	6.13	6.12	6.16	Amps	13.4	13.3	13.3	13.5	15.3	15.3	15.3	15.4	17.5	17.5	17.4	17.6	19.8	19.8	19.8	19.9	22.5	22.5	22.4	22.6	25.6	25.6	25.5	25.7	HI PR	276	277	279	284	318	319	321	326	362	364	365	370	410	411	413	418	461	463	464	469	516	517	519	524	LO PR	122	123	126	131	129	130	133	138	135	136	139	144	140	142	144	149	145	147	150	154	152	153	156	161

IDB		OUTDOOR AMBIENT TEMPERATURE																																																																																																																																																																															
		65				75				85				95				105				115																																																																																																																																																											
AIRFLOW		59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71	59	63	67	71																																																																																																																																																				
		ENTERING INDOOR WET BULB TEMPERATURE																																																																																																																																																																															
85	1550	MBh	60.1	60.9	62.6	65.3	59.5	60.4	62.1	64.7	58.0	58.8	60.6	63.2	55.4	56.2	58.0	60.6	52.2	53.1	54.8	57.4	49.3	50.2	51.9	54.5	S/T	1.00	0.88	0.75	0.62	1.00	0.88	0.76	0.62	1.00	0.91	0.78	0.65	1.00	1.00	0.80	0.67	1.00	1.00	0.82	0.69	1.00	1.00	0.87	0.73	ΔT	34	32	28	24	34	32	28	24	34	32	28	24	34	32	28	24	35	33	29	25	KW	3.43	3.43	3.42	3.46	3.86	3.86	3.85	3.88	4.34	4.33	4.33	4.36	4.85	4.85	4.84	4.87	5.43	5.42	5.42	5.45	6.10	6.10	6.09	6.12	Amps	13.2	13.2	13.2	13.3	15.2	15.1	15.1	15.3	17.3	17.3	17.3	17.4	19.7	19.7	19.7	19.8	22.3	22.3	22.3	22.4	25.4	25.4	25.4	25.5	HI PR	272	273	275	280	314	315	317	322	358	360	361	366	406	407	409	414	457	459	460	465	512	513	515	520	LO PR	119	120	123	128	126	127	130	135	132	133	136	141	137	138	141	146	142	144	146	151	148	150	153	158					
		1750	MBh	61.0	61.8	63.6	66.2	60.5	61.3	63.0	65.7	59.0	59.8	61.5	64.2	56.4	57.2	58.9	61.6	53.2	54.0	55.7	58.4	50.3	51.1	52.8	55.5	S/T	1.00	0.91	0.78	0.65	1.00	0.91	0.79	0.66	1.00	0.94	0.81	0.68	1.00	1.00	0.83	0.70	1.00	1.00	0.85	0.72	1.00	1.00	0.90	0.77	ΔT	33	31	27	23	33	31	27	23	33	31	27	23	33	31	27	23	34	32	28	24	KW	3.45	3.45	3.44	3.48	3.88	3.88	3.87	3.90	4.36	4.35	4.34	4.38	4.87	4.87	4.86	4.89	5.45	5.44	5.44	5.47	6.12	6.12	6.11	6.14	Amps	13.3	13.3	13.3	13.4	15.3	15.2	15.2	15.4	17.4	17.4	17.4	17.5	19.8	19.8	19.7	19.9	22.4	22.4	22.4	22.5	25.5	25.5	25.5	25.6	HI PR	274	275	277	282	316	318	319	324	361	362	364	368	408	410	411	416	460	461	463	467	515	516	518	522	LO PR	121	122	125	130	128	129	132	137	134	135	138	143	139	140	143	148	144	145	148	153	150	152	155	160				
		2000	MBh	62.5	63.3	65.0	67.7	62.0	62.8	64.5	67.2	60.4	61.3	63.0	65.6	57.8	58.7	60.4	63.0	54.7	55.5	57.2	59.9	51.7	52.6	54.3	56.9	S/T	1.00	0.92	0.79	0.66	1.00	0.92	0.80	0.67	1.00	0.94	0.82	0.69	1.00	1.00	0.86	0.73	1.00	1.00	0.86	0.73	1.00	1.00	0.91	0.77	ΔT	32	30	26	22	32	30	26	22	32	30	26	22	32	30	26	22	33	31	27	23	33	31	27	23	KW	3.47	3.47	3.46	3.50	3.90	3.90	3.89	3.92	4.38	4.37	4.37	4.40	4.89	4.89	4.88	4.91	5.47	5.46	5.46	5.49	6.14	6.14	6.13	6.16	Amps	13.4	13.4	13.3	13.5	15.3	15.3	15.3	15.4	17.5	17.5	17.5	17.6	19.9	19.9	19.8	20.0	22.5	22.5	22.5	22.6	25.6	25.6	25.6	25.7	HI PR	277	278	280	285	319	321	322	327	364	365	367	371	411	412	414	419	463	464	466	470	518	519	521	525	LO PR	124	125	128	133	131	132	135	140	137	138	141	146	142	143	146	151	147	148	151	156	153	155	158	162

IDB: Entering Indoor Dry Bulb Temperature  
 High and low pressures are measured at the liquid and suction service valves.  
 Shaded area reflects AHRI conditions  
 kW = Total system power  
 Amps = outdoor unit amps (comp.+fan)

ASX140181K* / CA*F3636*6** W/.052" ORIFICE CONDITIONS: 80 °F IBD, 67 °F IWB @ 600 CFM				
OUTDOOR TEM. ° F.	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75	19,300	13,124	6,176	1,220
80	19,050	13,142	5,908	1,290
85	18,800	13,160	5,640	1,360
90	18,400	13,060	5,340	1,435
<b>95</b>	<b>18,000</b>	<b>12,960</b>	<b>5,040</b>	<b>1,510</b>
100	17,500	12,770	4,730	1,595
105	17,000	12,580	4,420	1,680
110	16,550	12,650	3,901	1,780
115	16,100	12,719	3,381	1,880
TVA CONDITIONS @ 95° OD DB, 75° ID DB 63° ID WB				
95°	17,400	12,700	4,700	1,510

ASX140191K* / CA*F3636*6** W/.053" ORIFICE CONDITIONS: 80 °F IBD, 67 °F IWB @ 550 CFM				
OUTDOOR TEM. ° F.	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75	18,900	13,041	5,859	1,160
80	18,650	13,145	5,506	1,225
85	18,400	13,248	5,152	1,290
90	18,000	13,136	4,864	1,360
<b>95</b>	<b>17,600</b>	<b>13,024</b>	<b>4,576</b>	<b>1,430</b>
100	17,100	12,820	4,280	1,530
105	16,600	12,616	3,984	1,590
110	16,150	12,667	3,484	1,680
115	15,700	12,717	2,983	1,770
TVA CONDITIONS @ 95° OD DB, 75° ID DB 63° ID WB				
95°	17,000	12,750	4,250	1,430

ASX140241L* / CA*F3636*6** W/.057" ORIFICE CONDITIONS: 80 °F IBD, 67 °F IWB @ 700 CFM				
OUTDOOR TEM. ° F.	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75	24,877	16,961	7,916	1,554
80	24,568	17,040	7,528	1,644
85	24,260	17,120	7,140	1,735
90	23,730	16,961	6,769	1,833
<b>95</b>	<b>23,200</b>	<b>16,802</b>	<b>6,397</b>	<b>1,931</b>
100	22,552	16,564	5,988	2,040
105	21,904	16,326	5,578	2,149
110	21,312	16,393	4,919	2,278
115	20,721	16,461	4,260	2,406
TVA CONDITIONS @ 95° OD DB, 75° ID DB 63° ID WB				
95°	22,400	16,802	5,598	1,931

ASX140251L* / CA*F3636*6** W/.057" ORIFICE CONDITIONS: 80 °F IBD, 67 °F IWB @ 700 CFM				
OUTDOOR TEM. ° F.	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75	25,500	17,085	8,415	1,570
80	25,200	17,258	7,943	1,660
85	24,900	17,430	7,470	1,750
90	24,350	17,283	7,067	1,850
<b>95</b>	<b>23,800</b>	<b>17,136</b>	<b>6,664</b>	<b>1,950</b>
100	23,150	16,893	6,257	2,060
105	22,500	16,650	5,850	2,170
110	21,900	16,739	5,162	2,300
115	21,300	16,827	4,473	2,430
TVA Conditions @ 95° OD DB, 75° ID DB 63° ID WB				
95°	23,000	16,790	6,210	1,950

ASX140301K* / CA*F3642*6** W/.065" ORIFICE CONDITIONS: 80 °F IBD, 67 °F IWB @ 1000 CFM				
OUTDOOR TEM. ° F.	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75	30,900	21,630	9,270	1,960
80	30,500	21,651	8,849	2,070
85	30,100	21,672	8,428	2,180
90	29,450	21,492	7,958	2,300
<b>95</b>	<b>28,800</b>	<b>21,312</b>	<b>7,488</b>	<b>2,420</b>
100	28,000	20,992	7,008	2,550
105	27,200	20,672	6,528	2,680
110	26,450	20,745	5,706	2,840
115	25,700	20,817	4,883	3,000
TVA Conditions @ 95° OD DB, 75° ID DB 63° ID WB				
95°	27,800	20,850	6,950	2,420

ASX140311K* / CA*F3137*6** W/.063" ORIFICE CONDITIONS: 80 °F IBD, 67 °F IWB @ 1000 CFM				
OUTDOOR TEM. ° F.	TOTAL BTU/H	SENSIBLE BTU/H	LATENT BTU/H	TOTAL WATTS
75	30,700	22,718	7,982	1,920
80	30,300	22,871	7,430	2,025
85	29,900	23,023	6,877	2,130
90	29,250	22,809	6,442	2,245
<b>95</b>	<b>28,600</b>	<b>22,594</b>	<b>6,006</b>	<b>2,360</b>
100	27,800	22,232	5,568	2,490
105	27,000	21,870	5,130	2,620
110	26,250	21,900	4,350	2,770
115	25,500	21,930	3,570	2,920
TVA Conditions @ 95° OD DB, 75° ID DB 63° ID WB				
95°	27,600	20,080	5,520	2,360

ASX140361K* / CA*F3642*6** W/.068" ORIFICE CONDITIONS: 80 °F IBD, 67 °F IWB @ 1200 CFM				
OUTDOOR TEM. ° F.	TOTAL BTUH	SENSIBLE BTUH	LATENT BTUH	TOTAL WATTS
75	36,700	25,690	11,010	2,330
80	36,250	25,733	10,517	2,460
85	35,800	25,776	10,024	2,590
90	35,000	25,542	9,458	2,730
<b>95</b>	<b>34,200</b>	<b>25,308</b>	<b>8,892</b>	<b>2,870</b>
100	33,250	24,928	8,322	3,030
105	32,300	24,548	7,752	3,190
110	31,400	24,627	6,774	3,370
115	30,500	24,705	5,795	3,550
TVA Conditions @ 95° OD DB, 75° ID DB 63° ID WB				
<b>95°</b>	<b>33,000</b>	<b>24,750</b>	<b>8,250</b>	<b>2,870</b>

ASX140371K* / CA*F3137*6** W/.071" ORIFICE CONDITIONS: 80 °F IBD, 67 °F IWB @ 1100 CFM				
OUTDOOR TEM. ° F.	TOTAL BTUH	SENSIBLE BTUH	LATENT BTUH	TOTAL WATTS
75	36,500	25,915	10,585	2,260
80	36,050	26,130	9,921	2,400
85	35,600	26,344	9,256	2,540
90	34,800	26,092	8,708	2,675
<b>95</b>	<b>34,000</b>	<b>25,840</b>	<b>8,160</b>	<b>2,810</b>
100	33,050	25,439	7,611	2,970
105	32,100	25,038	7,062	3,130
110	31,250	25,135	6,115	3,315
115	30,400	25,232	5,168	3,500
TVA Conditions @ 95° OD DB, 75° ID DB 63° ID WB				
<b>95°</b>	<b>32,800</b>	<b>25,256</b>	<b>7,544</b>	<b>2,810</b>

ASX140421K* / CA*F4961*6** W/.074" ORIFICE CONDITIONS: 80 °F IBD, 67 °F IWB @ 1400 CFM				
OUTDOOR TEM. ° F.	TOTAL BTUH	SENSIBLE BTUH	LATENT BTUH	TOTAL WATTS
75	41,800	30,932	10,868	2,600
80	41,300	31,174	10,126	2,750
85	40,800	31,416	9,384	2,900
90	39,900	31,113	8,787	3,060
<b>95</b>	<b>39,000</b>	<b>30,810</b>	<b>8,190</b>	<b>3,220</b>
100	37,900	30,309	7,591	3,400
105	36,800	29,808	6,992	3,580
110	35,800	30,042	5,758	3,795
115	34,800	30,276	4,524	4,010
TVA Conditions @ 95° OD DB, 75° ID DB 63° ID WB				
<b>95°</b>	<b>37,600</b>	<b>30,080</b>	<b>7,520</b>	<b>3,220</b>

ASX140431K* / CA*F4961*6D* W/.074" ORIFICE CONDITIONS: 80 °F IBD, 67 °F IWB @ 1400 CFM				
OUTDOOR TEM. ° F.	TOTAL BTUH	SENSIBLE BTUH	LATENT BTUH	TOTAL WATTS
75	41,800	30,932	10,868	2,600
80	41,300	31,174	10,126	2,750
85	40,800	31,416	9,384	2,900
90	39,900	31,113	8,787	3,060
<b>95</b>	<b>39,000</b>	<b>30,810</b>	<b>8,190</b>	<b>3,220</b>
100	37,900	30,309	7,591	3,400
105	36,800	29,808	6,992	3,580
110	35,800	30,042	5,758	3,795
115	34,800	30,276	4,524	4,010
TVA Conditions @ 95° OD DB, 75° ID DB 63° ID WB				
<b>95°</b>	<b>37,600</b>	<b>30,080</b>	<b>7,520</b>	<b>3,220</b>

ASX140481K / CA*F4860*6** W/.078" ORIFICE CONDITIONS: 80 °F IBD, 67 °F IWB @ 1400 CFM				
OUTDOOR TEM. ° F.	TOTAL BTUH	SENSIBLE BTUH	LATENT BTUH	TOTAL WATTS
75	48,300	31,878	16,422	3,080
80	47,700	32,189	15,511	3,255
85	47,100	32,500	14,600	3,430
90	46,050	32,225	13,825	3,625
<b>95</b>	<b>45,000</b>	<b>31,950</b>	<b>13,050</b>	<b>3,820</b>
100	43,750	31,488	12,263	4,035
105	42,500	31,025	11,475	4,250
110	41,350	31,191	10,160	4,500
115	40,200	31,356	8,844	4,750
TVA Conditions @ 95° OD DB, 75° ID DB 63° ID WB				
<b>95°</b>	<b>43,400</b>	<b>31,248</b>	<b>12,152</b>	<b>3,820</b>

ASX140601K* / CA*F4961*6** W/.088" ORIFICE CONDITIONS: 80 °F IBD, 67 °F IWB @ 1550 CFM				
OUTDOOR TEM. ° F.	TOTAL BTUH	SENSIBLE BTUH	LATENT BTUH	TOTAL WATTS
75	61,100	40,326	20,774	3,840
80	60,350	40,725	19,625	4,080
85	59,600	41,124	18,476	4,320
90	58,300	40,512	17,788	4,575
<b>95</b>	<b>57,000</b>	<b>39,900</b>	<b>17,100</b>	<b>4,830</b>
100	55,400	39,318	16,082	5,120
105	53,800	38,736	15,064	5,410
110	52,350	38,965	13,386	5,745
115	50,900	39,193	11,707	6,080
TVA Conditions @ 95° OD DB, 75° ID DB 63° ID WB				
<b>95°</b>	<b>55,000</b>	<b>39,050</b>	<b>15,950</b>	<b>4,840</b>

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0181K*	ARUF25B14A*		17,800	12,800	14.0	11.5	570	7989008
	ASPT25B14A*		17,800	12,800	14.5	12.0	580	8245614
	ASPT29B14A*		18,000	13,000	15.0	12.5	560	8245615
	ASPT30C14A*		18,400	13,300	14.5	12.0	580	7546368
	AVPTC24B14A*		18,000	13,000	14.5	12.0	600	7546369
	AVPTC30C14A*		18,400	13,300	14.5	12.0	615	7546370
	AWUF19XX16A*		17,000	12,200	14.0	11.5	600	8390331
	AWUF31XX16A*		17,400	12,500	14.5	11.5	600	7546371
	AWUF32XX16A*		17,400	12,500	14.5	11.5	600	7546372
	CA*F3636*6D*	A*VC80603B*B*	18,000	13,800	14.5	11.5	600	9947392
	CA*F3636*6D*	A*VC80803B*B*	18,000	13,800	14.5	11.5	600	9947393
	CA*F3636*6D*+EEP+TXV		17,800	12,800	14.0	11.5	600	7546373
	CA*F3636*6D*+MBVC1200**-1A*+TXV		17,800	12,800	14.5	11.5	600	7546374
	CA*F3636*6D*+TXV	A*VC80603B*B*	18,000	13,800	15.0	12.0	600	9948943
	CA*F3636*6D*+TXV	A*VC80803B*B*	18,000	13,800	15.0	12.0	600	9948947
	CA*F3636*6D*+TXV	A*EC960803BNA*	17,800	12,800	14.5	11.5	540	7546462
	CA*F3636*6D*+TXV	G*VM970603BNA*	18,000	13,000	14.5	11.5	625	7546418
	CA*F3636*6D*+TXV	G*VM970804CNA*	18,000	13,000	14.5	11.5	620	7546422
	CA*F3636*6D*+TXV	A*EC960603BNA*	17,800	12,800	14.5	11.5	500	7546458
	CA*F3636*6D*+TXV	A*EC960302BNA*	17,800	12,800	14.5	11.5	575	7546450
	CA*F3636*6D*+TXV	G*EC960302BNA*	17,800	12,800	14.5	11.5	575	7546434
	CA*F3636*6D*+TXV	G*VC960403BNA*	18,000	13,000	14.5	11.5	615	7546394
	CA*F3636*6D*+TXV	A*VC960603BNA*	18,000	13,000	14.5	11.5	625	7546410
	CA*F3636*6D*+TXV	G*VC80604B*B*	18,000	13,000	14.5	11.5	620	7546386
	CA*F3636*6D*+TXV	G*EC960603BNA*	17,800	12,800	14.5	11.5	500	7546442
	CA*F3636*6D*+TXV	A*VC960403BNA*	18,000	13,000	14.5	11.5	615	7546406
	CA*F3636*6D*+TXV	A*VM970804CNA*	18,000	13,000	14.5	11.5	620	7546430
	CA*F3636*6D*+TXV	G*VC960803BNA*	18,000	13,000	14.5	11.5	620	7546402
	CA*F3636*6D*+TXV	G*EC960402BNA*	17,800	12,800	14.5	11.5	575	7546438
	CA*F3636*6D*+TXV	G*VC960603BNA*	18,000	13,000	14.5	11.5	625	7546398
	CA*F3636*6D*+TXV	A*VM970603BNA*	18,000	13,000	14.5	11.5	625	7546426
	CA*F3636*6D*+TXV	A*VC960803BNA*	18,000	13,000	14.5	11.5	620	7546414
	CA*F3636*6D*+TXV	G*EC960803BNA*	17,800	12,800	14.5	11.5	540	7546446
	CA*F3636*6D*+TXV	A*VC80604B*B*	18,000	13,000	14.5	11.5	620	7546390
	CA*F3636*6D*+TXV	G*E80603B*B*	18,000	13,000	14.5	11.5	670	7546383
	CA*F3636*6D*+TXV	A*EC960402BNA*	17,800	12,800	14.5	11.5	575	7546454
	CA*F3743*6D*+EEP+TXV		18,000	13,000	14.5	11.5	600	7546375
	CAPT3743*4A*	A*VC80603B*B*	18,000	13,800	14.5	11.5	600	9948944
	CAPT3743*4A*	A*VC80803B*B*	18,000	13,800	14.5	11.5	600	9948948
	CAPT3743*4A*	A*VC80604B*B*	18,000	13,000	14.5	11.5	620	7546391
	CAPT3743*4A*	A*VM970603BNA*	18,000	13,000	14.5	11.5	625	7546427
	CAPT3743*4A*	G*VM970603BNA*	18,000	13,000	14.5	11.5	625	7546419
	CAPT3743*4A*	G*VC960603BNA*	18,000	13,000	14.5	11.5	625	7546399
	CAPT3743*4A*	A*VC960603BNA*	18,000	13,000	14.5	11.5	625	7546411
	CAPT3743*4A*	G*VC960803BNA*	18,000	13,000	14.5	11.5	620	7546403
	CAPT3743*4A*	A*VC960803BNA*	18,000	13,000	14.5	11.5	620	7546415
	CAPT3743*4A*	A*VC960403BNA*	18,000	13,000	14.5	11.5	615	7546407
	CAPT3743*4A*	A*EC960402BNA*	17,800	12,800	14.5	11.5	575	7546455
	CAPT3743*4A*	G*E80603B*B*	18,000	13,000	14.5	11.5	670	7546384
	CAPT3743*4A*	G*EC960603BNA*	17,800	12,800	14.5	11.5	500	7546443
CAPT3743*4A*	A*VM970804CNA*	18,000	13,000	14.5	11.5	620	7546431	

See Notes on Page 39.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0181K* (cont.)	CAPT3743*4A*	A*EC960603BNA*	17,800	12,800	14.5	11.5	500	7546459
	CAPT3743*4A*	A*EC960302BNA*	17,800	12,800	14.5	11.5	575	7546451
	CAPT3743*4A*	G*EC960803BNA*	17,800	12,800	14.5	11.5	540	7546447
	CAPT3743*4A*	G*VC80604B*B*	18,000	13,000	14.5	11.5	620	7546387
	CAPT3743*4A*	G*EC960302BNA*	17,800	12,800	14.5	11.5	575	7546435
	CAPT3743*4A*	G*VC960403BNA*	18,000	13,000	14.5	11.5	615	7546395
	CAPT3743*4A*	A*EC960803BNA*	17,800	12,800	14.5	11.5	540	7546463
	CAPT3743*4A*	G*EC960402BNA*	17,800	12,800	14.5	11.5	575	7546439
	CAPT3743*4A*	G*VM970804CNA*	18,000	13,000	14.5	11.5	620	7546423
	CAPT3743*4A*+EEP		17,800	12,800	14.0	11.5	550	7546376
	CAPT3743*4A*+MBVC1200**-1A*		17,400	12,500	14.5	12.0	535	7546377
	CHPF2430B6C*+EEP+TXV		17,800	12,800	14.0	11.5	600	7546378
	CHPF2430B6C*+MBVC1200**-1A*+TXV		17,800	12,800	14.5	11.5	600	7546379
	CHPF2430B6C*+TXV	A*EH800603B*A*	18,000	13,000	14.0	11.5	600	9060490
	CHPF2430B6C*+TXV	G*VC80604B*B*	18,000	13,000	14.5	11.5	620	7546388
	CHPF2430B6C*+TXV	A*VC80604B*B*	18,000	13,000	14.5	11.5	620	7546392
	CHPF3636B6C*+EEP+TXV		18,000	13,000	14.5	11.5	600	7546380
	CHPF3636B6C*+TXV	A*VC80603B*B*	18,000	13,800	14.5	11.5	600	9948945
	CHPF3636B6C*+TXV	A*VC80803B*B*	18,000	13,800	14.5	11.5	600	9948949
	CHPF3636B6C*+TXV	G*VM970804CNA*	18,000	13,000	14.5	11.5	620	7546424
	CHPF3636B6C*+TXV	G*EC960803BNA*	17,800	12,800	14.5	11.5	540	7546448
	CHPF3636B6C*+TXV	G*VC960803BNA*	18,000	13,000	14.5	11.5	620	7546404
	CHPF3636B6C*+TXV	G*EC960603BNA*	17,800	12,800	14.5	11.5	500	7546444
	CHPF3636B6C*+TXV	A*VM970603BNA*	18,000	13,000	14.5	11.5	625	7546428
	CHPF3636B6C*+TXV	G*VC960603BNA*	18,000	13,000	14.5	11.5	625	7546400
	CHPF3636B6C*+TXV	A*EC960803BNA*	17,800	12,800	14.5	11.5	540	7546464
	CHPF3636B6C*+TXV	A*EH800603B*A*	18,000	13,000	14.5	11.5	600	9060491
	CHPF3636B6C*+TXV	G*VM970603BNA*	18,000	13,000	14.5	11.5	625	7546420
	CHPF3636B6C*+TXV	A*VM970804CNA*	18,000	13,000	14.5	11.5	620	7546432
	CHPF3636B6C*+TXV	A*EC960302BNA*	17,800	12,800	14.5	11.5	575	7546452
	CHPF3636B6C*+TXV	A*VC960603BNA*	18,000	13,000	14.5	11.5	625	7546412
	CHPF3636B6C*+TXV	G*E80603B*B*	18,000	13,000	14.5	11.5	670	7546385
	CHPF3636B6C*+TXV	G*EC960302BNA*	17,800	12,800	14.5	11.5	575	7546436
	CHPF3636B6C*+TXV	A*EC960603BNA*	17,800	12,800	14.5	11.5	500	7546460
	CHPF3636B6C*+TXV	A*VC960803BNA*	18,000	13,000	14.5	11.5	620	7546416
	CHPF3636B6C*+TXV	G*VC960403BNA*	18,000	13,000	14.5	11.5	615	7546396
	CHPF3636B6C*+TXV	G*EC960402BNA*	17,800	12,800	14.5	11.5	575	7546440
	CHPF3636B6C*+TXV	A*EC960402BNA*	17,800	12,800	14.5	11.5	575	7546456
	CHPF3636B6C*+TXV	A*VC960403BNA*	18,000	13,000	14.5	11.5	615	7546408
	CSCF3036N6D*+EEP+TXV		17,800	12,800	14.0	11.5	600	7546381
	CSCF3036N6D*+TXV	A*VC80603B*B*	18,000	13,800	14.5	12.0	600	9948946
	CSCF3036N6D*+TXV	A*VC80803B*B*	18,000	13,800	14.5	12.0	600	9948950
	CSCF3036N6D*+TXV	A*VC960603BNA*	18,000	13,000	14.5	11.5	625	7546413
	CSCF3036N6D*+TXV	A*EC960803BNA*	17,800	12,800	14.5	11.5	540	7546465
	CSCF3036N6D*+TXV	G*VC80604B*B*	18,000	13,000	14.5	11.5	620	7546389
	CSCF3036N6D*+TXV	A*VM970804CNA*	18,000	13,000	14.5	11.5	620	7546433
	CSCF3036N6D*+TXV	A*EC960302BNA*	17,800	12,800	14.5	11.5	575	7546453
	CSCF3036N6D*+TXV	G*EC960603BNA*	17,800	12,800	14.5	11.5	500	7546445
CSCF3036N6D*+TXV	A*VM970603BNA*	18,000	13,000	14.5	11.5	625	7546429	
CSCF3036N6D*+TXV	A*VC80604B*B*	18,000	13,000	14.5	11.5	620	7546393	
CSCF3036N6D*+TXV	A*EC960603BNA*	17,800	12,800	14.5	11.5	500	7546461	
CSCF3036N6D*+TXV	A*EC960402BNA*	17,800	12,800	14.5	11.5	575	7546457	
CSCF3036N6D*+TXV	G*VC960403BNA*	18,000	13,000	14.5	11.5	615	7546397	

See Notes on Page 39.



OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0181K* (cont.)	CSCF3036N6D*+TXV	G*VC960803BNA*	18,000	13,000	14.5	11.5	620	7546405
	CSCF3036N6D*+TXV	G*EC960803BNA*	17,800	12,800	14.5	11.5	540	7546449
	CSCF3036N6D*+TXV	G*VM970804CNA*	18,000	13,000	14.5	11.5	620	7546425
	CSCF3036N6D*+TXV	G*VM970603BNA*	18,000	13,000	14.5	11.5	625	7546421
	CSCF3036N6D*+TXV	G*VC960603BNA*	18,000	13,000	14.5	11.5	625	7546401
	CSCF3036N6D*+TXV	G*EC960402BNA*	17,800	12,800	14.5	11.5	575	7546441
	CSCF3036N6D*+TXV	G*EC960302BNA*	17,800	12,800	14.5	11.5	575	7546437
	CSCF3036N6D*+TXV	A*VC960403BNA*	18,000	13,000	14.5	11.5	615	7546409
	CSCF3036N6D*+TXV	A*VC960803BNA*	18,000	13,000	14.5	11.5	620	7546417
	CSCF3642N6D*+EEP+TXV		18,000	13,000	14.5	11.5	600	7546382
ASX14 0191K*	ACNF25XX16A*		17,400	12,800	14.0	12.2	610	8740696
	ARUF25B14A*		17,800	13,100	14.0	12.2	570	7989009
	ASPT25B14A*		17,800	13,100	14.5	12.2	580	8245616
	ASPT29B14A*		18,000	13,300	15.0	12.5	560	8245617
	ASPT30C14A*		18,000	13,300	15.0	12.5	600	7546467
	AVPTC24B14A*		17,800	13,100	14.5	12.2	600	7546468
	AVPTC25B14A*		17,800	13,100	14.5	12.2	640	8996352
	AVPTC29B14A*		18,000	13,300	15.0	12.5	585	8996353
	AVPTC30C14A*		18,200	13,400	15.0	12.5	615	7546469
	AWUF19XX16A*		17,000	12,600	14.0	12.2	600	8390332
	AWUF31XX16A*		17,200	12,700	15.0	12.5	550	7546470
	AWUF32XX16A*		17,200	12,700	15.0	12.5	550	7546471
	CA*F3636*6D*+EEP+TXV		17,600	13,000	14.0	12.2	550	7546472
	CA*F3636*6D*+MBVC1200**-1A*+TXV		18,000	13,300	15.0	12.5	600	7546473
	CA*F3636*6D*+TXV	A*VC80603B*B*	17,800	13,500	15.0	12.5	550	9947394
	CA*F3636*6D*+TXV	A*VC80803B*B*	17,800	13,500	15.0	12.5	600	9947398
	CA*F3636*6D*+TXV	A*VC80604B*B*	17,800	13,100	15.0	12.5	620	7546487
	CA*F3636*6D*+TXV	A*VM970603BNA*	17,800	13,100	15.0	12.5	625	7546523
	CA*F3636*6D*+TXV	A*EC960803BNA*	17,800	13,100	15.0	12.5	540	7546559
	CA*F3636*6D*+TXV	A*VC960403BNA*	17,800	13,100	15.0	12.5	615	7546503
	CA*F3636*6D*+TXV	G*EC960803BNA*	17,800	13,100	15.0	12.5	540	7546543
	CA*F3636*6D*+TXV	A*VC960803BNA*	17,800	13,100	15.0	12.5	620	7546511
	CA*F3636*6D*+TXV	A*VM970804CNA*	17,800	13,100	15.0	12.5	620	7546527
	CA*F3636*6D*+TXV	A*EC960402BNA*	17,800	13,100	15.0	12.5	575	7546551
	CA*F3636*6D*+TXV	G*EC960402BNA*	17,800	13,100	15.0	12.5	575	7546535
	CA*F3636*6D*+TXV	G*VM970804CNA*	17,800	13,100	15.0	12.5	620	7546519
	CA*F3636*6D*+TXV	G*VC960803BNA*	17,800	13,100	15.0	12.5	620	7546499
	CA*F3636*6D*+TXV	G*EC960302BNA*	17,800	13,100	15.0	12.5	575	7546531
	CA*F3636*6D*+TXV	G*VM970603BNA*	17,800	13,100	15.0	12.5	625	7546515
	CA*F3636*6D*+TXV	A*EC960603BNA*	17,800	13,100	15.0	12.5	500	7546555
	CA*F3636*6D*+TXV	A*VC960603BNA*	17,800	13,100	15.0	12.5	625	7546507
	CA*F3636*6D*+TXV	G*VC80604B*B*	17,800	13,100	15.0	12.5	620	7546483
	CA*F3636*6D*+TXV	G*VC960603BNA*	17,800	13,100	15.0	12.5	625	7546495
	CA*F3636*6D*+TXV	A*EC960302BNA*	17,800	13,100	15.0	12.5	575	7546547
	CA*F3636*6D*+TXV	G*VC960403BNA*	17,800	13,100	15.0	12.5	615	7546491
	CA*F3636*6D*+TXV	G*E80603B*B*	17,800	13,100	15.0	12.5	600	7546480
	CA*F3636*6D*+TXV	G*EC960603BNA*	17,800	13,100	15.0	12.5	500	7546539
	CA*F3743*6D*+EEP+TXV		18,000	13,300	14.5	12.2	550	7546474
	CAPT3743*4A*	A*VC80603B*B*	17,800	13,500	15.0	12.5	550	9947395
	CAPT3743*4A*	A*VC80803B*B*	17,800	13,500	15.0	12.5	600	9947399
CAPT3743*4A*	G*VC960403BNA*	17,800	13,100	15.0	12.5	615	7546492	
CAPT3743*4A*	A*VC960803BNA*	17,800	13,100	15.0	12.5	620	7546512	
CAPT3743*4A*	G*VC960803BNA*	17,800	13,100	15.0	12.5	620	7546500	

See Notes on Page 39.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #	
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>			
ASX14 0191K* (cont.)	CAPT3743*4A*	A*EC960803BNA*	17,800	13,100	15.0	12.5	540	7546560	
	CAPT3743*4A*	A*EC960402BNA*	17,800	13,100	15.0	12.5	575	7546552	
	CAPT3743*4A*	A*VC960603BNA*	17,800	13,100	15.0	12.5	625	7546508	
	CAPT3743*4A*	G*EC960803BNA*	17,800	13,100	15.0	12.5	540	7546544	
	CAPT3743*4A*	A*EC960302BNA*	17,800	13,100	15.0	12.5	575	7546548	
	CAPT3743*4A*	A*EC960603BNA*	17,800	13,100	15.0	12.5	500	7546556	
	CAPT3743*4A*	G*VM970603BNA*	17,800	13,100	15.0	12.5	625	7546516	
	CAPT3743*4A*	G*VC960603BNA*	17,800	13,100	15.0	12.5	625	7546496	
	CAPT3743*4A*	G*EC960402BNA*	17,800	13,100	15.0	12.5	575	7546536	
	CAPT3743*4A*	A*VM970603BNA*	17,800	13,100	15.0	12.5	625	7546524	
	CAPT3743*4A*	A*VM970804CNA*	17,800	13,100	15.0	12.5	620	7546528	
	CAPT3743*4A*	G*EC960302BNA*	17,800	13,100	15.0	12.5	575	7546532	
	CAPT3743*4A*	G*VC80604B*B*	17,800	13,100	15.0	12.5	620	7546484	
	CAPT3743*4A*	A*VC960403BNA*	17,800	13,100	15.0	12.5	615	7546504	
	CAPT3743*4A*	A*VC80604B*B*	17,800	13,100	15.0	12.5	620	7546488	
	CAPT3743*4A*	G*EC960603BNA*	17,800	13,100	15.0	12.5	500	7546540	
	CAPT3743*4A*	G*E80603B*B*	17,800	13,100	15.0	12.5	600	7546481	
	CAPT3743*4A*	G*VM970804CNA*	17,800	13,100	15.0	12.5	620	7546520	
	CAPT3743*4A*+EEP			17,600	13,000	14.0	12.2	550	7546475
	CAPT3743*4A*+MBVC1200**-1A*			17,800	13,100	15.0	12.5	600	7546476
	CHPF3636B6C*+EEP+TXV			17,600	13,000	14.5	12.2	550	7546477
	CHPF3636B6C*+MBVC1200**-1A*+TXV			18,200	13,400	15.0	12.5	600	7546478
	CHPF3636B6C*+TXV	A*VC80603B*B*		17,800	13,500	15.0	12.5	550	9947396
	CHPF3636B6C*+TXV	A*VC80803B*B*		17,800	13,500	15.0	12.5	600	9947400
	CHPF3636B6C*+TXV	G*E80603B*B*		17,800	13,100	15.0	12.5	600	7546482
	CHPF3636B6C*+TXV	A*EC960803BNA*		17,800	13,100	15.0	12.5	540	7546561
	CHPF3636B6C*+TXV	A*EC960402BNA*		17,800	13,100	15.0	12.5	575	7546553
	CHPF3636B6C*+TXV	G*EC960803BNA*		17,800	13,100	15.0	12.5	540	7546545
	CHPF3636B6C*+TXV	A*VM970603BNA*		17,800	13,100	15.0	12.5	625	7546525
	CHPF3636B6C*+TXV	A*VC960803BNA*		17,800	13,100	15.0	12.5	620	7546513
	CHPF3636B6C*+TXV	A*VC960603BNA*		17,800	13,100	15.0	12.5	625	7546509
	CHPF3636B6C*+TXV	G*VM970603BNA*		17,800	13,100	15.0	12.5	625	7546517
	CHPF3636B6C*+TXV	A*EC960603BNA*		17,800	13,100	15.0	12.5	500	7546557
	CHPF3636B6C*+TXV	G*EC960402BNA*		17,800	13,100	15.0	12.5	575	7546537
	CHPF3636B6C*+TXV	G*EC960302BNA*		17,800	13,100	15.0	12.5	575	7546533
	CHPF3636B6C*+TXV	A*VC80604B*B*		17,800	13,100	15.0	12.5	620	7546489
	CHPF3636B6C*+TXV	G*VC960603BNA*		17,800	13,100	15.0	12.5	625	7546497
	CHPF3636B6C*+TXV	G*VM970804CNA*		17,800	13,100	15.0	12.5	620	7546521
	CHPF3636B6C*+TXV	G*EC960603BNA*		17,800	13,100	15.0	12.5	500	7546541
	CHPF3636B6C*+TXV	A*EC960302BNA*		17,800	13,100	15.0	12.5	575	7546549
	CHPF3636B6C*+TXV	G*VC960803BNA*		17,800	13,100	15.0	12.5	620	7546501
	CHPF3636B6C*+TXV	A*VC960403BNA*		17,800	13,100	15.0	12.5	615	7546505
	CHPF3636B6C*+TXV	G*VC80604B*B*		17,800	13,100	15.0	12.5	620	7546485
	CHPF3636B6C*+TXV	G*VC960403BNA*		17,800	13,100	15.0	12.5	615	7546493
	CHPF3636B6C*+TXV	A*VM970804CNA*		17,800	13,100	15.0	12.5	620	7546529
	CSCF3036N6D*+EEP+TXV			17,600	13,000	14.0	12.2	550	7546479
	CSCF3036N6D*+TXV	A*VC80603B*B*		17,800	13,500	15.0	12.5	550	9947397
	CSCF3036N6D*+TXV	A*VC80803B*B*		17,800	13,500	15.0	12.5	600	9947401
CSCF3036N6D*+TXV	A*VC80604B*B*		17,800	13,100	15.0	12.5	620	7546490	
CSCF3036N6D*+TXV	A*VC960603BNA*		17,800	13,100	15.0	12.5	625	7546510	
CSCF3036N6D*+TXV	G*VC80604B*B*		17,800	13,100	15.0	12.5	620	7546486	
CSCF3036N6D*+TXV	G*VC960803BNA*		17,800	13,100	15.0	12.5	620	7546502	
CSCF3036N6D*+TXV	A*VM970804CNA*		17,800	13,100	15.0	12.5	620	7546530	

See Notes on Page 39.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0191K* (cont.)	CSCF3036N6D*+TXV	G*VM970804CNA*	17,800	13,100	15.0	12.5	620	7546522
	CSCF3036N6D*+TXV	G*VC960603BNA*	17,800	13,100	15.0	12.5	625	7546498
	CSCF3036N6D*+TXV	A*VC960803BNA*	17,800	13,100	15.0	12.5	620	7546514
	CSCF3036N6D*+TXV	G*VC960403BNA*	17,800	13,100	15.0	12.5	615	7546494
	CSCF3036N6D*+TXV	A*VC960403BNA*	17,800	13,100	15.0	12.5	615	7546506
	CSCF3036N6D*+TXV	A*VM970603BNA*	17,800	13,100	15.0	12.5	625	7546526
	CSCF3036N6D*+TXV	G*VM970603BNA*	17,800	13,100	15.0	12.5	625	7546518
	CSCF3642N6D*+TXV	A*EC960803BNA*	17,800	13,100	15.0	12.5	540	7546562
	CSCF3642N6D*+TXV	A*EC960402BNA*	17,800	13,100	15.0	12.5	575	7546554
	CSCF3642N6D*+TXV	G*EC960603BNA*	17,800	13,100	15.0	12.5	500	7546542
	CSCF3642N6D*+TXV	A*EC960302BNA*	17,800	13,100	15.0	12.5	575	7546550
	CSCF3642N6D*+TXV	G*EC960302BNA*	17,800	13,100	15.0	12.5	575	7546534
	CSCF3642N6D*+TXV	G*EC960803BNA*	17,800	13,100	15.0	12.5	540	7546546
	CSCF3642N6D*+TXV	G*EC960402BNA*	17,800	13,100	15.0	12.5	575	7546538
	CSCF3642N6D*+TXV	A*EC960603BNA*	17,800	13,100	15.0	12.5	500	7546558
ASX14 0241L*	ACNF25XX16A*		22,800	16,700	14.0	11.7	710	8740699
	ARUF29B14A*		23,600	17,300	14.0	11.5	860	8712039
	ARUF31B14A*		23,600	17,300	14.0	11.5	870	8712040
	ASPT25B14A*		23,000	16,900	14.5	12.0	800	8712042
	ASPT29B14A*		23,600	17,300	15.0	12.0	790	8712043
	ASPT30C14A*		23,600	17,300	14.5	12.0	845	8712044
	AVPTC24B14A*		23,000	16,900	14.0	11.5	795	8712045
	AVPTC30C14A*		23,600	17,300	14.5	12.0	780	8712046
	AWUF25XX16A*		22,000	16,200	14.0	11.5	750	8712047
	AWUF31XX16A*		23,000	16,900	14.5	11.5	800	8712048
	AWUF32XX16A*		23,000	16,900	14.5	11.5	800	8712049
	CA*F3137*6A*	A*VC80603B*B*	23,600	17,800	14.5	11.5	750	9947402
	CA*F3137*6A*	A*VC80803B*B*	23,600	17,800	14.5	11.5	750	9947406
	CA*F3137*6A*+TXV	A*VC80603B*B*	23,600	17,800	15.0	12.2	750	9948951
	CA*F3137*6A*+TXV	A*VC80803B*B*	23,600	17,800	15.0	12.2	750	9948956
	CA*F3636*6D*	A*VC80603B*B*	23,600	17,800	14.5	11.5	750	9947403
	CA*F3636*6D*	A*VC80803B*B*	23,600	17,800	14.5	11.5	750	9947407
	CA*F3636*6D*	A*VC80804C*B*	23,600	17,800	14.5	11.5	800	9947410
	CA*F3636*6D*	A*VC80805D*B*	23,600	17,800	14.5	11.5	800	9947412
	CA*F3636*6D*	A*VM970804CNA*	23,600	17,300	14.5	11.5	810	8712062
	CA*F3636*6D*	G*VM970804CNA*	23,600	17,300	14.5	11.5	810	8712076
	CA*F3636*6D*	G*VC80604B*B*	23,600	17,300	14.5	11.5	750	8712068
	CA*F3636*6D*	G*VC80805C*B*	23,600	17,300	14.5	11.5	730	8712069
	CA*F3636*6D*	A*EC960402BNA*	23,400	17,200	14.5	11.5	775	8712051
	CA*F3636*6D*	G*VC960603BNA*	23,600	17,300	14.5	11.5	820	8712071
	CA*F3636*6D*	A*EC960603BNA*	23,400	17,200	14.5	11.5	725	8712052
	CA*F3636*6D*	A*VC960804CNA*	23,600	17,300	14.5	11.5	810	8712059
	CA*F3636*6D*	A*VC960803BNA*	23,600	17,300	14.5	11.5	820	8712058
	CA*F3636*6D*	G*VC960804CNA*	23,600	17,300	14.5	11.5	810	8712073
	CA*F3636*6D*	G*E80603B*B*	23,600	17,300	14.5	11.5	725	8712063
	CA*F3636*6D*	G*VM970603BNA*	23,600	17,300	14.5	11.5	820	8712074
	CA*F3636*6D*	G*VM970803BNA*	23,600	17,300	14.5	11.5	800	8712075
	CA*F3636*6D*	G*EC960302BNA*	23,400	17,200	14.5	11.5	750	8712064
	CA*F3636*6D*	G*EC960803BNA*	23,400	17,200	14.5	11.5	750	8712067
CA*F3636*6D*	A*VM970603BNA*	23,600	17,300	14.5	11.5	820	8712060	
CA*F3636*6D*	A*EC960302BNA*	23,400	17,200	14.5	11.5	750	8712050	
CA*F3636*6D*	G*EC960603BNA*	23,400	17,200	14.5	11.5	725	8712066	
CA*F3636*6D*	G*VC960403BNA*	23,600	17,300	14.5	11.5	805	8712070	

See Notes on Page 39.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0241L* (cont.)	CA*F3636*6D*	G*EC960402BNA*	23,400	17,200	14.5	11.5	775	8712065
	CA*F3636*6D*	A*VC960403BNA*	23,600	17,300	14.5	11.5	805	8712056
	CA*F3636*6D*	A*VC80604B*B*	23,600	17,300	14.5	11.5	750	8712054
	CA*F3636*6D*	A*VC80805C*B*	23,600	17,300	14.5	11.5	730	8712055
	CA*F3636*6D*	A*VM970803BNA*	23,600	17,300	14.5	11.5	800	8712061
	CA*F3636*6D*	A*EC960803BNA*	23,400	17,200	14.5	11.5	750	8712053
	CA*F3636*6D*	G*VC960803BNA*	23,600	17,300	14.5	11.5	820	8712072
	CA*F3636*6D*	A*VC960603BNA*	23,600	17,300	14.5	11.5	820	8712057
	CA*F3636*6D*+EEP		23,600	17,300	14.0	11.5	725	8712077
	CA*F3636*6D*+EEP+TXV		23,600	17,300	14.0	11.5	725	8712078
	CA*F3636*6D*+MBVC1200**-1A*		23,600	17,300	14.5	12.0	725	8712079
	CA*F3636*6D*+TXV	A*VC80603B*B*	23,600	17,800	14.5	11.5	750	9948952
	CA*F3636*6D*+TXV	A*VC80803B*B*	23,600	17,800	14.5	11.5	750	9948957
	CA*F3636*6D*+TXV	A*VC80804C*B*	23,600	17,800	14.5	11.5	800	9948961
	CA*F3636*6D*+TXV	A*VC80805D*B*	23,600	17,800	14.5	11.5	750	9948963
	CA*F3636*6D*+TXV	G*VC960403BNA*	23,600	17,300	14.5	11.5	805	8712100
	CA*F3636*6D*+TXV	G*EC960402BNA*	23,400	17,200	14.5	11.5	775	8712095
	CA*F3636*6D*+TXV	G*EC960302BNA*	23,400	17,200	14.5	11.5	750	8712094
	CA*F3636*6D*+TXV	G*VC960803BNA*	23,600	17,300	14.5	11.5	800	8712102
	CA*F3636*6D*+TXV	A*VM970804CNA*	23,600	17,300	14.5	11.5	810	8712092
	CA*F3636*6D*+TXV	G*E80603B*B*	23,600	17,300	14.5	11.5	725	8712093
	CA*F3636*6D*+TXV	G*VC960804CNA*	23,600	17,300	14.5	11.5	810	8712103
	CA*F3636*6D*+TXV	A*VM970603BNA*	23,600	17,300	14.5	11.5	820	8712090
	CA*F3636*6D*+TXV	G*VM970804CNA*	23,600	17,300	14.5	11.5	810	8712106
	CA*F3636*6D*+TXV	G*VC80805C*B*	23,600	17,300	14.5	11.5	730	8712099
	CA*F3636*6D*+TXV	G*EC960803BNA*	23,400	17,200	14.5	11.5	750	8712097
	CA*F3636*6D*+TXV	A*VC80604B*B*	23,600	17,300	14.5	11.5	750	8712084
	CA*F3636*6D*+TXV	A*VC960603BNA*	23,600	17,300	14.5	11.5	820	8712087
	CA*F3636*6D*+TXV	A*EC960603BNA*	23,400	17,200	14.5	11.5	725	8712082
	CA*F3636*6D*+TXV	G*VM970803BNA*	23,600	17,300	14.5	11.5	800	8712105
	CA*F3636*6D*+TXV	A*VC80805C*B*	23,600	17,300	14.5	11.5	730	8712085
	CA*F3636*6D*+TXV	A*EC960803BNA*	23,400	17,200	14.5	11.5	750	8712083
	CA*F3636*6D*+TXV	A*VC960803BNA*	23,600	17,300	14.5	11.5	800	8712088
	CA*F3636*6D*+TXV	A*VM970803BNA*	23,600	17,300	14.5	11.5	800	8712091
	CA*F3636*6D*+TXV	G*VC960603BNA*	23,600	17,300	14.5	11.5	820	8712101
	CA*F3636*6D*+TXV	A*EC960302BNA*	23,400	17,200	14.5	11.5	750	8712080
	CA*F3636*6D*+TXV	G*VM970603BNA*	23,600	17,300	14.5	11.5	820	8712104
	CA*F3636*6D*+TXV	A*EC960402BNA*	23,400	17,200	14.5	11.5	775	8712081
	CA*F3636*6D*+TXV	G*VC80604B*B*	23,600	17,300	14.5	11.5	750	8712098
	CA*F3636*6D*+TXV	G*EC960603BNA*	23,400	17,200	14.5	11.5	725	8712096
	CA*F3636*6D*+TXV	A*VC960403BNA*	23,600	17,300	14.5	11.5	805	8712086
	CA*F3636*6D*+TXV	A*VC960804CNA*	23,600	17,300	14.5	11.5	810	8712089
	CA*F3642*6D*+EEP		23,600	17,300	14.0	11.5	725	8712107
	CA*F3743*6D*+EEP		23,600	17,300	14.0	11.5	725	8712108
	CA*F3743*6D*+EEP+TXV		23,600	17,300	14.5	12.0	725	8712109
	CAPT3743*4A*	A*VC80603B*B*	23,600	17,800	14.5	11.5	750	9948953
	CAPT3743*4A*	A*VC80803B*B*	23,600	17,800	14.5	11.5	750	9948958
	CAPT3743*4A*	A*VC80604B*B*	23,600	17,300	14.5	11.5	750	8712114
	CAPT3743*4A*	A*VC80805C*B*	23,600	17,300	14.5	11.5	730	8712115
	CAPT3743*4A*	A*VM970804CNA*	23,600	17,300	14.5	11.5	810	8712122
CAPT3743*4A*	G*VC80805C*B*	23,600	17,300	14.5	11.5	730	8712129	
CAPT3743*4A*	A*EC960402BNA*	23,400	17,200	14.5	11.5	775	8712111	
CAPT3743*4A*	A*VM970803BNA*	23,400	17,200	14.5	11.5	800	8712121	

See Notes on Page 39.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0241L* (cont.)	CAPT3743*4A*	A*VC960603BNA*	23,400	17,200	14.5	11.5	820	8712117
	CAPT3743*4A*	G*VC960403BNA*	23,400	17,200	14.5	11.5	805	8712130
	CAPT3743*4A*	A*VC960803BNA*	23,400	17,200	14.5	11.5	800	8712118
	CAPT3743*4A*	G*VC960603BNA*	23,400	17,200	14.5	11.5	820	8712131
	CAPT3743*4A*	G*EC960302BNA*	23,400	17,200	14.5	11.5	750	8712124
	CAPT3743*4A*	G*EC960603BNA*	23,400	17,200	14.5	11.5	725	8712126
	CAPT3743*4A*	G*VC960804CNA*	23,600	17,300	14.5	11.5	810	8712133
	CAPT3743*4A*	G*VM970603BNA*	23,400	17,200	14.5	11.5	820	8712134
	CAPT3743*4A*	G*VC960803BNA*	23,400	17,200	14.5	11.5	800	8712132
	CAPT3743*4A*	A*VM970603BNA*	23,400	17,200	14.5	11.5	820	8712120
	CAPT3743*4A*	A*VC960804CNA*	23,600	17,300	14.5	11.5	810	8712119
	CAPT3743*4A*	G*VC80604B*B*	23,600	17,300	14.5	11.5	750	8712128
	CAPT3743*4A*	G*EC960803BNA*	23,400	17,200	14.5	11.5	750	8712127
	CAPT3743*4A*	A*VC960403BNA*	23,400	17,200	14.5	11.5	805	8712116
	CAPT3743*4A*	G*VM970804CNA*	23,600	17,300	14.5	11.5	810	8712136
	CAPT3743*4A*	G*VM970803BNA*	23,400	17,200	14.5	11.5	800	8712135
	CAPT3743*4A*	A*EC960603BNA*	23,400	17,200	14.5	11.5	725	8712112
	CAPT3743*4A*	G*EC960402BNA*	23,400	17,200	14.5	11.5	775	8712125
	CAPT3743*4A*	A*EC960803BNA*	23,400	17,200	14.5	11.5	750	8712113
	CAPT3743*4A*	G*E80603B*B*	23,600	17,300	14.5	11.5	725	8712123
	CAPT3743*4A*	A*EC960302BNA*	23,400	17,200	14.5	11.5	750	8712110
	CAPT3743*4A*+EHP		23,000	16,900	14.0	11.5	725	8712137
	CAPT3743*4A*+MBVC1200**-1A*		23,600	17,300	14.5	12.0	760	8712138
	CHPF2430B6C*+TXV	A*EH800603B*A*	23,000	16,900	14.0	11.5	725	9060492
	CHPF3636B6C*	A*VC80603B*B*	23,600	17,800	14.5	11.5	750	9947404
	CHPF3636B6C*	A*VC80803B*B*	23,600	17,800	14.5	11.5	750	9947408
	CHPF3636B6C*	G*VC960803BNA*	23,600	17,300	14.5	11.5	800	8712157
	CHPF3636B6C*	A*VC960803BNA*	23,600	17,300	14.5	11.5	800	8712146
	CHPF3636B6C*	G*VM970803BNA*	23,600	17,300	14.5	11.5	800	8712159
	CHPF3636B6C*	A*EC960603BNA*	23,400	17,200	14.5	11.5	725	8712141
	CHPF3636B6C*	A*EC960302BNA*	23,400	17,200	14.5	11.5	750	8712139
	CHPF3636B6C*	G*VC80604B*B*	23,600	17,300	14.5	11.5	750	8712154
	CHPF3636B6C*	A*VM970803BNA*	23,600	17,300	14.5	11.5	800	8712148
	CHPF3636B6C*	G*VC960403BNA*	23,600	17,300	14.5	11.5	805	8712155
	CHPF3636B6C*	A*VC960403BNA*	23,600	17,300	14.5	11.5	805	8712144
	CHPF3636B6C*	A*VC80604B*B*	23,600	17,300	14.5	11.5	750	8712143
	CHPF3636B6C*	G*VM970603BNA*	23,600	17,300	14.5	11.5	820	8712158
	CHPF3636B6C*	A*EC960803BNA*	23,400	17,200	14.5	11.5	750	8712142
	CHPF3636B6C*	G*EC960803BNA*	23,400	17,200	14.5	11.5	750	8712153
	CHPF3636B6C*	G*E80603B*B*	23,600	17,300	14.5	11.5	725	8712149
	CHPF3636B6C*	G*EC960302BNA*	23,400	17,200	14.5	11.5	750	8712150
	CHPF3636B6C*	A*VM970603BNA*	23,600	17,300	14.5	11.5	820	8712147
	CHPF3636B6C*	G*EC960603BNA*	23,400	17,200	14.5	11.5	725	8712152
	CHPF3636B6C*	A*EC960402BNA*	23,400	17,200	14.5	11.5	775	8712140
	CHPF3636B6C*	G*VC960603BNA*	23,600	17,300	14.5	11.5	820	8712156
	CHPF3636B6C*	A*VC960603BNA*	23,600	17,300	14.5	11.5	820	8712145
	CHPF3636B6C*	G*EC960402BNA*	23,400	17,200	14.5	11.5	775	8712151
CHPF3636B6C*+EHP		23,600	17,300	14.0	11.5	725	8712160	
CHPF3636B6C*+EHP+TXV		23,600	17,300	14.5	11.5	725	8712161	
CHPF3636B6C*+MBVC1200**-1A*		23,600	17,300	14.5	12.0	725	8712162	
CHPF3636B6C*+TXV	A*VC80603B*B*	23,600	17,800	14.5	11.5	750	9948954	
CHPF3636B6C*+TXV	A*VC80803B*B*	23,600	17,800	14.5	11.5	750	9948959	
CHPF3636B6C*+TXV	G*VM970603BNA*	23,600	17,300	14.5	11.5	820	8712182	

See Notes on Page 39.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0241L* (cont.)	CHPF3636B6C*+TXV	A*VM970803BNA*	23,600	17,300	14.5	11.5	800	8712172
	CHPF3636B6C*+TXV	A*VC960603BNA*	23,600	17,300	14.5	11.5	820	8712169
	CHPF3636B6C*+TXV	G*VC960803BNA*	23,600	17,300	14.5	11.5	800	8712181
	CHPF3636B6C*+TXV	G*EC960803BNA*	23,400	17,200	14.5	11.5	750	8712177
	CHPF3636B6C*+TXV	A*EC960302BNA*	23,400	17,200	14.5	11.5	750	8712163
	CHPF3636B6C*+TXV	A*VM970603BNA*	23,600	17,300	14.5	11.5	820	8712171
	CHPF3636B6C*+TXV	G*VC80604B*B*	23,600	17,300	14.5	11.5	750	8712178
	CHPF3636B6C*+TXV	A*EC960803BNA*	23,400	17,200	14.5	11.5	750	8712166
	CHPF3636B6C*+TXV	A*EC960402BNA*	23,400	17,200	14.5	11.5	775	8712164
	CHPF3636B6C*+TXV	A*VC80604B*B*	23,600	17,300	14.5	11.5	750	8712167
	CHPF3636B6C*+TXV	A*EC960603BNA*	23,400	17,200	14.5	11.5	725	8712165
	CHPF3636B6C*+TXV	G*EC960302BNA*	23,400	17,200	14.5	11.5	750	8712174
	CHPF3636B6C*+TXV	G*EC960603BNA*	23,400	17,200	14.5	11.5	725	8712176
	CHPF3636B6C*+TXV	G*E80603B*B*	23,600	17,300	14.5	11.5	725	8712173
	CHPF3636B6C*+TXV	A*VC960403BNA*	23,600	17,300	14.5	11.5	805	8712168
	CHPF3636B6C*+TXV	A*EH800603B*A*	23,600	17,300	14.5	11.5	725	9060493
	CHPF3636B6C*+TXV	G*VC960403BNA*	23,600	17,300	14.5	11.5	805	8712179
	CHPF3636B6C*+TXV	G*EC960402BNA*	23,400	17,200	14.5	11.5	775	8712175
	CHPF3636B6C*+TXV	G*VM970803BNA*	23,600	17,300	14.5	11.5	800	8712183
	CHPF3636B6C*+TXV	G*VC960603BNA*	23,600	17,300	14.5	11.5	820	8712180
	CHPF3636B6C*+TXV	A*VC960803BNA*	23,600	17,300	14.5	11.5	800	8712170
	CHPF3642C6C*	G*VC80805C*B*	23,600	17,300	14.5	11.5	730	8712187
	CHPF3642C6C*	G*VC960804CNA*	23,600	17,300	14.5	11.5	810	8712188
	CHPF3642C6C*	A*VM970804CNA*	23,600	17,300	14.5	11.5	810	8712186
	CHPF3642C6C*	G*VM970804CNA*	23,600	17,300	14.5	11.5	810	8712189
	CHPF3642C6C*	A*VC80805C*B*	23,600	17,300	14.5	11.5	730	8712184
	CHPF3642C6C*	A*VC960804CNA*	23,600	17,300	14.5	11.5	810	8712185
	CHPF3642C6C*+EEP		23,600	17,300	14.0	11.5	725	8712190
	CHPF3642C6C*+EEP+TXV		23,600	17,300	14.5	11.5	725	8712191
	CHPF3642C6C*+TXV	A*VC80805C*B*	23,600	17,300	14.5	11.5	730	8712192
	CHPF3642C6C*+TXV	G*VC960804CNA*	23,600	17,300	14.5	11.5	810	8712196
	CHPF3642C6C*+TXV	G*VM970804CNA*	23,600	17,300	14.5	11.5	810	8712197
	CHPF3642C6C*+TXV	A*VC960804CNA*	23,600	17,300	14.5	11.5	810	8712193
	CHPF3642C6C*+TXV	A*VM970804CNA*	23,600	17,300	14.5	11.5	810	8712194
	CHPF3642C6C*+TXV	G*VC80805C*B*	23,600	17,300	14.5	11.5	730	8712195
	CSCF3036N6D*	A*VC80603B*B*	23,000	17,400	14.5	11.5	750	9947405
	CSCF3036N6D*	A*VC80803B*B*	23,000	17,400	14.5	11.5	750	9947409
	CSCF3036N6D*	A*VC80804C*B*	23,600	17,800	14.5	11.5	800	9947411
	CSCF3036N6D*	A*VC80805D*B*	23,600	17,800	14.5	11.5	750	9947413
	CSCF3036N6D*	G*VM970804CNA*	23,600	17,300	14.5	11.5	810	8712223
	CSCF3036N6D*	G*EC960402BNA*	23,400	17,200	14.5	11.5	775	8712212
	CSCF3036N6D*	A*EC960402BNA*	23,400	17,200	14.5	11.5	775	8712199
CSCF3036N6D*	G*EC960603BNA*	23,400	17,200	14.5	11.5	725	8712213	
CSCF3036N6D*	A*VC960804CNA*	23,600	17,300	14.5	11.5	810	8712207	
CSCF3036N6D*	G*VC80604B*B*	23,600	17,300	14.5	11.5	750	8712215	
CSCF3036N6D*	G*VM970803BNA*	23,600	17,300	14.5	11.5	800	8712222	
CSCF3036N6D*	A*VM970603BNA*	23,600	17,300	14.5	11.5	820	8712208	
CSCF3036N6D*	G*VM970603BNA*	23,600	17,300	14.5	11.5	820	8712221	
CSCF3036N6D*	A*VC960403BNA*	23,600	17,300	14.5	11.5	805	8712204	
CSCF3036N6D*	A*VM970803BNA*	23,600	17,300	14.5	11.5	800	8712209	
CSCF3036N6D*	A*VM970804CNA*	23,600	17,300	14.5	11.5	810	8712210	
CSCF3036N6D*	G*EC960803BNA*	23,400	17,200	14.5	11.5	750	8712214	
CSCF3036N6D*	A*VC80805C*B*	23,600	17,300	14.5	11.5	730	8712203	

See Notes on Page 39.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 O241L* (cont.)	CSCF3036N6D*	G*VC960603BNA*	23,600	17,300	14.5	11.5	820	8712218
	CSCF3036N6D*	A*VC960603BNA*	23,600	17,300	14.5	11.5	820	8712205
	CSCF3036N6D*	A*EC960803BNA*	23,400	17,200	14.5	11.5	750	8712201
	CSCF3036N6D*	G*VC960803BNA*	23,600	17,300	14.5	11.5	800	8712219
	CSCF3036N6D*	A*EC960603BNA*	23,400	17,200	14.5	11.5	725	8712200
	CSCF3036N6D*	G*EC960302BNA*	23,400	17,200	14.5	11.5	750	8712211
	CSCF3036N6D*	A*VC960803BNA*	23,600	17,300	14.5	11.5	800	8712206
	CSCF3036N6D*	A*EC960302BNA*	23,400	17,200	14.5	11.5	750	8712198
	CSCF3036N6D*	G*VC960804CNA*	23,600	17,300	14.5	11.5	810	8712220
	CSCF3036N6D*	G*VC960403BNA*	23,600	17,300	14.5	11.5	805	8712217
	CSCF3036N6D*	G*VC80805C*B*	23,600	17,300	14.5	11.5	730	8712216
	CSCF3036N6D*	A*VC80604B*B*	23,600	17,300	14.5	11.5	750	8712202
	CSCF3036N6D*+EEP		23,600	17,300	14.0	11.5	800	8712224
	CSCF3036N6D*+EEP+TXV		23,600	17,300	14.0	11.5	800	8712225
	CSCF3036N6D*+TXV	A*VC80603B*B*	23,600	17,800	14.5	11.5	750	9948955
	CSCF3036N6D*+TXV	A*VC80803B*B*	23,600	17,800	14.5	11.5	750	9948960
	CSCF3036N6D*+TXV	A*VC80804C*B*	23,600	17,800	14.5	11.5	800	9948962
	CSCF3036N6D*+TXV	A*VC80805D*B*	23,600	17,800	14.5	11.5	750	9948964
	CSCF3036N6D*+TXV	G*VM970803BNA*	23,600	17,300	14.5	11.5	800	8712250
	CSCF3036N6D*+TXV	G*EC960302BNA*	23,400	17,200	14.5	11.5	750	8712239
	CSCF3036N6D*+TXV	G*VC80805C*B*	23,600	17,300	14.5	11.5	730	8712244
	CSCF3036N6D*+TXV	G*VC960804CNA*	23,600	17,300	14.5	11.5	810	8712248
	CSCF3036N6D*+TXV	A*EC960402BNA*	23,400	17,200	14.5	11.5	775	8712227
	CSCF3036N6D*+TXV	A*VC960804CNA*	23,600	17,300	14.5	11.5	810	8712235
	CSCF3036N6D*+TXV	G*EC960603BNA*	23,400	17,200	14.5	11.5	725	8712241
	CSCF3036N6D*+TXV	G*VC960403BNA*	23,600	17,300	14.5	11.5	805	8712245
	CSCF3036N6D*+TXV	A*VM970804CNA*	23,600	17,300	14.5	11.5	810	8712238
	CSCF3036N6D*+TXV	A*VC960603BNA*	23,600	17,300	14.5	11.5	820	8712233
	CSCF3036N6D*+TXV	A*VM970603BNA*	23,600	17,300	14.5	11.5	820	8712236
	CSCF3036N6D*+TXV	G*VC960803BNA*	23,600	17,300	14.5	11.5	800	8712247
	CSCF3036N6D*+TXV	G*VC960603BNA*	23,600	17,300	14.5	11.5	820	8712246
	CSCF3036N6D*+TXV	G*VC80604B*B*	23,600	17,300	14.5	11.5	750	8712243
	CSCF3036N6D*+TXV	A*VC960803BNA*	23,600	17,300	14.5	11.5	800	8712234
	CSCF3036N6D*+TXV	G*EC960402BNA*	23,400	17,200	14.5	11.5	775	8712240
	CSCF3036N6D*+TXV	A*VC80604B*B*	23,600	17,300	14.5	11.5	750	8712230
	CSCF3036N6D*+TXV	A*VC80805C*B*	23,600	17,300	14.5	11.5	730	8712231
	CSCF3036N6D*+TXV	A*EC960302BNA*	23,400	17,200	14.5	11.5	750	8712226
	CSCF3036N6D*+TXV	A*VC960403BNA*	23,600	17,300	14.5	11.5	805	8712232
	CSCF3036N6D*+TXV	G*EC960803BNA*	23,400	17,200	14.5	11.5	750	8712242
	CSCF3036N6D*+TXV	G*VM970603BNA*	23,600	17,300	14.5	11.5	820	8712249
	CSCF3036N6D*+TXV	G*VM970804CNA*	23,600	17,300	14.5	11.5	810	8712251
	CSCF3036N6D*+TXV	A*EC960803BNA*	23,400	17,200	14.5	11.5	750	8712229
CSCF3036N6D*+TXV	A*VM970803BNA*	23,600	17,300	14.5	11.5	800	8712237	
CSCF3036N6D*+TXV	A*EC960603BNA*	23,400	17,200	14.5	11.5	725	8712228	
CSCF3642N6D*+EEP		23,600	17,300	14.0	11.5	725	8712252	
CSCF3642N6D*+EEP+TXV		23,600	17,300	14.0	11.5	725	8712253	

<sup>1</sup> BTU/h

<sup>2</sup> Seasonal Energy Efficiency Ratio; Certified per AHRI 210/240 @ 80°F/ 67°F/ 95°F

<sup>3</sup> Energy Efficiency Ratio @ 80°F/ 67°F/ 95°F

**NOTES**

- Always check the S&R plate for electrical data on the unit being installed.
- When matching the outdoor unit to the indoor unit, use the piston supplied with the outdoor unit or that specified on the piston kit chart supplied with the indoor unit.
- EEP - Order from Service Dept. Part No. B13707-38 or new Solid State Board B13707-35S. Part No. B13707-38 is not interchangeable with B13707-35S. The Amana brand Gas Furnace contains the EEP cooling time delay.
- HSK - Hard Start Kit: This is an additional capacitor to assist with compressor start-up, used with the standard "run" capacitor that is supplied in the unit. Order from an Amana® brand distributor or service department.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0251L*	ACNF25XX16A*		22,800	16,400	14.0	12.2	710	8740702
	ARUF29B14A*		23,600	16,900	14.0	12.2	860	8714959
	ARUF31B14A*		23,600	16,900	14.0	12.2	870	8714960
	ASPT25B14A*		23,600	16,900	14.5	12.2	800	8714962
	ASPT29B14A*		24,000	17,200	15.0	12.5	790	8714963
	ASPT30C14A*		23,600	16,900	15.0	12.5	845	8714964
	AVPTC24B14A*		23,000	16,500	14.0	12.2	795	8714965
	AVPTC25B14A*		23,200	16,600	14.5	12.2	850	8996354
	AVPTC29B14A*		23,800	17,100	15.0	12.5	795	8996355
	AVPTC30C14A*		23,600	16,900	15.0	12.5	780	8714966
	AWUF25XX16A*		22,000	15,800	14.0	12.2	750	8714967
	AWUF31XX16A*		23,000	16,500	14.5	12.2	800	8714968
	AWUF32XX16A*		23,000	16,500	14.5	12.2	800	8714969
	CA*F3636*6D*	A*VC80603B*B*	23,600	17,400	15.0	12.5	750	9947414
	CA*F3636*6D*	A*VC80803B*B*	23,600	17,400	15.0	12.5	750	9947419
	CA*F3636*6D*	A*VC80804C*B*	23,600	17,400	15.0	12.5	800	9947424
	CA*F3636*6D*	A*VC80805D*B*	23,600	17,400	15.0	12.5	800	9947429
	CA*F3636*6D*	G*VM970603BNA*	23,600	16,900	15.0	12.5	820	8714994
	CA*F3636*6D*	G*VC960603BNA*	23,600	16,900	15.0	12.5	820	8714991
	CA*F3636*6D*	G*VC80604B*B*	23,600	16,900	15.0	12.5	750	8714988
	CA*F3636*6D*	G*VC960804CNA*	23,600	16,900	15.0	12.5	810	8714993
	CA*F3636*6D*	A*VC960804CNA*	23,600	16,900	15.0	12.5	810	8714979
	CA*F3636*6D*	A*VM970804CNA*	23,600	16,900	15.0	12.5	810	8714982
	CA*F3636*6D*	G*VM970804CNA*	23,600	16,900	15.0	12.5	810	8714996
	CA*F3636*6D*	A*VC960803BNA*	23,600	16,900	15.0	12.5	820	8714978
	CA*F3636*6D*	A*EC960302BNA*	23,400	16,800	14.5	12.2	750	8714970
	CA*F3636*6D*	G*VC960403BNA*	23,600	16,900	15.0	12.5	805	8714990
	CA*F3636*6D*	A*EC960603BNA*	23,400	16,800	14.5	12.2	775	8714972
	CA*F3636*6D*	A*VC80805C*B*	23,600	16,900	15.0	12.5	725	8714975
	CA*F3636*6D*	A*VC80604B*B*	23,600	16,900	15.0	12.5	750	8714974
	CA*F3636*6D*	A*VC960403BNA*	23,600	16,900	15.0	12.5	805	8714976
	CA*F3636*6D*	A*VC960603BNA*	23,600	16,900	15.0	12.5	820	8714977
	CA*F3636*6D*	G*EC960402BNA*	23,400	16,800	14.5	12.2	775	8714985
	CA*F3636*6D*	G*VC960803BNA*	23,600	16,900	15.0	12.5	820	8714992
	CA*F3636*6D*	G*EC960803BNA*	23,400	16,800	14.5	12.2	750	8714987
	CA*F3636*6D*	G*VC80805C*B*	23,600	16,900	15.0	12.5	725	8714989
	CA*F3636*6D*	G*VM970803BNA*	23,600	16,900	15.0	12.5	800	8714995
	CA*F3636*6D*	G*EC960302BNA*	23,400	16,800	14.5	12.2	750	8714984
	CA*F3636*6D*	A*EC960402BNA*	23,400	16,800	14.5	12.2	775	8714971
	CA*F3636*6D*	A*VM970603BNA*	23,600	16,900	15.0	12.5	820	8714980
	CA*F3636*6D*	G*EC960603BNA*	23,400	16,800	14.5	12.2	775	8714986
	CA*F3636*6D*	A*VM970803BNA*	23,600	16,900	15.0	12.5	800	8714981
	CA*F3636*6D*	A*EC960803BNA*	23,400	16,800	14.5	12.2	750	8714973
	CA*F3636*6D*	G*E80603B*B*	23,600	16,900	15.0	12.5	725	8714983
	CA*F3636*6D*+EEP		23,600	16,900	14.0	12.2	725	8714997
	CA*F3636*6D*+EEP+TXV		23,600	16,900	14.0	12.2	725	8714998
	CA*F3636*6D*+MBVC1200**-1A*		23,600	16,900	15.0	12.5	775	8714999
	CA*F3636*6D*+TXV	A*VC80603B*B*	23,600	17,400	15.0	12.5	750	9947415
	CA*F3636*6D*+TXV	A*VC80803B*B*	23,600	17,400	15.0	12.5	750	9947420
	CA*F3636*6D*+TXV	A*VC80804C*B*	23,600	17,400	15.0	12.5	800	9947425
CA*F3636*6D*+TXV	A*VC80805D*B*	23,600	17,400	15.0	12.5	800	9947430	
CA*F3636*6D*+TXV	G*VC960403BNA*	23,600	16,900	15.0	12.5	805	8715020	
CA*F3636*6D*+TXV	G*EC960302BNA*	23,400	16,800	15.0	12.5	750	8715014	

See Notes on Page 39.



OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0251L* (cont.)	CA*F3636*6D*+TXV	G*VC960603BNA*	23,600	16,900	15.0	12.5	820	8715021
	CA*F3636*6D*+TXV	A*EC960402BNA*	23,400	16,800	15.0	12.5	775	8715001
	CA*F3636*6D*+TXV	A*EC960603BNA*	23,400	16,800	15.0	12.5	775	8715002
	CA*F3636*6D*+TXV	A*VC80805C*B*	23,600	16,900	15.0	12.5	725	8715005
	CA*F3636*6D*+TXV	G*VC80604B*B*	23,600	16,900	15.0	12.5	750	8715018
	CA*F3636*6D*+TXV	G*EC960803BNA*	23,400	16,800	15.0	12.5	750	8715017
	CA*F3636*6D*+TXV	G*E80603B*B*	23,600	16,900	15.0	12.5	725	8715013
	CA*F3636*6D*+TXV	G*EC960603BNA*	23,400	16,800	15.0	12.5	775	8715016
	CA*F3636*6D*+TXV	G*VM970803BNA*	23,600	16,900	15.0	12.5	800	8715025
	CA*F3636*6D*+TXV	G*VM970804CNA*	23,600	16,900	15.0	12.5	810	8715026
	CA*F3636*6D*+TXV	G*VC960804CNA*	23,600	16,900	15.0	12.5	810	8715023
	CA*F3636*6D*+TXV	G*VC960803BNA*	23,600	16,900	15.0	12.5	800	8715022
	CA*F3636*6D*+TXV	A*EC960302BNA*	23,400	16,800	15.0	12.5	750	8715000
	CA*F3636*6D*+TXV	A*VM970803BNA*	23,600	16,900	15.0	12.5	800	8715011
	CA*F3636*6D*+TXV	A*VC960804CNA*	23,600	16,900	15.0	12.5	810	8715009
	CA*F3636*6D*+TXV	A*VM970804CNA*	23,600	16,900	15.0	12.5	810	8715012
	CA*F3636*6D*+TXV	A*VC960803BNA*	23,600	16,900	15.0	12.5	800	8715008
	CA*F3636*6D*+TXV	A*VC960603BNA*	23,600	16,900	15.0	12.5	820	8715007
	CA*F3636*6D*+TXV	G*VM970603BNA*	23,600	16,900	15.0	12.5	820	8715024
	CA*F3636*6D*+TXV	G*EC960402BNA*	23,400	16,800	15.0	12.5	775	8715015
	CA*F3636*6D*+TXV	A*EC960803BNA*	23,400	16,800	15.0	12.5	750	8715003
	CA*F3636*6D*+TXV	A*VM970603BNA*	23,600	16,900	15.0	12.5	820	8715010
	CA*F3636*6D*+TXV	G*VC80805C*B*	23,600	16,900	15.0	12.5	725	8715019
	CA*F3636*6D*+TXV	A*VC960403BNA*	23,600	16,900	15.0	12.5	805	8715006
	CA*F3636*6D*+TXV	A*VC80604B*B*	23,600	16,900	15.0	12.5	750	8715004
	CA*F3743*6D*+EHP		23,800	17,100	14.0	12.2	725	8715027
	CA*F3743*6D*+EHP+TXV		23,800	17,100	14.5	12.2	725	8715028
	CAPT3743*4A*	A*VC80603B*B*	23,600	17,400	15.0	12.5	750	9947416
	CAPT3743*4A*	A*VC80803B*B*	23,600	17,400	15.0	12.5	750	9947421
	CAPT3743*4A*	A*VC80804C*B*	23,600	17,400	15.0	12.5	800	9947426
	CAPT3743*4A*	A*VC80805D*B*	23,600	17,400	15.0	12.5	800	9947431
	CAPT3743*4A*	G*VM970803BNA*	23,400	16,800	15.0	12.5	800	8715054
	CAPT3743*4A*	A*EC960803BNA*	23,400	16,800	14.5	12.2	750	8715032
	CAPT3743*4A*	G*EC960302BNA*	23,400	16,800	14.5	12.2	750	8715043
	CAPT3743*4A*	G*VM970804CNA*	23,600	16,900	15.0	12.5	810	8715055
	CAPT3743*4A*	A*EC960402BNA*	23,400	16,800	14.5	12.2	775	8715030
	CAPT3743*4A*	G*VC960804CNA*	23,600	16,900	15.0	12.5	810	8715052
	CAPT3743*4A*	A*VC960403BNA*	23,400	16,800	15.0	12.5	805	8715035
	CAPT3743*4A*	A*VM970804CNA*	23,600	16,900	15.0	12.5	810	8715041
	CAPT3743*4A*	G*VC80805C*B*	23,600	16,900	15.0	12.5	725	8715048
	CAPT3743*4A*	A*VC960603BNA*	23,400	16,800	15.0	12.5	820	8715036
	CAPT3743*4A*	A*EC960302BNA*	23,400	16,800	14.5	12.2	750	8715029
	CAPT3743*4A*	A*VC80604B*B*	23,600	16,900	15.0	12.5	750	8715033
	CAPT3743*4A*	A*VM970603BNA*	23,400	16,800	15.0	12.5	820	8715039
	CAPT3743*4A*	G*VC960803BNA*	23,400	16,800	15.0	12.5	800	8715051
	CAPT3743*4A*	A*VC80805C*B*	23,600	16,900	15.0	12.5	725	8715034
	CAPT3743*4A*	G*VM970603BNA*	23,400	16,800	15.0	12.5	820	8715053
CAPT3743*4A*	G*EC960803BNA*	23,400	16,800	14.5	12.2	750	8715046	
CAPT3743*4A*	G*VC80604B*B*	23,600	16,900	15.0	12.5	750	8715047	
CAPT3743*4A*	G*VC960403BNA*	23,400	16,800	15.0	12.5	805	8715049	
CAPT3743*4A*	A*VC960804CNA*	23,600	16,900	15.0	12.5	810	8715038	
CAPT3743*4A*	A*VM970803BNA*	23,400	16,800	15.0	12.5	800	8715040	
CAPT3743*4A*	A*EC960603BNA*	23,400	16,800	14.5	12.2	725	8715031	

See Notes on Page 39.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0251L* (cont.)	CAPT3743*4A*	G*VC960603BNA*	23,400	16,800	15.0	12.5	820	8715050
	CAPT3743*4A*	A*VC960803BNA*	23,400	16,800	15.0	12.5	800	8715037
	CAPT3743*4A*	G*EC960402BNA*	23,400	16,800	14.5	12.2	775	8715044
	CAPT3743*4A*	G*EC960603BNA*	23,400	16,800	14.5	12.2	725	8715045
	CAPT3743*4A*	G*E80603B*B*	23,600	16,900	15.0	12.5	725	8715042
	CAPT3743*4A*+EEP		23,600	16,900	14.0	12.2	725	8715056
	CAPT3743*4A*+MBVC1200**-1A*		23,600	16,900	14.5	12.2	775	8715057
	CHPF3636B6C*	A*VC80603B*B*	23,600	17,400	15.0	12.5	750	9947417
	CHPF3636B6C*	A*VC80803B*B*	23,600	17,400	15.0	12.5	750	9947422
	CHPF3636B6C*	G*E80603B*B*	23,600	16,900	15.0	12.5	725	8715068
	CHPF3636B6C*	G*VM970603BNA*	23,600	16,900	15.0	12.5	820	8715077
	CHPF3636B6C*	A*VC80604B*B*	23,600	16,900	15.0	12.5	750	8715062
	CHPF3636B6C*	A*EC960402BNA*	23,400	16,800	14.5	12.2	775	8715059
	CHPF3636B6C*	A*VC960403BNA*	23,600	16,900	15.0	12.5	805	8715063
	CHPF3636B6C*	G*VM970803BNA*	23,600	16,900	15.0	12.5	800	8715078
	CHPF3636B6C*	A*EC960603BNA*	23,400	16,800	14.5	12.2	725	8715060
	CHPF3636B6C*	G*EC960803BNA*	23,400	16,800	14.5	12.2	750	8715072
	CHPF3636B6C*	G*VC960803BNA*	23,600	16,900	15.0	12.5	800	8715076
	CHPF3636B6C*	A*EC960302BNA*	23,400	16,800	14.5	12.2	750	8715058
	CHPF3636B6C*	A*VM970603BNA*	23,600	16,900	15.0	12.5	820	8715066
	CHPF3636B6C*	A*VC960603BNA*	23,600	16,900	15.0	12.5	820	8715064
	CHPF3636B6C*	G*VC960403BNA*	23,600	16,900	15.0	12.5	805	8715074
	CHPF3636B6C*	A*VC960803BNA*	23,600	16,900	15.0	12.5	800	8715065
	CHPF3636B6C*	A*EC960803BNA*	23,400	16,800	14.5	12.2	750	8715061
	CHPF3636B6C*	G*VC960603BNA*	23,600	16,900	15.0	12.5	820	8715075
	CHPF3636B6C*	G*VC80604B*B*	23,600	16,900	15.0	12.5	750	8715073
	CHPF3636B6C*	A*VM970803BNA*	23,600	16,900	15.0	12.5	800	8715067
	CHPF3636B6C*	G*EC960603BNA*	23,400	16,800	14.5	12.2	725	8715071
	CHPF3636B6C*	G*EC960302BNA*	23,400	16,800	14.5	12.2	750	8715069
	CHPF3636B6C*	G*EC960402BNA*	23,400	16,800	14.5	12.2	775	8715070
	CHPF3636B6C*+EEP		23,600	16,900	14.0	12.2	725	8715079
	CHPF3636B6C*+EEP+TXV		23,600	16,900	14.5	12.2	725	8715080
	CHPF3636B6C*+MBVC1200**-1A*		23,600	16,900	15.0	12.5	775	8715081
	CHPF3636B6C*+TXV	A*VC80603B*B*	23,600	17,400	15.0	12.5	750	9947418
	CHPF3636B6C*+TXV	A*VC80803B*B*	23,600	17,400	15.0	12.5	750	9947423
	CHPF3636B6C*+TXV	A*VM970803BNA*	23,600	16,900	15.0	12.5	800	8715091
	CHPF3636B6C*+TXV	G*VC960603BNA*	23,600	16,900	15.0	12.5	820	8715099
	CHPF3636B6C*+TXV	G*EC960302BNA*	23,400	16,800	14.5	12.2	750	8715093
	CHPF3636B6C*+TXV	A*VC960803BNA*	23,600	16,900	15.0	12.5	800	8715089
	CHPF3636B6C*+TXV	A*VC960403BNA*	23,600	16,900	15.0	12.5	805	8715087
	CHPF3636B6C*+TXV	G*VC80604B*B*	23,600	16,900	15.0	12.5	750	8715097
	CHPF3636B6C*+TXV	G*VM970603BNA*	23,600	16,900	15.0	12.5	820	8715101
	CHPF3636B6C*+TXV	A*EC960803BNA*	23,400	16,800	14.5	12.2	750	8715085
	CHPF3636B6C*+TXV	G*EC960803BNA*	23,400	16,800	14.5	12.2	750	8715096
	CHPF3636B6C*+TXV	G*VM970803BNA*	23,600	16,900	15.0	12.5	800	8715102
	CHPF3636B6C*+TXV	G*EC960603BNA*	23,400	16,800	14.5	12.2	725	8715095
	CHPF3636B6C*+TXV	A*EC960603BNA*	23,400	16,800	14.5	12.2	725	8715084
	CHPF3636B6C*+TXV	A*EC960302BNA*	23,400	16,800	14.5	12.2	750	8715082
CHPF3636B6C*+TXV	G*VC960403BNA*	23,600	16,900	15.0	12.5	805	8715098	
CHPF3636B6C*+TXV	A*VC80604B*B*	23,600	16,900	15.0	12.5	750	8715086	
CHPF3636B6C*+TXV	G*VC960803BNA*	23,600	16,900	15.0	12.5	800	8715100	
CHPF3636B6C*+TXV	G*E80603B*B*	23,600	16,900	15.0	12.5	725	8715092	
CHPF3636B6C*+TXV	A*VC960603BNA*	23,600	16,900	15.0	12.5	820	8715088	

See Notes on Page 39.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0251L* (cont.)	CHPF3636B6C*+TXV	A*VM970603BNA*	23,600	16,900	15.0	12.5	820	8715090
	CHPF3636B6C*+TXV	A*EC960402BNA*	23,400	16,800	14.5	12.2	775	8715083
	CHPF3636B6C*+TXV	G*EC960402BNA*	23,400	16,800	14.5	12.2	775	8715094
	CHPF3642C6C*	A*VC80805D*B*	23,600	17,400	15.0	12.5	800	9947432
	CHPF3642C6C*	A*VC960804CNA*	23,600	16,900	15.0	12.5	810	8715104
	CHPF3642C6C*	G*VM970804CNA*	23,600	16,900	15.0	12.5	810	8715108
	CHPF3642C6C*	A*VC80805C*B*	23,600	16,900	15.0	12.5	725	8715103
	CHPF3642C6C*	A*VM970804CNA*	23,600	16,900	15.0	12.5	810	8715105
	CHPF3642C6C*	G*VC960804CNA*	23,600	16,900	15.0	12.5	810	8715107
	CHPF3642C6C*	G*VC80805C*B*	23,600	16,900	15.0	12.5	725	8715106
	CHPF3642C6C*+TXV	A*VC80805D*B*	23,600	17,400	15.0	12.5	800	9947433
	CHPF3642C6C*+TXV	G*VC960804CNA*	23,600	16,900	15.0	12.5	810	8715113
	CHPF3642C6C*+TXV	A*VC960804CNA*	23,600	16,900	15.0	12.5	810	8715110
	CHPF3642C6C*+TXV	A*VM970804CNA*	23,600	16,900	15.0	12.5	810	8715111
	CHPF3642C6C*+TXV	G*VC80805C*B*	23,600	16,900	15.0	12.5	725	8715112
	CHPF3642C6C*+TXV	G*VM970804CNA*	23,600	16,900	15.0	12.5	810	8715114
	CHPF3642C6C*+TXV	A*VC80805C*B*	23,600	16,900	15.0	12.5	725	8715109
	CSCF3036N6D*	A*VC80804C*B*	23,600	17,400	15.0	12.5	800	9947427
	CSCF3036N6D*	A*VC80805D*B*	23,600	17,400	15.0	12.5	800	9947434
	CSCF3036N6D*	G*VM970803BNA*	23,600	16,900	15.0	12.5	800	8715131
	CSCF3036N6D*	A*VC960603BNA*	23,600	16,900	15.0	12.5	820	8715118
	CSCF3036N6D*	A*VC80604B*B*	23,600	16,900	15.0	12.5	750	8715115
	CSCF3036N6D*	G*VC960804CNA*	23,600	16,900	15.0	12.5	810	8715129
	CSCF3036N6D*	G*VC80604B*B*	23,600	16,900	15.0	12.5	750	8715124
	CSCF3036N6D*	G*VC80805C*B*	23,600	16,900	15.0	12.5	725	8715125
	CSCF3036N6D*	A*VM970803BNA*	23,600	16,900	15.0	12.5	800	8715122
	CSCF3036N6D*	A*VC960403BNA*	23,600	16,900	15.0	12.5	805	8715117
	CSCF3036N6D*	G*VM970804CNA*	23,600	16,900	15.0	12.5	810	8715132
	CSCF3036N6D*	A*VC80805C*B*	23,600	16,900	15.0	12.5	725	8715116
	CSCF3036N6D*	G*VC960803BNA*	23,600	16,900	15.0	12.5	800	8715128
	CSCF3036N6D*	G*VM970603BNA*	23,600	16,900	15.0	12.5	820	8715130
	CSCF3036N6D*	A*VC960803BNA*	23,600	16,900	15.0	12.5	800	8715119
	CSCF3036N6D*	G*VC960603BNA*	23,600	16,900	15.0	12.5	820	8715127
	CSCF3036N6D*	A*VC960804CNA*	23,600	16,900	15.0	12.5	810	8715120
	CSCF3036N6D*	A*VM970603BNA*	23,600	16,900	15.0	12.5	820	8715121
	CSCF3036N6D*	G*VC960403BNA*	23,600	16,900	15.0	12.5	805	8715126
	CSCF3036N6D*	A*VM970804CNA*	23,600	16,900	15.0	12.5	810	8715123
	CSCF3036N6D*+EEP		23,200	16,600	14.0	12.2	800	8715133
	CSCF3036N6D*+EEP+TXV		23,200	16,600	14.0	12.2	800	8715134
	CSCF3036N6D*+TXV	A*VC80804C*B*	23,600	17,400	15.0	12.5	800	9947428
	CSCF3036N6D*+TXV	A*VC80805D*B*	23,600	17,400	15.0	12.5	800	9947435
	CSCF3036N6D*+TXV	A*VM970804CNA*	23,600	16,900	15.0	12.5	810	8715143
	CSCF3036N6D*+TXV	G*VC960603BNA*	23,600	16,900	15.0	12.5	820	8715147
	CSCF3036N6D*+TXV	G*VC960804CNA*	23,600	16,900	15.0	12.5	810	8715149
	CSCF3036N6D*+TXV	A*VC960603BNA*	23,600	16,900	15.0	12.5	820	8715138
	CSCF3036N6D*+TXV	G*VM970804CNA*	23,600	16,900	15.0	12.5	810	8715152
	CSCF3036N6D*+TXV	G*VC80604B*B*	23,600	16,900	15.0	12.5	750	8715144
	CSCF3036N6D*+TXV	A*VC80604B*B*	23,600	16,900	15.0	12.5	750	8715135
CSCF3036N6D*+TXV	A*VC80805C*B*	23,600	16,900	15.0	12.5	725	8715136	
CSCF3036N6D*+TXV	A*VM970603BNA*	23,600	16,900	15.0	12.5	820	8715141	
CSCF3036N6D*+TXV	A*VM970803BNA*	23,600	16,900	15.0	12.5	800	8715142	
CSCF3036N6D*+TXV	A*VC960803BNA*	23,600	16,900	15.0	12.5	800	8715139	
CSCF3036N6D*+TXV	A*VC960403BNA*	23,600	16,900	15.0	12.5	805	8715137	

See Notes on Page 39.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0251L* (cont.)	CSCF3036N6D*+TXV	G*VC960403BNA*	23,600	16,900	15.0	12.5	805	8715146
	CSCF3036N6D*+TXV	G*VC960803BNA*	23,600	16,900	15.0	12.5	800	8715148
	CSCF3036N6D*+TXV	A*VC960804CNA*	23,600	16,900	15.0	12.5	810	8715140
	CSCF3036N6D*+TXV	G*VC80805C*B*	23,600	16,900	15.0	12.5	725	8715145
	CSCF3036N6D*+TXV	G*VM970603BNA*	23,600	16,900	15.0	12.5	820	8715150
	CSCF3036N6D*+TXV	G*VM970803BNA*	23,600	16,900	15.0	12.5	800	8715151
	CSCF3642N6D*	G*EC960302BNA*	23,400	16,800	14.5	12.2	750	8715157
	CSCF3642N6D*	G*EC960603BNA*	23,400	16,800	14.5	12.2	725	8715159
	CSCF3642N6D*	G*EC960402BNA*	23,400	16,800	14.5	12.2	775	8715158
	CSCF3642N6D*	A*EC960603BNA*	23,400	16,800	14.5	12.2	725	8715155
	CSCF3642N6D*	G*EC960803BNA*	23,400	16,800	14.5	12.2	750	8715160
	CSCF3642N6D*	A*EC960402BNA*	23,400	16,800	14.5	12.2	775	8715154
	CSCF3642N6D*	A*EC960803BNA*	23,400	16,800	14.5	12.2	750	8715156
	CSCF3642N6D*	A*EC960302BNA*	23,400	16,800	14.5	12.2	750	8715153
	CSCF3642N6D*+TXV	G*EC960302BNA*	23,400	16,800	14.5	12.2	750	8715165
	CSCF3642N6D*+TXV	A*EC960302BNA*	23,400	16,800	14.5	12.2	750	8715161
	CSCF3642N6D*+TXV	A*EC960402BNA*	23,400	16,800	14.5	12.2	775	8715162
	CSCF3642N6D*+TXV	G*EC960803BNA*	23,400	16,800	14.5	12.2	750	8715168
	CSCF3642N6D*+TXV	A*EC960803BNA*	23,400	16,800	14.5	12.2	750	8715164
	CSCF3642N6D*+TXV	A*EC960603BNA*	23,400	16,800	14.5	12.2	725	8715163
CSCF3642N6D*+TXV	G*EC960603BNA*	23,400	16,800	14.5	12.2	725	8715167	
CSCF3642N6D*+TXV	G*EC960402BNA*	23,400	16,800	14.5	12.2	775	8715166	
ASX14 0301K*	ARUF31B14A*		28,200	21,000	14.0	11.5	870	7989014
	ASPT36C14A*		29,000	21,400	14.5	12.0	1,010	7546978
	ASPT37B14A*		29,000	21,400	14.5	12.0	945	8245625
	ASPT37C14A*		29,000	21,400	15.0	12.5	1,045	8245627
	AVPTC36C14A*		29,000	21,400	14.5	12.0	1,085	7546979
	AVPTC37B14A*		29,000	21,400	14.5	12.0	925	8996356
	AVPTC37C14A*		29,200	21,600	15.0	12.5	930	8996357
	AWUF31XX16A*		28,000	20,800	14.0	11.5	950	7546980
	AWUF31XX16A*+TXV		28,400	21,000	14.5	11.5	1,000	7546981
	AWUF32XX16A*		28,000	20,800	14.0	11.5	950	7546982
	AWUF32XX16A*+TXV		28,400	21,000	14.5	11.5	1,000	7546983
	AWUF37XX16B*		28,400	21,000	14.0	11.5	1,000	7546984
	AWUF37XX16B*+TXV		28,600	21,200	14.5	11.5	1,000	7546985
	CA*F3137*6A*+EEP		28,800	21,400	14.0	11.5	1,000	8191546
	CA*F3137*6A*+EEP+TXV		28,800	21,400	14.0	11.5	1,000	8191547
	CA*F3137*6A*+MBVC1200**-1A*		28,800	21,400	14.5	11.5	950	8191548
	CA*F3137*6A*+MBVC1200**-1A*+TXV		28,800	21,400	14.5	12.0	950	8191549
	CA*F3137*6A*+TXV	G*EC960402BNA*	28,200	21,000	14.5	11.5	925	8191557
	CA*F3137*6A*+TXV	A*VM970603BNA*	28,600	21,200	14.5	11.5	1,000	8191576
	CA*F3137*6A*+TXV	G*EC960603BNA*	28,200	21,000	14.5	11.5	965	8191558
	CA*F3137*6A*+TXV	A*VC960803BNA*	28,600	21,200	14.5	11.5	950	8191575
	CA*F3137*6A*+TXV	A*VC80604B*B*	28,400	21,000	14.5	11.5	1,000	8191572
	CA*F3137*6A*+TXV	G*EC960803BNA*	28,200	21,000	14.5	11.5	950	8191559
	CA*F3137*6A*+TXV	A*EH800603B*A*	28,800	21,400	14.5	11.5	1,000	8191571
	CA*F3137*6A*+TXV	A*EC960803BNA*	28,200	21,000	14.5	11.5	950	8191580
	CA*F3137*6A*+TXV	A*VC960403BNA*	28,600	21,200	14.5	11.5	1,000	8191573
	CA*F3137*6A*+TXV	G*VC80604B*B*	28,400	21,000	14.5	11.5	1,000	8191551
	CA*F3137*6A*+TXV	A*EC960603BNA*	28,200	21,000	14.5	11.5	965	8191579
	CA*F3137*6A*+TXV	G*VC960403BNA*	28,600	21,200	14.5	11.5	1,000	8191552
	CA*F3137*6A*+TXV	A*EC960302BNA*	28,200	21,000	14.5	11.5	940	8191577
CA*F3137*6A*+TXV	G*VC960603BNA*	28,800	21,400	14.5	11.5	1,000	8191553	

See Notes on Page 48.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0301K* (cont.)	CA*F3137*6A*+TXV	A*VC960603BNA*	28,800	21,400	14.5	11.5	1,000	8191574
	CA*F3137*6A*+TXV	G*VM970603BNA*	28,600	21,200	14.5	11.5	1,000	8191555
	CA*F3137*6A*+TXV	G*EC960302BNA*	28,200	21,000	14.5	11.5	940	8191556
	CA*F3137*6A*+TXV	G*E80603B*B*	28,800	21,400	14.5	11.5	1,000	8191550
	CA*F3137*6A*+TXV	G*VC960803BNA*	28,600	21,200	14.5	11.5	950	8191554
	CA*F3137*6A*+TXV	A*EC960402BNA*	28,200	21,000	14.5	11.5	925	8191578
	CA*F3642*6D*	A*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7547121
	CA*F3642*6D*	A*VC960804CNA*	28,600	21,200	14.5	11.5	1,000	7547093
	CA*F3642*6D*	G*VC960804CNA*	28,600	21,200	14.5	11.5	1,000	7547069
	CA*F3642*6D*	G*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7547107
	CA*F3642*6D*+EEP		28,800	21,400	14.0	11.5	1,000	7546986
	CA*F3642*6D*+EEP+TXV		28,800	21,400	14.0	11.5	1,000	7546987
	CA*F3642*6D*+MBVC1200**-1A*		28,800	21,400	14.5	11.5	980	7546988
	CA*F3642*6D*+MBVC1200**-1A*+TXV		28,800	21,400	14.5	12.0	980	7546989
	CA*F3642*6D*+MBVC1600**-1A*		28,800	21,400	14.5	11.5	1,000	7546990
	CA*F3642*6D*+MBVC1600**-1A*+TXV		28,800	21,400	14.5	12.0	1,000	7546991
	CA*F3642*6D*+TXV	A*VC80804C*B*	28,400	21,800	14.5	11.5	1050	9947436
	CA*F3642*6D*+TXV	A*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7547122
	CA*F3642*6D*+TXV	A*EC960803BNA*	28,200	21,000	14.5	11.5	950	7547170
	CA*F3642*6D*+TXV	G*VC960603BNA*	28,800	21,400	14.5	11.5	1,040	7547059
	CA*F3642*6D*+TXV	G*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7547108
	CA*F3642*6D*+TXV	A*VC960803BNA*	28,600	21,200	14.5	11.5	975	7547088
	CA*F3642*6D*+TXV	G*EC960803BNA*	28,200	21,000	14.5	11.5	950	7547145
	CA*F3642*6D*+TXV	G*VC81005C*B*	28,400	21,000	14.5	11.5	1,000	7547034
	CA*F3642*6D*+TXV	G*E81005C*B*	28,800	21,400	14.5	11.5	1,080	7547019
	CA*F3642*6D*+TXV	A*VC81005C*B*	28,400	21,000	14.5	11.5	1,000	7547049
	CA*F3642*6D*+TXV	G*VC960403BNA*	28,600	21,200	14.5	11.5	1,000	7547054
	CA*F3642*6D*+TXV	A*VC960804CNA*	28,600	21,200	14.5	11.5	1,000	7547094
	CA*F3642*6D*+TXV	G*EC960603BNA*	28,200	21,000	14.5	11.5	965	7547140
	CA*F3642*6D*+TXV	G*VC80604B*B*	28,400	21,000	14.5	11.5	1,000	7547024
	CA*F3642*6D*+TXV	G*E80805C*B*	28,800	21,400	14.5	11.5	1,060	7547014
	CA*F3642*6D*+TXV	G*VM970603BNA*	28,600	21,200	14.5	11.5	1,040	7547102
	CA*F3642*6D*+TXV	G*VC80805C*B*	28,400	21,000	14.5	11.5	990	7547029
	CA*F3642*6D*+TXV	G*E80603B*B*	28,800	21,400	14.5	11.5	1,050	7547009
	CA*F3642*6D*+TXV	G*EC960302BNA*	28,200	21,000	14.5	11.5	940	7547130
	CA*F3642*6D*+TXV	A*EC960603BNA*	28,200	21,000	14.5	11.5	965	7547165
	CA*F3642*6D*+TXV	A*VC80604B*B*	28,400	21,000	14.5	11.5	1,000	7547039
	CA*F3642*6D*+TXV	A*VC80805C*B*	28,400	21,000	14.5	11.5	990	7547044
	CA*F3642*6D*+TXV	A*EC961004CNA*	28,600	21,200	14.5	11.5	1,025	7547175
	CA*F3642*6D*+TXV	G*EC961004CNA*	28,600	21,200	14.5	11.5	1,025	7547150
	CA*F3642*6D*+TXV	A*EC960302BNA*	28,200	21,000	14.5	11.5	940	7547155
	CA*F3642*6D*+TXV	A*VC960403BNA*	28,600	21,200	14.5	11.5	1,000	7547078
	CA*F3642*6D*+TXV	A*EC960402BNA*	28,200	21,000	14.5	11.5	925	7547160
	CA*F3642*6D*+TXV	G*VC960804CNA*	28,600	21,200	14.5	11.5	1,000	7547070
	CA*F3642*6D*+TXV	A*VC960603BNA*	28,800	21,400	14.5	11.5	1,040	7547083
	CA*F3642*6D*+TXV	A*VM970603BNA*	28,600	21,200	14.5	11.5	1,040	7547116
	CA*F3642*6D*+TXV	G*EC960402BNA*	28,200	21,000	14.5	11.5	925	7547135
	CA*F3642*6D*+TXV	G*VC960803BNA*	28,600	21,200	14.5	11.5	975	7547064
	CA*F3743*6D*	A*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7547123
	CA*F3743*6D*	A*VC960804CNA*	28,800	21,400	14.5	11.5	1,000	7547095
CA*F3743*6D*	G*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7547109	
CA*F3743*6D*	G*VC960804CNA*	28,800	21,400	14.5	11.5	1,000	7547071	
CA*F3743*6D*+EEP		28,800	21,400	14.0	11.5	1,000	7546992	

See Notes on Page 48.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0301K* (cont.)	CA*F3743*6D*+EPP+TXV		28,800	21,400	14.0	11.5	1,000	7546993
	CA*F3743*6D*+TXV	A*VC80804C*B*	28,600	22,000	14.5	11.5	1050	9947437
	CA*F3743*6D*+TXV	A*EC960603BNA*	28,400	21,000	14.5	11.5	965	7547166
	CA*F3743*6D*+TXV	G*EC960402BNA*	28,400	21,000	14.5	11.5	925	7547136
	CA*F3743*6D*+TXV	G*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7547110
	CA*F3743*6D*+TXV	A*EC960302BNA*	28,400	21,000	14.5	11.5	940	7547156
	CA*F3743*6D*+TXV	A*EC960803BNA*	28,400	21,000	14.5	11.5	950	7547171
	CA*F3743*6D*+TXV	A*VC960403BNA*	28,800	21,400	14.5	11.5	1,000	7547079
	CA*F3743*6D*+TXV	A*VC81005C*B*	28,600	21,200	14.5	11.5	1,000	7547050
	CA*F3743*6D*+TXV	G*VC960403BNA*	28,800	21,400	14.5	11.5	1,000	7547055
	CA*F3743*6D*+TXV	A*VC960603BNA*	28,800	21,400	14.5	11.5	1,040	7547084
	CA*F3743*6D*+TXV	G*E81005C*B*	28,800	21,400	14.5	11.5	1,080	7547020
	CA*F3743*6D*+TXV	G*VC81005C*B*	28,600	21,200	14.5	11.5	1,000	7547035
	CA*F3743*6D*+TXV	G*VC960803BNA*	28,600	21,200	14.5	11.5	975	7547065
	CA*F3743*6D*+TXV	A*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7547124
	CA*F3743*6D*+TXV	A*VC960804CNA*	28,800	21,400	14.5	11.5	1,000	7547096
	CA*F3743*6D*+TXV	A*EC961004CNA*	28,800	21,400	14.5	11.5	1,025	7547176
	CA*F3743*6D*+TXV	G*E80603B*B*	28,800	21,400	14.5	12.0	1,050	7547010
	CA*F3743*6D*+TXV	A*VC960803BNA*	28,600	21,200	14.5	11.5	975	7547089
	CA*F3743*6D*+TXV	G*VC960804CNA*	28,800	21,400	14.5	11.5	1,000	7547072
	CA*F3743*6D*+TXV	G*EC960302BNA*	28,400	21,000	14.5	11.5	940	7547131
	CA*F3743*6D*+TXV	G*E80805C*B*	28,800	21,400	14.5	12.0	1,060	7547015
	CA*F3743*6D*+TXV	G*VM970603BNA*	28,600	21,200	14.5	11.5	1,040	7547103
	CA*F3743*6D*+TXV	A*VC80604B*B*	28,600	21,200	14.5	11.5	1,000	7547040
	CA*F3743*6D*+TXV	A*VC80805C*B*	28,600	21,200	14.5	11.5	990	7547045
	CA*F3743*6D*+TXV	G*VC80604B*B*	28,600	21,200	14.5	11.5	1,000	7547025
	CA*F3743*6D*+TXV	A*VM970603BNA*	28,600	21,200	14.5	11.5	1,040	7547117
	CA*F3743*6D*+TXV	G*VC960603BNA*	28,800	21,400	14.5	11.5	1,040	7547060
	CA*F3743*6D*+TXV	G*EC961004CNA*	28,800	21,400	14.5	11.5	1,025	7547151
	CA*F3743*6D*+TXV	A*EC960402BNA*	28,400	21,000	14.5	11.5	925	7547161
	CA*F3743*6D*+TXV	G*EC960603BNA*	28,400	21,000	14.5	11.5	965	7547141
	CA*F3743*6D*+TXV	G*EC960803BNA*	28,400	21,000	14.5	11.5	950	7547146
	CA*F3743*6D*+TXV	G*VC80805C*B*	28,600	21,200	14.5	11.5	990	7547030
	CAPT3743*4A*	A*VC80804C*B*	28,400	21,800	14.5	11.5	1050	9947438
	CAPT3743*4A*	A*VC960603BNA*	28,600	21,200	14.5	11.5	1,040	7547085
	CAPT3743*4A*	G*VC960603BNA*	28,600	21,200	14.5	11.5	1,040	7547061
	CAPT3743*4A*	G*VC960803BNA*	28,400	21,000	14.5	11.5	975	7547066
	CAPT3743*4A*	A*VC960803BNA*	28,400	21,000	14.5	11.5	975	7547090
	CAPT3743*4A*	G*EC961004CNA*	28,600	21,200	14.5	11.5	1,025	7547152
	CAPT3743*4A*	G*VM970603BNA*	28,600	21,200	14.5	11.5	1,040	7547104
	CAPT3743*4A*	G*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7547111
	CAPT3743*4A*	A*EC961004CNA*	28,600	21,200	14.5	11.5	1,025	7547177
CAPT3743*4A*	G*VC80604B*B*	28,400	21,000	14.5	11.5	1,000	7547026	
CAPT3743*4A*	G*VC81005C*B*	28,400	21,000	14.5	11.5	1,000	7547036	
CAPT3743*4A*	G*EC960603BNA*	28,200	21,000	14.5	11.5	965	7547142	
CAPT3743*4A*	A*EC960603BNA*	28,200	21,000	14.5	11.5	965	7547167	
CAPT3743*4A*	A*EC960302BNA*	28,200	21,000	14.5	11.5	940	7547157	
CAPT3743*4A*	A*VC960403BNA*	28,600	21,200	14.5	11.5	1,000	7547080	
CAPT3743*4A*	A*VC960804CNA*	28,600	21,200	14.5	11.5	1,000	7547097	
CAPT3743*4A*	G*E80603B*B*	28,800	21,400	14.5	11.5	1,050	7547011	
CAPT3743*4A*	G*EC960402BNA*	28,200	21,000	14.5	11.5	925	7547137	
CAPT3743*4A*	G*VC80805C*B*	28,400	21,000	14.5	11.5	990	7547031	
CAPT3743*4A*	G*EC960803BNA*	28,200	21,000	14.5	11.5	950	7547147	

See Notes on Page 48.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0301K* (cont.)	CAPT3743*4A*	G*EC960302BNA*	28,200	21,000	14.5	11.5	940	7547132
	CAPT3743*4A*	A*EC960803BNA*	28,200	21,000	14.5	11.5	950	7547172
	CAPT3743*4A*	A*VM970603BNA*	28,600	21,200	14.5	11.5	1,040	7547118
	CAPT3743*4A*	A*VC80805C*B*	28,400	21,000	14.5	11.5	990	7547046
	CAPT3743*4A*	A*VC80604B*B*	28,400	21,000	14.5	11.5	1,000	7547041
	CAPT3743*4A*	G*VC960804CNA*	28,600	21,200	14.5	11.5	1,000	7547073
	CAPT3743*4A*	A*VC81005C*B*	28,400	21,000	14.5	11.5	1,000	7547051
	CAPT3743*4A*	A*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7547125
	CAPT3743*4A*	G*E81005C*B*	28,800	21,400	14.5	11.5	1,080	7547021
	CAPT3743*4A*	G*VC960403BNA*	28,600	21,200	14.5	11.5	1,000	7547056
	CAPT3743*4A*	A*EC960402BNA*	28,200	21,000	14.5	11.5	925	7547162
	CAPT3743*4A*	G*E80805C*B*	28,800	21,400	14.5	11.5	1,060	7547016
	CAPT3743*4A*+EERP		28,800	21,400	14.5	11.5	1,000	7546994
	CAPT3743*4A*+MBVC1200**-1A*		28,800	21,400	14.5	12.0	980	7546995
	CAPT3743*4A*+MBVC1600**-1A*		28,800	21,400	14.5	12.0	1,000	7546996
	CHPF3636B6C*+TXV	A*VC960603BNA*	28,800	21,400	14.5	11.5	1,040	7547086
	CHPF3636B6C*+TXV	A*VC960403BNA*	28,800	21,400	14.5	11.5	1,000	7547081
	CHPF3636B6C*+TXV	G*VC960803BNA*	28,600	21,200	14.5	11.5	975	7547067
	CHPF3636B6C*+TXV	A*VM970603BNA*	28,600	21,200	14.5	11.5	1,040	7547119
	CHPF3636B6C*+TXV	A*VC960803BNA*	28,600	21,200	14.5	11.5	975	7547091
	CHPF3636B6C*+TXV	G*VC960403BNA*	28,800	21,400	14.5	11.5	1,000	7547057
	CHPF3636B6C*+TXV	G*VC960603BNA*	28,800	21,400	14.5	11.5	1,040	7547062
	CHPF3636B6C*+TXV	G*VM970603BNA*	28,600	21,200	14.5	11.5	1,040	7547105
	CHPF3642C6C*	G*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7547112
	CHPF3642C6C*	G*VC960804CNA*	28,800	21,400	14.5	11.5	1,000	7547074
	CHPF3642C6C*	A*VC960804CNA*	28,800	21,400	14.5	11.5	1,000	7547098
	CHPF3642C6C*	A*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7547126
	CHPF3642C6C*+EERP		28,800	21,400	14.0	11.5	1,000	7546997
	CHPF3642C6C*+EERP+TXV		28,800	21,400	14.0	11.5	1,000	7546998
	CHPF3642C6C*+MBVC1200**-1A*		28,800	21,400	14.5	12.0	1,000	7546999
	CHPF3642C6C*+MBVC1200**-1A*+TXV		28,800	21,400	14.5	12.0	1,000	7547000
	CHPF3642C6C*+MBVC1600**-1A*		28,800	21,400	14.5	12.0	1,000	7547001
	CHPF3642C6C*+MBVC1600**-1A*+TXV		28,800	21,400	14.5	12.0	1,000	7547002
	CHPF3642C6C*+TXV	A*VC80804C*B*	28,600	22,000	14.5	11.5	1000	9947439
	CHPF3642C6C*+TXV	G*EC961004CNA*	28,800	21,400	14.5	11.5	1,025	7547153
	CHPF3642C6C*+TXV	G*E80603B*B*	28,800	21,400	14.5	11.5	1,050	7547012
	CHPF3642C6C*+TXV	G*EC960803BNA*	28,400	21,000	14.5	11.5	950	7547148
	CHPF3642C6C*+TXV	A*EC961004CNA*	28,800	21,400	14.5	11.5	1,025	7547178
	CHPF3642C6C*+TXV	A*VC80805C*B*	28,600	21,200	14.5	11.5	990	7547047
	CHPF3642C6C*+TXV	A*EC960302BNA*	28,400	21,000	14.5	11.5	940	7547158
	CHPF3642C6C*+TXV	A*EC960402BNA*	28,400	21,000	14.5	11.5	925	7547163
	CHPF3642C6C*+TXV	G*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7547113
	CHPF3642C6C*+TXV	A*EC960803BNA*	28,400	21,000	14.5	11.5	950	7547173
	CHPF3642C6C*+TXV	G*EC960603BNA*	28,400	21,000	14.5	11.5	965	7547143
	CHPF3642C6C*+TXV	G*VC960804CNA*	28,800	21,400	14.5	11.5	1,000	7547075
	CHPF3642C6C*+TXV	G*VC81005C*B*	28,600	21,200	14.5	11.5	1,000	7547037
	CHPF3642C6C*+TXV	G*VC80604B*B*	28,600	21,200	14.5	11.5	1,000	7547027
	CHPF3642C6C*+TXV	A*EC960603BNA*	28,400	21,000	14.5	11.5	965	7547168
	CHPF3642C6C*+TXV	A*VC81005C*B*	28,600	21,200	14.5	11.5	1,000	7547052
	CHPF3642C6C*+TXV	G*EC960402BNA*	28,400	21,000	14.5	11.5	925	7547138
CHPF3642C6C*+TXV	G*E81005C*B*	28,800	21,400	14.5	11.5	1,080	7547022	
CHPF3642C6C*+TXV	G*VC80805C*B*	28,600	21,200	14.5	11.5	990	7547032	
CHPF3642C6C*+TXV	G*E80805C*B*	28,800	21,400	14.5	11.5	1,000	7547017	

See Notes on Page 48.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0301K* (cont.)	CHPF3642C6C*+TXV	A*VC960804CNA*	28,800	21,400	14.5	11.5	1,000	7547099
	CHPF3642C6C*+TXV	G*EC960302BNA*	28,400	21,000	14.5	11.5	940	7547133
	CHPF3642C6C*+TXV	A*VC80604B*B*	28,600	21,200	14.5	11.5	1,000	7547042
	CHPF3642C6C*+TXV	A*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7547127
	CHPF3743C6B*+EEP		28,800	21,400	14.0	11.5	1,000	7547003
	CHPF3743C6B*+EEP+TXV		28,800	21,400	14.0	11.5	1,000	7547004
	CHPF3743D6B*+EEP		28,800	21,400	14.0	11.5	1,000	7547005
	CHPF3743D6B*+EEP+TXV		28,800	21,400	14.0	11.5	1,000	7547006
	CSCF3642N6D*	G*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7547114
	CSCF3642N6D*	A*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7547128
	CSCF3642N6D*	G*VC960804CNA*	28,800	21,400	14.5	11.5	1,000	7547076
	CSCF3642N6D*	A*VC960804CNA*	28,800	21,400	14.5	11.5	1,000	7547100
	CSCF3642N6D*+EEP		28,600	21,200	14.0	11.5	1,000	7547007
	CSCF3642N6D*+EEP+TXV		28,600	21,200	14.0	11.5	1,000	7547008
	CSCF3642N6D*+TXV	A*VC80804C*B*	28,600	22,000	14.5	11.5	1050	9947440
	CSCF3642N6D*+TXV	A*VC80604B*B*	28,600	21,200	14.5	11.5	1,000	7547043
	CSCF3642N6D*+TXV	G*VC960403BNA*	28,800	21,400	14.5	11.5	1,000	7547058
	CSCF3642N6D*+TXV	A*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7547129
	CSCF3642N6D*+TXV	A*VC960804CNA*	28,800	21,400	14.5	11.5	1,000	7547101
	CSCF3642N6D*+TXV	A*VC80805C*B*	28,600	21,200	14.5	11.5	990	7547048
	CSCF3642N6D*+TXV	G*EC960803BNA*	28,400	21,000	14.5	11.5	950	7547149
	CSCF3642N6D*+TXV	G*VC81005C*B*	28,600	21,200	14.5	11.5	1,000	7547038
	CSCF3642N6D*+TXV	G*VC960804CNA*	28,800	21,400	14.5	11.5	1,000	7547077
	CSCF3642N6D*+TXV	G*VM970603BNA*	28,600	21,200	14.5	11.5	1,040	7547106
	CSCF3642N6D*+TXV	A*EC960302BNA*	28,200	21,000	14.5	11.5	940	7547159
	CSCF3642N6D*+TXV	G*EC960302BNA*	28,200	21,000	14.5	11.5	940	7547134
	CSCF3642N6D*+TXV	G*EC960603BNA*	28,200	21,000	14.5	11.5	965	7547144
	CSCF3642N6D*+TXV	A*VC81005C*B*	28,600	21,200	14.5	11.5	1,000	7547053
	CSCF3642N6D*+TXV	A*EC960603BNA*	28,200	21,000	14.5	11.5	965	7547169
	CSCF3642N6D*+TXV	A*VC960803BNA*	28,600	21,200	14.5	11.5	975	7547092
	CSCF3642N6D*+TXV	G*VC960603BNA*	28,800	21,400	14.5	11.5	1,040	7547063
	CSCF3642N6D*+TXV	A*VC960603BNA*	28,800	21,400	14.5	11.5	1,040	7547087
	CSCF3642N6D*+TXV	G*VC80604B*B*	28,600	21,200	14.5	11.5	1,000	7547028
	CSCF3642N6D*+TXV	G*VC960803BNA*	28,600	21,200	14.5	11.5	975	7547068
	CSCF3642N6D*+TXV	G*VC80805C*B*	28,600	21,200	14.5	11.5	990	7547033
	CSCF3642N6D*+TXV	A*EC960803BNA*	28,400	21,000	14.5	11.5	950	7547174
	CSCF3642N6D*+TXV	A*VC960403BNA*	28,800	21,400	14.5	11.5	1,000	7547082
	CSCF3642N6D*+TXV	G*VM970804CNA*	28,600	21,200	14.5	11.5	1,000	7547115
	CSCF3642N6D*+TXV	G*E80805C*B*	28,800	21,400	14.5	11.5	1,060	7547018
	CSCF3642N6D*+TXV	G*E80603B*B*	28,800	21,400	14.5	11.5	1,050	7547013
CSCF3642N6D*+TXV	A*EC961004CNA*	28,400	21,000	14.5	11.5	1,025	7547179	
CSCF3642N6D*+TXV	G*EC961004CNA*	28,400	21,000	14.5	11.5	1,025	7547154	
CSCF3642N6D*+TXV	G*E81005C*B*	28,600	21,200	14.5	11.5	1,070	7547023	
CSCF3642N6D*+TXV	A*EC960402BNA*	28,200	21,000	14.5	11.5	925	7547164	
CSCF3642N6D*+TXV	G*EC960402BNA*	28,200	21,000	14.5	11.5	925	7547139	
CSCF3642N6D*+TXV	A*VM970603BNA*	28,600	21,200	14.5	11.5	1,040	7547120	

<sup>1</sup> BTU/h

<sup>2</sup> Seasonal Energy Efficiency Ratio; Certified per AHRI 210/240 @ 80°F/ 67°F/ 95°F

<sup>3</sup> Energy Efficiency Ratio @ 80°F/ 67°F/ 95°F

**NOTES**

- Always check the S&R plate for electrical data on the unit being installed.
- When matching the outdoor unit to the indoor unit, use the piston supplied with the outdoor unit or that specified on the piston kit chart supplied with the indoor unit.
- EEP - Order from Service Dept. Part No. B13707-38 or new Solid State Board B13707-35S. Part No. B13707-38 is not interchangeable with B13707-35S. The Amana brand Gas Furnace contains the EEP cooling time delay.
- HSK - Hard Start Kit: This is an additional capacitor to assist with compressor start-up, used with the standard "run" capacitor that is supplied in the unit. Order from an Amana® brand distributor or service department.



OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0311K*	ARUF31B14A*		28,200	22,200	14.0	12.2	870	7989015
	ARUF37C14A*		28,400	22,400	14.0	12.2	1,050	7989016
	ASPT36C14A*		28,000	22,000	15.0	12.5	1,010	7547180
	ASPT37B14A*		29,000	22,800	14.5	12.2	945	8245628
	ASPT37C14A*		29,000	22,800	15.0	12.5	1,045	8245630
	AVPTC36C14A*		28,000	22,000	15.0	12.5	1,000	7547181
	AVPTC37B14A*		28,000	22,000	14.5	12.2	925	8996358
	AVPTC37C14A*		28,200	22,200	15.0	12.5	930	8996359
	AWUF31X16A*		28,000	22,000	14.0	12.2	1,000	7547182
	AWUF31X16A*+TXV		28,000	22,000	14.5	12.2	1,000	7547183
	AWUF32X16A*		28,000	22,000	14.0	12.2	950	7547184
	AWUF32X16A*+TXV		28,000	22,000	14.5	12.2	950	7547185
	AWUF37X16B*		28,000	22,000	14.0	12.2	950	7547186
	AWUF37X16B*+TXV		28,000	22,000	14.5	12.2	950	7547187
	CA*F3137*6A*	A*VC80603B*B*	28,400	23,000	14.5	12.2	1000	9947441
	CA*F3137*6A*	A*VC80803B*B*	28,400	23,000	14.5	12.2	1050	9947446
	CA*F3137*6A*	G*VC80604B*B*	28,400	22,400	15.0	12.5	1,000	7547216
	CA*F3137*6A*	G*VM970603BNA*	28,400	22,400	15.0	12.5	1,040	7547294
	CA*F3137*6A*	A*EC960402BNA*	28,200	22,200	15.0	12.5	925	7547352
	CA*F3137*6A*	G*VC960803BNA*	28,400	22,400	15.0	12.5	975	7547256
	CA*F3137*6A*	A*VM970603BNA*	28,400	22,400	15.0	12.5	1,040	7547308
	CA*F3137*6A*	G*EC960302BNA*	28,200	22,200	15.0	12.5	940	7547322
	CA*F3137*6A*	G*EC960803BNA*	28,200	22,200	15.0	12.5	950	7547337
	CA*F3137*6A*	A*EC960603BNA*	28,200	22,200	15.0	12.5	965	7547357
	CA*F3137*6A*	A*VC960803BNA*	28,400	22,400	15.0	12.5	975	7547280
	CA*F3137*6A*	A*EC960302BNA*	28,200	22,200	15.0	12.5	940	7547347
	CA*F3137*6A*	A*VC960403BNA*	28,600	22,600	15.0	12.5	1,000	7547270
	CA*F3137*6A*	G*EC960603BNA*	28,200	22,200	15.0	12.5	965	7547332
	CA*F3137*6A*	G*E80603B*B*	28,400	22,400	14.5	12.2	1,050	7547201
	CA*F3137*6A*	G*VC960603BNA*	28,600	22,600	15.0	12.5	1,040	7547251
	CA*F3137*6A*	A*VC960603BNA*	28,600	22,600	15.0	12.5	1,040	7547275
	CA*F3137*6A*	G*VC960403BNA*	28,600	22,600	15.0	12.5	1,000	7547246
	CA*F3137*6A*	A*EC960803BNA*	28,200	22,200	15.0	12.5	950	7547362
	CA*F3137*6A*	G*EC960402BNA*	28,200	22,200	15.0	12.5	925	7547327
	CA*F3137*6A*	A*VC80604B*B*	28,400	22,400	15.0	12.5	1,000	7547231
	CA*F3137*6A*+EEP		28,600	22,600	14.0	12.2	1,000	7547188
	CA*F3137*6A*+EEP+TXV		28,600	22,600	14.0	12.2	1,000	7547189
	CA*F3743*6D*	G*VM970804CNA*	28,600	22,600	15.0	12.5	1,000	7547301
	CA*F3743*6D*	A*VC960804CNA*	28,800	22,600	15.0	12.5	1,000	7547287
	CA*F3743*6D*	A*VM970804CNA*	28,600	22,600	15.0	12.5	1,000	7547315
	CA*F3743*6D*	G*VC960804CNA*	28,800	22,600	15.0	12.5	1,000	7547263
	CA*F3743*6D*+TXV	A*VC80603B*B*	28,400	23,000	15.0	12.5	1000	9947442
	CA*F3743*6D*+TXV	A*VC80803B*B*	28,400	23,000	15.0	12.5	1050	9947447
	CA*F3743*6D*+TXV	A*VC80804C*B*	28,600	23,200	15.0	12.5	1050	9947451
	CA*F3743*6D*+TXV	A*VC80805D*B*	28,600	23,200	15.0	12.5	1000	9947455
	CA*F3743*6D*+TXV	G*EC960803BNA*	28,400	22,400	15.0	12.5	950	7547338
	CA*F3743*6D*+TXV	A*VC80604B*B*	28,600	22,600	15.0	12.5	1,000	7547232
	CA*F3743*6D*+TXV	A*VM970603BNA*	28,400	22,400	15.0	12.5	1,040	7547309
	CA*F3743*6D*+TXV	G*VC960403BNA*	28,800	22,600	15.0	12.5	1,000	7547247
	CA*F3743*6D*+TXV	A*EC960603BNA*	28,400	22,400	15.0	12.5	965	7547358
CA*F3743*6D*+TXV	A*VC960804CNA*	28,800	22,600	15.0	12.5	1,000	7547288	
CA*F3743*6D*+TXV	G*EC960302BNA*	28,400	22,400	15.0	12.5	940	7547323	
CA*F3743*6D*+TXV	A*VC960603BNA*	28,600	22,600	15.0	12.5	1,040	7547276	

See Notes on Page 48.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0311K* (cont.)	CA*F3743*6D*+TXV	G*VC80805C*B*	28,600	22,600	15.0	12.5	990	7547222
	CA*F3743*6D*+TXV	G*EC961004CNA*	28,800	22,600	15.0	12.5	1,025	7547343
	CA*F3743*6D*+TXV	A*EC960302BNA*	28,400	22,400	15.0	12.5	940	7547348
	CA*F3743*6D*+TXV	A*EC960803BNA*	28,400	22,400	15.0	12.5	950	7547363
	CA*F3743*6D*+TXV	A*EC960402BNA*	28,400	22,400	15.0	12.5	925	7547353
	CA*F3743*6D*+TXV	G*VM970804CNA*	28,600	22,600	15.0	12.5	1,000	7547302
	CA*F3743*6D*+TXV	G*E80805C*B*	28,600	22,600	15.0	12.5	1,000	7547207
	CA*F3743*6D*+TXV	G*VC960803BNA*	28,400	22,400	15.0	12.5	975	7547257
	CA*F3743*6D*+TXV	G*E81005C*B*	28,400	22,400	15.0	12.5	1,000	7547212
	CA*F3743*6D*+TXV	G*EC960603BNA*	28,400	22,400	15.0	12.5	965	7547333
	CA*F3743*6D*+TXV	A*VC81005C*B*	28,600	22,600	15.0	12.5	1,000	7547242
	CA*F3743*6D*+TXV	A*EC961004CNA*	28,800	22,600	15.0	12.5	1,025	7547368
	CA*F3743*6D*+TXV	A*VC80805C*B*	28,600	22,600	15.0	12.5	990	7547237
	CA*F3743*6D*+TXV	A*VC960403BNA*	28,800	22,600	15.0	12.5	1,000	7547271
	CA*F3743*6D*+TXV	G*VC81005C*B*	28,600	22,600	15.0	12.5	1,000	7547227
	CA*F3743*6D*+TXV	G*E80603B*B*	28,400	22,400	15.0	12.5	1,050	7547202
	CA*F3743*6D*+TXV	G*VC80604B*B*	28,600	22,600	15.0	12.5	1,000	7547217
	CA*F3743*6D*+TXV	G*EC960402BNA*	28,400	22,400	15.0	12.5	925	7547328
	CA*F3743*6D*+TXV	G*VC960603BNA*	28,600	22,600	15.0	12.5	1,040	7547252
	CA*F3743*6D*+TXV	A*VM970804CNA*	28,600	22,600	15.0	12.5	1,000	7547316
	CA*F3743*6D*+TXV	G*VM970603BNA*	28,400	22,400	15.0	12.5	1,040	7547295
	CA*F3743*6D*+TXV	G*VC960804CNA*	28,800	22,600	15.0	12.5	1,000	7547264
	CA*F3743*6D*+TXV	A*VC960803BNA*	28,400	22,400	15.0	12.5	975	7547281
	CAPT3743*4A*	A*VC80603B*B*	28,400	23,000	14.5	12.2	1000	9947443
	CAPT3743*4A*	A*VC80803B*B*	28,400	23,000	14.5	12.2	1050	9947448
	CAPT3743*4A*	A*VC80804C*B*	28,400	23,000	14.5	12.2	1050	9947452
	CAPT3743*4A*	G*VC81005C*B*	28,400	22,400	14.5	12.2	1,000	7547228
	CAPT3743*4A*	A*VC960603BNA*	28,400	22,400	14.5	12.2	1,040	7547277
	CAPT3743*4A*	G*VM970603BNA*	28,400	22,400	15.0	12.5	1,040	7547296
	CAPT3743*4A*	A*VC960403BNA*	28,400	22,400	14.5	12.2	1,000	7547272
	CAPT3743*4A*	G*EC960402BNA*	28,200	22,200	14.5	12.2	925	7547329
	CAPT3743*4A*	G*E80805C*B*	28,400	22,400	14.5	12.2	1,000	7547208
	CAPT3743*4A*	G*VC960804CNA*	28,400	22,400	14.5	12.2	1,000	7547265
	CAPT3743*4A*	A*EC960302BNA*	28,200	22,200	14.5	12.2	940	7547349
	CAPT3743*4A*	G*EC961004CNA*	28,600	22,600	14.5	12.2	1,025	7547344
	CAPT3743*4A*	G*E80603B*B*	28,400	22,400	14.5	12.2	1,050	7547203
	CAPT3743*4A*	G*EC960302BNA*	28,200	22,200	14.5	12.2	940	7547324
	CAPT3743*4A*	A*VC81005C*B*	28,400	22,400	14.5	12.2	1,000	7547243
	CAPT3743*4A*	G*VC960803BNA*	27,800	21,800	15.0	12.5	975	7547258
	CAPT3743*4A*	A*VM970804CNA*	28,400	22,400	14.5	12.2	1,000	7547317
	CAPT3743*4A*	A*EC960803BNA*	28,200	22,200	14.5	12.2	950	7547364
	CAPT3743*4A*	G*VM970804CNA*	28,400	22,400	14.5	12.2	1,000	7547303
	CAPT3743*4A*	G*VC960403BNA*	28,400	22,400	14.5	12.2	1,000	7547248
	CAPT3743*4A*	A*EC960402BNA*	28,200	22,200	14.5	12.2	925	7547354
	CAPT3743*4A*	G*VC960603BNA*	28,400	22,400	14.5	12.2	1,040	7547253
	CAPT3743*4A*	A*VM970603BNA*	28,400	22,400	15.0	12.5	1,040	7547310
	CAPT3743*4A*	A*VC960804CNA*	28,400	22,400	14.5	12.2	1,000	7547289
	CAPT3743*4A*	G*EC960803BNA*	28,200	22,200	14.5	12.2	950	7547339
CAPT3743*4A*	A*EC961004CNA*	28,600	22,600	14.5	12.2	1,025	7547369	
CAPT3743*4A*	G*VC80604B*B*	28,400	22,400	14.5	12.2	1,000	7547218	
CAPT3743*4A*	A*VC80604B*B*	28,400	22,400	14.5	12.2	1,000	7547233	
CAPT3743*4A*	A*VC960803BNA*	27,800	21,800	15.0	12.5	975	7547282	
CAPT3743*4A*+EEP			28,000	22,000	14.5	12.2	1,000	7547190

See Notes on Page 48.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0311K* (cont.)	CAPT3743*4A*+MBVC1200**-1A*		28,600	22,600	15.0	12.5	1,000	7547191
	CAPT3743*4A*+MBVC1600**-1A*		28,600	22,600	15.0	12.5	1,000	7547192
	CHPF3636B6C*+TXV	A*VC80603B*B*	28,400	23,000	14.5	12.2	1000	9947444
	CHPF3636B6C*+TXV	A*VC80803B*B*	28,400	23,000	14.5	12.2	950	9947449
	CHPF3636B6C*+TXV	A*VC960403BNA*	28,000	22,000	14.5	12.5	1,000	7547273
	CHPF3636B6C*+TXV	A*VC960803BNA*	28,000	22,000	14.5	12.2	975	7547283
	CHPF3636B6C*+TXV	G*VM970603BNA*	28,000	22,000	14.5	12.2	1,040	7547297
	CHPF3636B6C*+TXV	G*VC960603BNA*	28,000	22,000	14.5	12.2	1,040	7547254
	CHPF3636B6C*+TXV	G*VC960403BNA*	28,000	22,000	14.5	12.5	1,000	7547249
	CHPF3636B6C*+TXV	A*VC960603BNA*	28,000	22,000	14.5	12.2	1,040	7547278
	CHPF3636B6C*+TXV	A*VM970603BNA*	28,000	22,000	14.5	12.2	1,040	7547311
	CHPF3636B6C*+TXV	G*VC960803BNA*	28,000	22,000	14.5	12.2	975	7547259
	CHPF3642C6C*+EEP		28,600	22,600	14.0	12.2	1,000	7547193
	CHPF3642C6C*+EEP+TXV		28,000	22,000	14.5	12.2	1,000	7547194
	CHPF3642C6C*+MBVC1200**-1A*		28,000	22,000	14.5	12.2	1,000	7547195
	CHPF3642C6C*+MBVC1200**-1A*+TXV		28,000	22,000	14.5	12.2	1,000	7547196
	CHPF3642C6C*+MBVC1600**-1A*		28,000	22,000	14.5	12.2	1,000	7547197
	CHPF3642C6C*+MBVC1600**-1A*+TXV		28,400	22,400	15.0	12.5	1,000	7547198
	CHPF3642C6C*+TXV	A*VC80804C*B*	28,000	22,600	14.5	12.2	1000	9947453
	CHPF3642C6C*+TXV	A*EC960402BNA*	28,400	22,400	15.0	12.5	925	7547355
	CHPF3642C6C*+TXV	G*EC960402BNA*	28,400	22,400	15.0	12.5	925	7547330
	CHPF3642C6C*+TXV	G*VC80604B*B*	28,000	22,000	14.5	12.2	1,000	7547219
	CHPF3642C6C*+TXV	A*EC960302BNA*	28,400	22,400	14.5	12.2	940	7547350
	CHPF3642C6C*+TXV	G*EC960803BNA*	28,400	22,400	14.5	12.2	950	7547340
	CHPF3642C6C*+TXV	A*EC960603BNA*	28,400	22,400	14.5	12.2	965	7547360
	CHPF3642C6C*+TXV	A*EC960803BNA*	28,400	22,400	14.5	12.2	950	7547365
	CHPF3642C6C*+TXV	G*EC960603BNA*	28,400	22,400	14.5	12.2	965	7547335
	CHPF3642C6C*+TXV	G*EC960302BNA*	28,400	22,400	14.5	12.2	940	7547325
	CHPF3642C6C*+TXV	A*VC80604B*B*	28,000	22,000	14.5	12.2	1,000	7547234
	CHPF3642C6C*+TXV	G*E80603B*B*	28,000	22,000	14.5	12.2	1,050	7547204
	CHPF3642D6C*	G*VM970804CNA*	28,600	22,600	14.5	12.2	1,000	7547304
	CHPF3642D6C*	G*VC960804CNA*	28,600	22,600	14.5	12.2	1,000	7547266
	CHPF3642D6C*	A*VC960804CNA*	28,600	22,600	14.5	12.2	1,000	7547290
	CHPF3642D6C*	A*VM970804CNA*	28,600	22,600	14.5	12.2	1,000	7547318
	CHPF3642D6C*+TXV	A*VC80805D*B*	28,400	23,000	15.0	12.5	1000	9947456
	CHPF3642D6C*+TXV	A*VC960804CNA*	28,600	22,600	14.5	12.2	1,000	7547291
	CHPF3642D6C*+TXV	G*VC80805C*B*	28,600	22,600	15.0	12.5	990	7547224
	CHPF3642D6C*+TXV	G*VC81005C*B*	28,600	22,600	14.5	12.2	1,000	7547229
	CHPF3642D6C*+TXV	G*E80805C*B*	28,000	22,000	15.0	12.5	1,000	7547209
	CHPF3642D6C*+TXV	A*EC961004CNA*	28,800	22,600	15.0	12.5	1,025	7547370
	CHPF3642D6C*+TXV	A*VM970804CNA*	28,600	22,600	14.5	12.2	1,000	7547319
	CHPF3642D6C*+TXV	G*VM970804CNA*	28,600	22,600	14.5	12.2	1,000	7547305
	CHPF3642D6C*+TXV	A*VC81005C*B*	28,600	22,600	14.5	12.2	1,000	7547244
	CHPF3642D6C*+TXV	G*EC961004CNA*	28,800	22,600	15.0	12.5	1,025	7547345
	CHPF3642D6C*+TXV	A*VC80805C*B*	28,600	22,600	15.0	12.5	990	7547239
	CHPF3642D6C*+TXV	G*E81005C*B*	28,600	22,600	15.0	12.5	1,000	7547214
	CHPF3642D6C*+TXV	G*VC960804CNA*	28,600	22,600	14.5	12.2	1,000	7547267
	CSCF3642N6D*	A*VM970804CNA*	28,600	22,600	15.0	12.5	1,000	7547320
	CSCF3642N6D*	G*VC960804CNA*	28,800	22,600	15.0	12.5	1,000	7547268
	CSCF3642N6D*	A*VC960804CNA*	28,800	22,600	15.0	12.5	1,000	7547292
CSCF3642N6D*	G*VM970804CNA*	28,600	22,600	15.0	12.5	1,000	7547306	
CSCF3642N6D*+EEP		28,400	22,400	14.0	12.2	1,000	7547199	
CSCF3642N6D*+EEP+TXV		28,400	22,400	14.5	12.2	1,000	7547200	

See Notes on Page 48.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0311K* (cont.)	CSCF3642N6D*+TXV	A*VC80603B*B*	28,600	23,200	15.0	12.5	1000	9947445
	CSCF3642N6D*+TXV	A*VC80803B*B*	28,600	23,200	15.0	12.5	1050	9947450
	CSCF3642N6D*+TXV	A*VC80804C*B*	28,600	23,200	15.0	12.5	1050	9947454
	CSCF3642N6D*+TXV	A*VC80805D*B*	28,400	23,000	15.0	12.5	1000	9947457
	CSCF3642N6D*+TXV	G*VC81005C*B*	28,600	22,600	15.0	12.5	1,000	7547230
	CSCF3642N6D*+TXV	G*VM970603BNA*	28,400	22,400	15.0	12.5	1,040	7547298
	CSCF3642N6D*+TXV	G*EC961004CNA*	28,400	22,400	14.5	12.2	1,025	7547346
	CSCF3642N6D*+TXV	A*EC960402BNA*	28,400	22,400	14.5	12.2	925	7547356
	CSCF3642N6D*+TXV	A*EC961004CNA*	28,400	22,400	14.5	12.2	1,025	7547371
	CSCF3642N6D*+TXV	G*EC960402BNA*	28,400	22,400	14.5	12.2	925	7547331
	CSCF3642N6D*+TXV	A*VC960603BNA*	28,400	22,400	15.0	12.5	1,040	7547279
	CSCF3642N6D*+TXV	G*EC960603BNA*	28,400	22,400	14.5	12.2	965	7547336
	CSCF3642N6D*+TXV	A*EC960803BNA*	28,400	22,400	14.5	12.2	950	7547366
	CSCF3642N6D*+TXV	A*VC81005C*B*	28,600	22,600	15.0	12.5	1,000	7547245
	CSCF3642N6D*+TXV	A*VM970603BNA*	28,400	22,400	15.0	12.5	1,040	7547312
	CSCF3642N6D*+TXV	G*E81005C*B*	28,400	22,400	15.0	12.5	1,000	7547215
	CSCF3642N6D*+TXV	A*VC960403BNA*	28,600	22,600	15.0	12.5	1,000	7547274
	CSCF3642N6D*+TXV	G*VC960803BNA*	28,400	22,400	15.0	12.5	975	7547260
	CSCF3642N6D*+TXV	A*EC960603BNA*	28,400	22,400	14.5	12.2	965	7547361
	CSCF3642N6D*+TXV	G*VC80604B*B*	28,600	22,600	15.0	12.5	1,000	7547220
	CSCF3642N6D*+TXV	A*VM970804CNA*	28,600	22,600	15.0	12.5	1,000	7547321
	CSCF3642N6D*+TXV	G*VC960804CNA*	28,800	22,600	15.0	12.5	1,000	7547269
	CSCF3642N6D*+TXV	G*EC960302BNA*	28,400	22,400	14.5	12.2	940	7547326
	CSCF3642N6D*+TXV	G*VM970804CNA*	28,600	22,600	15.0	12.5	1,000	7547307
	CSCF3642N6D*+TXV	A*VC80805C*B*	28,400	22,400	15.0	12.5	990	7547240
	CSCF3642N6D*+TXV	A*VC960804CNA*	28,800	22,600	15.0	12.5	1,000	7547293
	CSCF3642N6D*+TXV	G*EC960803BNA*	28,400	22,400	14.5	12.2	950	7547341
	CSCF3642N6D*+TXV	A*VC960803BNA*	28,400	22,400	15.0	12.5	975	7547284
	CSCF3642N6D*+TXV	G*VC80805C*B*	28,400	22,400	15.0	12.5	990	7547225
	CSCF3642N6D*+TXV	G*VC960403BNA*	28,600	22,600	15.0	12.5	1,000	7547250
CSCF3642N6D*+TXV	G*E80805C*B*	28,400	22,400	15.0	12.5	1,000	7547210	
CSCF3642N6D*+TXV	G*VC960603BNA*	28,400	22,400	15.0	12.5	1,040	7547255	
CSCF3642N6D*+TXV	G*E80603B*B*	28,600	22,600	15.0	12.5	1,050	7547205	
CSCF3642N6D*+TXV	A*EC960302BNA*	28,400	22,400	14.5	12.2	940	7547351	
CSCF3642N6D*+TXV	A*VC80604B*B*	28,600	22,600	15.0	12.5	1,000	7547235	
ASX14 0361K*	ARUF37C14A*		33,600	25,000	14.0	11.5	1,050	7989017
	ARUF37D14A*		33,600	25,000	14.0	11.5	1,240	8171743
	ASPT36C14A*		34,200	25,400	14.5	11.5	1,210	7547372
	ASPT37C14A*		34,200	25,400	14.5	12.0	1,120	8245632
	ASPT47C14A*		34,200	25,400	14.5	12.0	1,120	8245633
	ASPT47D14A*		34,600	25,600	15.0	12.5	1,205	8245635
	AVPTC36C14A*		34,200	25,400	14.5	11.5	1,100	7547374
	AVPTC37C14A*		34,200	25,400	14.5	12.0	1,130	8996360
	AVPTC37D14A*		34,600	25,600	14.5	12.2	1,145	8996361
	AVPTC42D14A*		34,800	25,800	14.5	12.0	1,120	7547375
	AVPTC49D14A*		35,000	26,000	15.0	12.5	1,075	8996362
	AWUF37XX16B*+TXV		33,000	24,400	14.5	11.5	1,050	7547376
	CA*F3137*6A*+EEP		34,000	25,200	14.0	11.5	1,200	8191560
	CA*F3137*6A*+EEP+TXV		34,000	25,200	14.0	11.5	1,200	8191561
	CA*F3137*6A*+TXV	A*VC80603B*B*	33,400	25,400	14.5	12.0	1200	9947458
	CA*F3137*6A*+TXV	A*VC80803B*B*	33,400	25,400	14.5	12.0	1150	9947463
	CA*F3137*6A*+TXV	A*VC960803BNA*	34,400	25,400	14.0	11.5	1,150	8191585
	CA*F3137*6A*+TXV	A*EC960603BNA*	34,200	25,400	14.0	11.5	1,100	8191588

See Notes on Page 48.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0361K* (cont.)	CA*F3137*6A*+TXV	A*VM970803BNA*	34,400	25,400	14.0	11.5	1,150	8191587
	CA*F3137*6A*+TXV	G*VC960603BNA*	34,400	25,400	14.0	11.5	1,200	8191565
	CA*F3137*6A*+TXV	A*VM970603BNA*	34,400	25,400	14.0	11.5	1,200	8191586
	CA*F3137*6A*+TXV	A*VC960403BNA*	34,200	25,400	14.0	11.5	1,200	8191583
	CA*F3137*6A*+TXV	G*EC960803BNA*	34,200	25,400	14.0	11.5	1,100	8191570
	CA*F3137*6A*+TXV	A*VC960603BNA*	34,400	25,400	14.0	11.5	1,200	8191584
	CA*F3137*6A*+TXV	A*VC80604B*B*	33,600	25,000	14.0	11.5	1,240	8191582
	CA*F3137*6A*+TXV	G*EC960603BNA*	34,200	25,400	14.0	11.5	1,100	8191569
	CA*F3137*6A*+TXV	G*VM970603BNA*	34,400	25,400	14.0	11.5	1,200	8191567
	CA*F3137*6A*+TXV	G*VC960803BNA*	34,400	25,400	14.0	11.5	1,150	8191566
	CA*F3137*6A*+TXV	G*VM970803BNA*	34,400	25,400	14.0	11.5	1,150	8191568
	CA*F3137*6A*+TXV	A*EC960803BNA*	34,200	25,400	14.0	11.5	1,100	8191589
	CA*F3137*6A*+TXV	G*VC80604B*B*	33,600	25,000	14.0	11.5	1,240	8191563
	CA*F3137*6A*+TXV	A*EH800603B*A*	33,400	24,800	14.0	11.5	1,100	8191581
	CA*F3137*6A*+TXV	G*VC960403BNA*	34,200	25,400	14.0	11.5	1,200	8191564
	CA*F3137*6A*+TXV	G*E80603B*B*	33,400	24,800	14.0	11.5	1,100	8191562
	CA*F3642*6D*+EHP		34,000	25,200	14.0	11.5	1,200	7547377
	CA*F3642*6D*+EHP+TXV		34,000	25,200	14.0	11.5	1,200	7547378
	CA*F3642*6D*+MBVC1600**-1A*		34,000	25,200	14.5	11.5	1,200	7547379
	CA*F3642*6D*+MBVC2000**-1A*		34,000	25,200	14.5	12.0	1,200	7547380
	CA*F3743*6D*	A*VC80805D*B*	33,600	25,600	14.5	11.5	1,200	9947472
	CA*F3743*6D*	A*EC961004CNA*	34,600	25,600	14.5	11.5	1,250	7540152
	CA*F3743*6D*	G*VM970804CNA*	34,600	25,600	14.5	11.5	1,190	7540070
	CA*F3743*6D*	A*VC81005C*B*	33,400	24,800	14.5	11.5	1,200	7539991
	CA*F3743*6D*	A*VM971005CNA*	34,600	25,600	14.5	11.5	1,175	7540104
	CA*F3743*6D*	G*VC961205DNA*	34,600	25,600	14.5	11.5	1,200	7540022
	CA*F3743*6D*	A*VC961005CNA*	34,600	25,600	14.5	11.5	1,175	7540047
	CA*F3743*6D*	G*EC961004CNA*	34,600	25,600	14.5	11.5	1,250	7540125
	CA*F3743*6D*	A*EC961205DNA*	34,000	25,200	14.5	11.5	1,075	7540162
	CA*F3743*6D*	A*VM971205DNA*	34,600	25,600	14.5	11.5	1,200	7540111
	CA*F3743*6D*	G*E81005C*B*	34,000	25,200	14.5	11.5	1,230	7539956
	CA*F3743*6D*	G*VC81005C*B*	33,400	24,800	14.5	11.5	1,200	7539973
	CA*F3743*6D*	G*VM971205DNA*	34,600	25,600	14.5	11.5	1,200	7540084
	CA*F3743*6D*	G*VC961005CNA*	34,600	25,600	14.5	11.5	1,175	7540015
	CA*F3743*6D*	A*VM970804CNA*	34,600	25,600	14.5	11.5	1,190	7540097
	CA*F3743*6D*	G*E80805C*B*	33,600	25,000	14.5	11.5	1,210	7539949
	CA*F3743*6D*	A*VC961205DNA*	34,600	25,600	14.5	11.5	1,200	7540054
	CA*F3743*6D*	A*VC960804CNA*	34,600	25,600	14.5	11.5	1,190	7540039
	CA*F3743*6D*	A*VC80805C*B*	33,600	25,000	14.5	11.5	1,200	7539984
	CA*F3743*6D*	G*EC961205DNA*	34,000	25,200	14.5	11.5	1,075	7540135
	CA*F3743*6D*	G*VM971005CNA*	34,600	25,600	14.5	11.5	1,175	7540077
	CA*F3743*6D*	G*VC960804CNA*	34,600	25,600	14.5	11.5	1,190	7540008
	CA*F3743*6D*	G*VC80805C*B*	33,600	25,000	14.5	11.5	1,200	7539966
	CA*F3743*6D*+EHP		34,600	25,600	14.0	11.5	1,200	7547381
	CA*F3743*6D*+EHP+TXV		34,600	25,600	14.5	11.5	1,200	7547382
	CA*F3743*6D*+MBVC1600**-1A*		35,000	26,000	14.5	11.5	1,200	7547383
	CA*F3743*6D*+MBVC2000**-1A*		35,000	26,000	14.5	11.5	1,200	7547384
	CA*F3743*6D*+TXV	A*VC80603B*B*	33,400	25,400	14.5	11.5	1,200	9947459
	CA*F3743*6D*+TXV	A*VC80803B*B*	33,400	25,400	14.5	11.5	1,150	9947464
	CA*F3743*6D*+TXV	A*VC80804C*B*	33,600	25,600	14.5	11.5	1,250	9947468
CA*F3743*6D*+TXV	A*VC80805D*B*	33,600	25,600	14.5	12.0	1,200	9947473	
CA*F3743*6D*+TXV	G*VM971205DNA*	34,600	25,600	14.5	12.0	1,200	7540086	
CA*F3743*6D*+TXV	A*EC961205DNA*	34,000	25,200	14.5	12.0	1,075	7540164	

See Notes on Page 74.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0361K* (cont.)	CA*F3743*6D*+TXV	G*VM970804CNA*	34,600	25,600	14.5	11.5	1,190	7540072
	CA*F3743*6D*+TXV	G*VC81005C*B*	33,400	24,800	14.5	12.0	1,200	7539975
	CA*F3743*6D*+TXV	G*EC961205DNA*	34,000	25,200	14.5	12.0	1,075	7540137
	CA*F3743*6D*+TXV	G*VC960403BNA*	34,200	25,400	14.5	11.5	1,200	7539997
	CA*F3743*6D*+TXV	A*EC960803BNA*	34,200	25,400	14.5	11.5	1,150	7540148
	CA*F3743*6D*+TXV	G*VC961205DNA*	34,600	25,600	14.5	12.0	1,200	7540024
	CA*F3743*6D*+TXV	A*VM971205DNA*	34,600	25,600	14.5	12.0	1,200	7540113
	CA*F3743*6D*+TXV	G*VC960803BNA*	34,400	25,400	14.5	11.5	1,250	7540004
	CA*F3743*6D*+TXV	A*VC960603BNA*	34,400	25,400	14.5	11.5	1,250	7540032
	CA*F3743*6D*+TXV	A*VC80604B*B*	33,600	25,000	14.5	11.5	1,220	7539980
	CA*F3743*6D*+TXV	A*VC960804CNA*	34,600	25,600	14.5	12.0	1,190	7540041
	CA*F3743*6D*+TXV	G*VM970603BNA*	34,400	25,400	14.5	11.5	1,250	7540062
	CA*F3743*6D*+TXV	G*E81005C*B*	34,000	25,200	14.5	11.5	1,230	7539958
	CA*F3743*6D*+TXV	A*VC960803BNA*	34,400	25,400	14.5	11.5	1,250	7540036
	CA*F3743*6D*+TXV	G*VC80604B*B*	33,600	25,000	14.5	11.5	1,220	7539963
	CA*F3743*6D*+TXV	A*VM970804CNA*	34,600	25,600	14.5	11.5	1,190	7540099
	CA*F3743*6D*+TXV	A*VC961005CNA*	34,600	25,600	14.5	12.0	1,175	7540049
	CA*F3743*6D*+TXV	G*VC80805C*B*	33,600	25,000	14.5	12.0	1,200	7539968
	CA*F3743*6D*+TXV	G*VC960603BNA*	34,400	25,400	14.5	11.5	1,250	7540001
	CA*F3743*6D*+TXV	A*VC960403BNA*	34,200	25,400	14.5	11.5	1,200	7540029
	CA*F3743*6D*+TXV	A*VM970603BNA*	34,400	25,400	14.5	11.5	1,250	7540090
	CA*F3743*6D*+TXV	G*E80603B*B*	33,400	24,800	14.5	11.5	1,250	7547400
	CA*F3743*6D*+TXV	G*EC960603BNA*	34,200	25,400	14.5	11.5	1,150	7540118
	CA*F3743*6D*+TXV	G*VM970803BNA*	34,400	25,400	14.5	11.5	1,250	7540066
	CA*F3743*6D*+TXV	A*VC81005C*B*	33,400	24,800	14.5	12.0	1,200	7539993
	CA*F3743*6D*+TXV	G*EC961004CNA*	34,600	25,600	14.5	11.5	1,250	7540127
	CA*F3743*6D*+TXV	A*VM970803BNA*	34,400	25,400	14.5	11.5	1,250	7540094
	CA*F3743*6D*+TXV	G*VC960804CNA*	34,600	25,600	14.5	12.0	1,190	7540010
	CA*F3743*6D*+TXV	A*EC961004CNA*	34,600	25,600	14.5	11.5	1,250	7540154
	CA*F3743*6D*+TXV	G*VC961005CNA*	34,600	25,600	14.5	12.0	1,175	7540017
	CA*F3743*6D*+TXV	G*VM971005CNA*	34,600	25,600	14.5	11.5	1,175	7540079
	CA*F3743*6D*+TXV	G*EC960803BNA*	34,200	25,400	14.5	11.5	1,150	7540122
	CA*F3743*6D*+TXV	A*VC961205DNA*	34,600	25,600	14.5	12.0	1,200	7540057
	CA*F3743*6D*+TXV	A*VM971005CNA*	34,600	25,600	14.5	11.5	1,175	7540106
	CA*F3743*6D*+TXV	G*E80805C*B*	33,600	25,000	14.5	11.5	1,210	7539951
	CA*F3743*6D*+TXV	A*VC80805C*B*	33,600	25,000	14.5	12.0	1,200	7539986
	CA*F3743*6D*+TXV	A*EC960603BNA*	34,200	25,400	14.5	11.5	1,150	7540144
	CA*F4860*6D*+EEP		34,800	25,800	14.0	11.5	1,200	7547388
	CA*F4860*6D*+EEP+TXV		34,800	25,800	14.0	11.5	1,200	7547389
	CAPT3743*4A*	A*VC80603B*B*	33,600	25,600	14.5	11.5	1200	9947460
	CAPT3743*4A*	A*VC80803B*B*	33,600	25,600	14.5	11.5	1150	9947465
	CAPT3743*4A*	A*VC80804C*B*	33,600	25,600	14.5	11.5	1250	9947469
	CAPT3743*4A*	A*VC80805D*B*	33,600	25,600	14.5	11.5	1200	9947474
	CAPT3743*4A*	G*VM971205DNA*	34,400	25,400	14.5	11.5	1,200	7547502
	CAPT3743*4A*	G*VC81005C*B*	33,400	24,800	14.5	11.5	1,200	7547420
	CAPT3743*4A*	G*VC960403BNA*	34,000	25,200	14.5	11.5	1,200	7547438
	CAPT3743*4A*	G*VM970803BNA*	34,200	25,400	14.5	11.5	1,250	7547489
	CAPT3743*4A*	A*EC960803BNA*	34,200	25,400	14.0	11.5	1,150	7547533
CAPT3743*4A*	A*VM970603BNA*	34,200	25,400	14.5	11.5	1,250	7547507	
CAPT3743*4A*	A*VC81005C*B*	33,400	24,800	14.5	11.5	1,200	7547433	
CAPT3743*4A*	A*VC80604B*B*	33,600	25,000	14.5	11.5	1,220	7547425	
CAPT3743*4A*	A*VM970803BNA*	34,200	25,400	14.5	11.5	1,250	7547510	
CAPT3743*4A*	G*VM970804CNA*	34,600	25,600	14.5	11.5	1,190	7547492	

See Notes on Page 74.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0361K* (cont.)	CAPT3743*4A*	G*EC961004CNA*	34,600	25,600	14.5	11.5	1,250	7540129
	CAPT3743*4A*	A*VC80805C*B*	33,600	25,000	14.5	11.5	1,200	7547428
	CAPT3743*4A*	G*E80805C*B*	33,600	25,000	14.5	11.5	1,210	7547402
	CAPT3743*4A*	A*VM971005CNA*	34,600	25,600	14.5	11.5	1,175	7547518
	CAPT3743*4A*	G*E81005C*B*	34,000	25,200	14.5	11.5	1,230	7547407
	CAPT3743*4A*	A*VC961205DNA*	34,400	25,400	14.5	11.5	1,200	7547481
	CAPT3743*4A*	G*VC961205DNA*	34,400	25,400	14.5	11.5	1,200	7547457
	CAPT3743*4A*	G*VC960603BNA*	34,200	25,400	14.5	11.5	1,250	7547441
	CAPT3743*4A*	G*VC80604B*B*	33,600	25,000	14.5	11.5	1,220	7547412
	CAPT3743*4A*	G*VC961005CNA*	34,600	25,600	14.5	11.5	1,175	7547452
	CAPT3743*4A*	A*VC961005CNA*	34,600	25,600	14.5	11.5	1,175	7547476
	CAPT3743*4A*	A*VC960603BNA*	34,200	25,400	14.5	11.5	1,250	7547465
	CAPT3743*4A*	G*VM970603BNA*	34,200	25,400	14.5	11.5	1,250	7547486
	CAPT3743*4A*	G*EC961205DNA*	34,000	25,200	14.5	11.5	1,075	7540139
	CAPT3743*4A*	G*VM971005CNA*	34,600	25,600	14.5	11.5	1,175	7547497
	CAPT3743*4A*	A*EC961205DNA*	34,000	25,200	14.5	11.5	1,075	7540166
	CAPT3743*4A*	A*VM971205DNA*	34,400	25,400	14.5	11.5	1,200	7547523
	CAPT3743*4A*	A*VM970804CNA*	34,600	25,600	14.5	11.5	1,190	7547513
	CAPT3743*4A*	A*EC960603BNA*	34,200	25,400	14.0	11.5	1,150	7540146
	CAPT3743*4A*	A*VC960803BNA*	34,200	25,400	14.5	11.5	1,250	7547468
	CAPT3743*4A*	A*VC960804CNA*	34,600	25,600	14.5	11.5	1,190	7547471
	CAPT3743*4A*	A*VC960403BNA*	34,000	25,200	14.5	11.5	1,200	7547462
	CAPT3743*4A*	G*VC960803BNA*	34,200	25,400	14.5	11.5	1,250	7547444
	CAPT3743*4A*	G*VC960804CNA*	34,600	25,600	14.5	11.5	1,190	7547447
	CAPT3743*4A*	G*VC80805C*B*	33,600	25,000	14.5	11.5	1,200	7547415
	CAPT3743*4A*	A*EC961004CNA*	34,600	25,600	14.5	11.5	1,250	7540156
	CAPT3743*4A*	G*EC960803BNA*	34,200	25,400	14.0	11.5	1,150	7547529
	CAPT3743*4A*	G*EC960603BNA*	34,200	25,400	14.0	11.5	1,150	7540120
	CAPT3743*4A*+EEP		34,600	25,600	14.5	11.5	1,200	7547385
	CAPT3743*4A*+MBVC1600**-1A*		34,000	25,200	14.5	11.5	1,205	7547386
	CAPT3743*4A*+MBVC2000**-1A*		34,000	25,200	14.5	11.5	1,205	7547387
	CHPF3642C6C*	G*E80805C*B*	33,600	25,000	14.5	11.5	1,210	7547403
	CHPF3642C6C*	G*E81005C*B*	34,000	25,200	14.5	11.5	1,230	7547408
	CHPF3642C6C*+EEP		34,600	25,600	14.0	11.5	1,200	7547390
	CHPF3642C6C*+EEP+TXV		34,600	25,600	14.0	11.5	1,200	7547391
	CHPF3642C6C*+MBVC1600**-1A*		35,000	26,000	14.5	11.5	1,200	7547392
	CHPF3642C6C*+TXV	G*E80805C*B*	33,600	25,000	14.5	11.5	1,210	7547404
	CHPF3642C6C*+TXV	G*E81005C*B*	34,000	25,200	14.5	12.0	1,230	7547409
	CHPF3642C6C*+TXV	G*EC960803BNA*	34,200	25,400	14.5	11.5	1,150	7547530
	CHPF3642C6C*+TXV	G*EC960603BNA*	34,200	25,400	14.5	11.5	1,150	7547528
	CHPF3642C6C*+TXV	G*E80603B*B*	33,400	24,800	14.5	11.5	1,250	7547401
	CHPF3642C6C*+TXV	A*EH800603B*A*	33,400	24,800	14.5	11.5	1,250	8953010
	CHPF3642C6C*+TXV	A*EC960603BNA*	34,200	25,400	14.5	11.5	1,150	7547532
	CHPF3642C6C*+TXV	A*EC960803BNA*	34,200	25,400	14.5	11.5	1,150	7547534
	CHPF3743C6B*	A*VC80805D*B*	33,600	25,600	14.5	11.5	1100	9947475
	CHPF3743C6B*	A*VC81005C*B*	33,400	24,800	14.5	11.5	1,200	7547434
	CHPF3743C6B*	A*VM971005CNA*	34,600	25,600	14.5	11.5	1,175	7547519
	CHPF3743C6B*	G*VC960804CNA*	34,600	25,600	14.5	11.5	1,190	7547448
	CHPF3743C6B*	G*VC80805C*B*	33,600	25,000	14.5	11.5	1,200	7547416
	CHPF3743C6B*	A*VC961005CNA*	34,600	25,600	14.5	11.5	1,175	7547477
CHPF3743C6B*	G*VC961005CNA*	34,600	25,600	14.5	11.5	1,175	7547453	
CHPF3743C6B*	G*VM971005CNA*	34,600	25,600	14.5	11.5	1,175	7547498	
CHPF3743C6B*	A*VC960804CNA*	34,600	25,600	14.5	11.5	1,190	7547472	
CHPF3743C6B*	A*EC961004CNA*	34,600	25,600	14.5	11.5	1,250	7540158	

See Notes on Page 74.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0361K* (cont.)	CHPF3743C6B*	G*EC961004CNA*	34,600	25,600	14.5	11.5	1,250	7540131
	CHPF3743C6B*	A*VC80805C*B*	33,600	25,000	14.5	11.5	1,200	7547429
	CHPF3743C6B*	G*VC81005C*B*	33,400	24,800	14.5	11.5	1,200	7547421
	CHPF3743C6B*	A*VM970804CNA*	34,600	25,600	14.5	11.5	1,190	7547514
	CHPF3743C6B*	G*VM970804CNA*	34,600	25,600	14.5	11.5	1,190	7547493
	CHPF3743C6B*+EEP		34,000	25,200	14.0	11.5	1,150	7547393
	CHPF3743C6B*+EEP+TXV		34,000	25,200	14.5	11.5	1,150	7547394
	CHPF3743C6B*+MBVC1600**-1A*		35,000	26,000	14.5	11.5	1,200	7547395
	CHPF3743C6B*+TXV	A*VC80603B*B*	33,600	25,600	14.5	12.0	1100	9947461
	CHPF3743C6B*+TXV	A*VC80803B*B*	33,600	25,600	14.5	12.0	1150	9947466
	CHPF3743C6B*+TXV	A*VC80804C*B*	33,600	25,600	14.5	11.5	1100	9947470
	CHPF3743C6B*+TXV	A*VC80805D*B*	33,600	25,600	14.5	12.0	1100	9947476
	CHPF3743C6B*+TXV	G*VM970803BNA*	34,400	25,400	14.5	11.5	1,250	7547490
	CHPF3743C6B*+TXV	A*VC960804CNA*	34,600	25,600	14.5	12.0	1,190	7547473
	CHPF3743C6B*+TXV	A*VM970804CNA*	34,600	25,600	14.5	11.5	1,190	7547515
	CHPF3743C6B*+TXV	G*VC81005C*B*	33,400	24,800	14.5	12.0	1,200	7547422
	CHPF3743C6B*+TXV	A*VC80604B*B*	33,600	25,000	14.5	11.5	1,220	7547426
	CHPF3743C6B*+TXV	G*EC961004CNA*	34,600	25,600	14.5	11.5	1,250	7540133
	CHPF3743C6B*+TXV	A*EC961004CNA*	34,600	25,600	14.5	11.5	1,250	7540160
	CHPF3743C6B*+TXV	A*VC960803BNA*	34,400	25,400	14.5	11.5	1,250	7547469
	CHPF3743C6B*+TXV	A*VC80805C*B*	33,600	25,000	14.5	12.0	1,200	7547430
	CHPF3743C6B*+TXV	G*VC80805C*B*	33,600	25,000	14.5	12.0	1,200	7547417
	CHPF3743C6B*+TXV	A*VC960403BNA*	34,200	25,400	14.5	11.5	1,200	7547463
	CHPF3743C6B*+TXV	A*VM970603BNA*	34,400	25,400	14.5	11.5	1,250	7547508
	CHPF3743C6B*+TXV	A*VM971005CNA*	34,600	25,600	14.5	11.5	1,175	7547520
	CHPF3743C6B*+TXV	G*VM970804CNA*	34,600	25,600	14.5	11.5	1,190	7547494
	CHPF3743C6B*+TXV	G*VC960403BNA*	34,200	25,400	14.5	11.5	1,200	7547439
	CHPF3743C6B*+TXV	A*VM970803BNA*	34,400	25,400	14.5	11.5	1,250	7547511
	CHPF3743C6B*+TXV	G*VM971005CNA*	34,600	25,600	14.5	11.5	1,175	7547499
	CHPF3743C6B*+TXV	G*VC960804CNA*	34,600	25,600	14.5	12.0	1,190	7547449
	CHPF3743C6B*+TXV	A*VC960603BNA*	34,400	25,400	14.5	11.5	1,250	7547466
	CHPF3743C6B*+TXV	A*VC961005CNA*	34,600	25,600	14.5	12.0	1,175	7547478
	CHPF3743C6B*+TXV	G*VC80604B*B*	33,600	25,000	14.5	11.5	1,220	7547413
	CHPF3743C6B*+TXV	G*VC961005CNA*	34,600	25,600	14.5	12.0	1,175	7547454
	CHPF3743C6B*+TXV	G*VM970603BNA*	34,400	25,400	14.5	11.5	1,250	7547487
	CHPF3743C6B*+TXV	A*VC81005C*B*	33,400	24,800	14.5	12.0	1,200	7547435
	CHPF3743C6B*+TXV	G*VC960603BNA*	34,400	25,400	14.5	11.5	1,250	7547442
	CHPF3743C6B*+TXV	G*VC960803BNA*	34,400	25,400	14.5	11.5	1,250	7547445
	CHPF3743D6B*	G*EC961205DNA*	34,000	25,200	14.5	11.5	1,075	7540141
	CHPF3743D6B*	A*EC961205DNA*	34,000	25,200	14.5	11.5	1,075	7540168
	CHPF3743D6B*	A*VM971205DNA*	34,600	25,600	14.5	11.5	1,200	7547524
	CHPF3743D6B*	A*VC961205DNA*	34,600	25,600	14.5	11.5	1,200	7547482
	CHPF3743D6B*	G*VC961205DNA*	34,600	25,600	14.5	11.5	1,200	7547458
	CHPF3743D6B*	G*VM971205DNA*	34,600	25,600	14.5	11.5	1,200	7547503
	CHPF3743D6B*+EEP		34,600	25,600	14.5	11.5	1,150	7547396
	CHPF3743D6B*+EEP+TXV		34,600	25,600	14.5	12.0	1,150	7547397
	CHPF3743D6B*+TXV	A*VC961205DNA*	34,600	25,600	14.5	12.0	1,200	7547483
	CHPF3743D6B*+TXV	A*VM971205DNA*	34,600	25,600	14.5	12.0	1,200	7547525
CHPF3743D6B*+TXV	A*EC961205DNA*	34,000	25,200	14.5	12.0	1,075	7547535	
CHPF3743D6B*+TXV	G*EC961205DNA*	34,000	25,200	14.5	12.0	1,075	7547531	
CHPF3743D6B*+TXV	G*VC961205DNA*	34,600	25,600	14.5	12.0	1,200	7547459	
CHPF3743D6B*+TXV	G*VM971205DNA*	34,600	25,600	14.5	12.0	1,200	7547504	
CSCF4860N6D*	A*VC80805D*B*	33,600	25,600	14.5	11.5	1200	9947477	
CSCF4860N6D*	G*VM971005CNA*	34,600	25,600	14.5	11.5	1,175	7547500	

See Notes on Page 74.



OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0361K* (cont.)	CSCF4860N6D*	G*VC81005C*B*	33,400	24,800	14.5	11.5	1,200	7547423
	CSCF4860N6D*	A*VC960804CNA*	34,600	25,600	14.5	11.5	1,190	7547474
	CSCF4860N6D*	A*VM970804CNA*	34,600	25,600	14.5	11.5	1,190	7547516
	CSCF4860N6D*	G*VC960804CNA*	34,600	25,600	14.5	11.5	1,190	7547450
	CSCF4860N6D*	G*VC961205DNA*	34,600	25,600	14.5	11.5	1,200	7547460
	CSCF4860N6D*	G*E80805C*B*	33,600	25,000	14.5	11.5	1,210	7547405
	CSCF4860N6D*	G*VC80805C*B*	33,600	25,000	14.5	11.5	1,200	7547418
	CSCF4860N6D*	G*E81005C*B*	34,000	25,200	14.5	11.5	1,230	7547410
	CSCF4860N6D*	A*VM971005CNA*	34,600	25,600	14.5	11.5	1,175	7547521
	CSCF4860N6D*	A*VC961205DNA*	34,600	25,600	14.5	11.5	1,200	7547484
	CSCF4860N6D*	A*VC81005C*B*	33,400	24,800	14.5	11.5	1,200	7547436
	CSCF4860N6D*	G*VC961005CNA*	34,600	25,600	14.5	11.5	1,175	7547455
	CSCF4860N6D*	G*VM971205DNA*	34,600	25,600	14.5	11.5	1,200	7547505
	CSCF4860N6D*	G*VM970804CNA*	34,600	25,600	14.5	11.5	1,190	7547495
	CSCF4860N6D*	A*VM971205DNA*	34,600	25,600	14.5	11.5	1,200	7547526
	CSCF4860N6D*	A*VC961005CNA*	34,600	25,600	14.5	11.5	1,175	7547479
	CSCF4860N6D*	A*VC80805C*B*	33,600	25,000	14.5	11.5	1,200	7547431
	CSCF4860N6D*+EEP		34,600	25,600	14.0	11.5	1,200	7547398
	CSCF4860N6D*+EEP+TXV		34,600	25,600	14.0	11.5	1,200	7547399
	CSCF4860N6D*+TXV	A*VC80603B*B*	33,400	25,400	14.5	11.5	1,200	9947462
	CSCF4860N6D*+TXV	A*VC80803B*B*	33,400	25,400	14.5	11.5	1,150	9947467
	CSCF4860N6D*+TXV	A*VC80804C*B*	33,600	25,600	14.5	11.5	1,250	9947471
	CSCF4860N6D*+TXV	A*VC80805D*B*	33,600	25,600	14.5	12.0	1,200	9947478
	CSCF4860N6D*+TXV	G*VC80604B*B*	33,600	25,000	14.5	11.5	1,220	7547414
	CSCF4860N6D*+TXV	G*VC961205DNA*	34,600	25,600	14.5	12.0	1,200	7547461
	CSCF4860N6D*+TXV	A*VC961205DNA*	34,600	25,600	14.5	12.0	1,200	7547485
	CSCF4860N6D*+TXV	A*VM970804CNA*	34,600	25,600	14.5	11.5	1,190	7547517
	CSCF4860N6D*+TXV	G*E80805C*B*	33,600	25,000	14.5	11.5	1,210	7547406
	CSCF4860N6D*+TXV	A*VM971205DNA*	34,600	25,600	14.5	12.0	1,200	7547527
	CSCF4860N6D*+TXV	G*E81005C*B*	34,000	25,200	14.5	12.0	1,230	7547411
	CSCF4860N6D*+TXV	G*VC81005C*B*	33,400	24,800	14.5	11.5	1,200	7547424
	CSCF4860N6D*+TXV	A*VC80805C*B*	33,600	25,000	14.5	12.0	1,200	7547432
	CSCF4860N6D*+TXV	G*VC960803BNA*	34,400	25,400	14.5	11.5	1,250	7547446
	CSCF4860N6D*+TXV	G*VC960603BNA*	34,400	25,400	14.5	11.5	1,250	7547443
	CSCF4860N6D*+TXV	G*VM971005CNA*	34,600	25,600	14.5	11.5	1,175	7547501
	CSCF4860N6D*+TXV	A*VC81005C*B*	33,400	24,800	14.5	11.5	1,200	7547437
	CSCF4860N6D*+TXV	G*VC960804CNA*	34,600	25,600	14.5	12.0	1,190	7547451
	CSCF4860N6D*+TXV	G*VM970803BNA*	34,400	25,400	14.5	11.5	1,250	7547491
	CSCF4860N6D*+TXV	A*VM970603BNA*	34,400	25,400	14.5	11.5	1,250	7547509
	CSCF4860N6D*+TXV	G*VC961005CNA*	34,600	25,600	14.5	11.5	1,175	7547456
	CSCF4860N6D*+TXV	A*VC960403BNA*	34,200	25,400	14.5	11.5	1,200	7547464
	CSCF4860N6D*+TXV	G*E80603B*B*	33,400	24,800	14.5	11.5	1,250	7539947
	CSCF4860N6D*+TXV	A*VC960803BNA*	34,400	25,400	14.5	11.5	1,250	7547470
	CSCF4860N6D*+TXV	G*VM970804CNA*	34,600	25,600	14.5	11.5	1,190	7547496
	CSCF4860N6D*+TXV	G*VM971205DNA*	34,600	25,600	14.5	12.0	1,200	7547506
	CSCF4860N6D*+TXV	G*VM970603BNA*	34,400	25,400	14.5	11.5	1,250	7547488
	CSCF4860N6D*+TXV	A*VC80604B*B*	33,600	25,000	14.5	11.5	1,220	7547427
	CSCF4860N6D*+TXV	G*VC960403BNA*	34,200	25,400	14.5	11.5	1,200	7547440
	CSCF4860N6D*+TXV	A*VM970803BNA*	34,400	25,400	14.5	11.5	1,250	7547512
	CSCF4860N6D*+TXV	G*VC80805C*B*	33,600	25,000	14.5	12.0	1,200	7547419
CSCF4860N6D*+TXV	A*VM971005CNA*	34,600	25,600	14.5	11.5	1,175	7547522	
CSCF4860N6D*+TXV	A*VC960804CNA*	34,600	25,600	14.5	12.0	1,190	7547475	
CSCF4860N6D*+TXV	A*VC961005CNA*	34,600	25,600	14.5	11.5	1,175	7547480	
CSCF4860N6D*+TXV	A*VC960603BNA*	34,400	25,400	14.5	11.5	1,250	7547467	

See Notes on Page 74.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0371K*	ARUF37C14A*+TXV		33,400	25,200	14.0	12.2	1,050	7989057
	ARUF37D14A*		34,200	25,800	14.0	12.2	1,240	8171744
	ARUF49C14A*		34,000	25,800	14.0	12.2	1,220	7989018
	ASPT36C14A*		34,200	25,800	14.5	12.5	1,210	7540170
	ASPT37C14A*		34,200	25,800	14.5	12.2	1,120	8245636
	ASPT47C14A*		34,200	25,800	14.5	12.2	1,120	8245638
	ASPT47D14A*		34,600	26,200	15.0	12.5	1,205	8245640
	AVPTC36C14A*		34,000	25,800	14.5	12.2	1,100	7540174
	AVPTC37C14A*		34,000	25,800	14.5	12.2	1,130	8996363
	AVPTC37D14A*		34,600	26,200	15.0	12.5	1,145	8996364
	AVPTC42D14A*		34,800	26,400	15.0	12.5	1,120	7540176
	AVPTC49D14A*		34,600	26,200	15.0	12.5	1,075	8996365
	AWUF37XX16B*+TXV		33,000	25,000	14.5	12.2	355	7540178
	CA*F3137*6A*	A*VC80603B*B*	33,400	26,000	14.5	12.2	1100	9947479
	CA*F3137*6A*	A*VC80803B*B*	33,400	26,000	14.5	12.2	1150	9947484
	CA*F3137*6A*	A*VC960403BNA*	34,000	25,800	15.0	12.5	1,200	7540412
	CA*F3137*6A*	A*VC960603BNA*	34,000	25,800	15.0	12.5	1,250	7540423
	CA*F3137*6A*	G*E80603B*B*	33,400	25,200	14.5	12.2	1,225	7540223
	CA*F3137*6A*	G*VC960803BNA*	34,000	25,800	15.0	12.5	1,250	7540356
	CA*F3137*6A*	A*VM970603BNA*	34,000	25,800	15.0	12.5	1,250	7540579
	CA*F3137*6A*	A*VC80604B*B*	33,600	25,400	15.0	12.5	1,220	7540308
	CA*F3137*6A*	G*VC80604B*B*	33,600	25,400	15.0	12.5	1,220	7540263
	CA*F3137*6A*	G*VC960403BNA*	34,000	25,800	15.0	12.5	1,200	7540341
	CA*F3137*6A*	G*VC960603BNA*	34,000	25,800	15.0	12.5	1,250	7540350
	CA*F3137*6A*	A*VM970803BNA*	34,000	25,800	15.0	12.5	1,250	7540590
	CA*F3137*6A*	G*VM970803BNA*	34,000	25,800	15.0	12.5	1,250	7540513
	CA*F3137*6A*	A*VC960803BNA*	34,000	25,800	15.0	12.5	1,250	7540435
	CA*F3137*6A*	G*VM970603BNA*	34,000	25,800	15.0	12.5	1,250	7540502
	CA*F3137*6A*+EEP		34,000	25,800	14.0	12.2	1,100	7540179
	CA*F3137*6A*+EEP+TXV		34,000	25,800	14.0	12.2	1,100	7540181
	CA*F3743*6D*	A*VC80805D*B*	33,600	26,200	14.5	12.2	1200	9947493
	CA*F3743*6D*	A*VM971005CNA*	34,600	26,200	14.5	12.2	1,175	7540623
	CA*F3743*6D*	G*VC81005C*B*	33,400	25,200	14.5	12.2	1,200	7540297
	CA*F3743*6D*	A*VM971205DNA*	34,600	26,200	15.0	12.5	1,200	7540641
	CA*F3743*6D*	A*VC960804CNA*	34,600	26,200	14.5	12.2	1,190	7540450
	CA*F3743*6D*	A*VC81005C*B*	33,400	25,200	14.5	12.2	1,200	7540331
	CA*F3743*6D*	G*E81005C*B*	34,000	25,800	14.5	12.2	1,200	7540248
	CA*F3743*6D*	G*EC961205DNA*	34,400	26,000	15.0	12.5	1,075	7540677
	CA*F3743*6D*	G*VC960804CNA*	34,600	26,200	14.5	12.2	1,190	7540366
	CA*F3743*6D*	G*VM970804CNA*	34,600	26,200	14.5	12.2	1,190	7540527
	CA*F3743*6D*	G*VM971005CNA*	34,600	26,200	14.5	12.2	1,175	7540546
	CA*F3743*6D*	A*EC961205DNA*	34,400	26,000	15.0	12.5	1,075	7540714
	CA*F3743*6D*	A*VM970804CNA*	34,600	26,200	14.5	12.2	1,190	7540605
	CA*F3743*6D*	A*VC961005CNA*	34,600	26,200	14.5	12.2	1,175	7540469
	CA*F3743*6D*	G*VM971205DNA*	34,600	26,200	15.0	12.5	1,200	7540565
	CA*F3743*6D*	G*VC961005CNA*	34,600	26,200	14.5	12.2	1,175	7540380
	CA*F3743*6D*	A*VC961205DNA*	34,600	26,200	15.0	12.5	1,200	7540488
	CA*F3743*6D*	G*VC961205DNA*	34,600	26,200	15.0	12.5	1,200	7540397
	CA*F3743*6D*	G*EC961004CNA*	34,600	26,200	14.5	12.2	1,250	7540659
	CA*F3743*6D*	A*EC961004CNA*	34,600	26,200	14.5	12.2	1,250	7540696
CA*F3743*6D*	A*VC80805C*B*	33,600	25,400	14.5	12.2	1,200	7540318	
CA*F3743*6D*	G*VC80805C*B*	33,600	25,400	14.5	12.2	1,200	7540278	
CA*F3743*6D*	G*E80805C*B*	33,600	25,400	14.5	12.2	1,210	7540231	
CA*F3743*6D*+EEP		34,000	25,800	14.0	12.2	1,200	7540183	

See Notes on Page 74.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0371K* (cont.)	CA*F3743*6D*+EEP+TXV		34,000	25,800	14.5	12.2	1,200	7540185
	CA*F3743*6D*+MBVC1600**-1A*		34,600	26,200	14.5	12.2	1,200	7540187
	CA*F3743*6D*+MBVC1600**-1A*+TXV		34,600	26,200	14.5	12.2	1,200	7540189
	CA*F3743*6D*+MBVC2000**-1A*		34,600	26,200	15.0	12.5	1,200	7540191
	CA*F3743*6D*+MBVC2000**-1A*+TXV		34,600	26,200	15.0	12.5	1,200	7540193
	CA*F3743*6D*+TXV	A*VC80603B*B*	33,400	26,000	14.5	12.2	1100	9947480
	CA*F3743*6D*+TXV	A*VC80803B*B*	33,400	26,000	14.5	12.2	1150	9947485
	CA*F3743*6D*+TXV	A*VC80804C*B*	33,600	26,200	14.5	12.2	1250	9947489
	CA*F3743*6D*+TXV	A*VC80805D*B*	33,600	26,200	15.0	12.5	1200	9947494
	CA*F3743*6D*+TXV	G*VC80604B*B*	33,600	25,400	14.5	12.2	1,220	7540265
	CA*F3743*6D*+TXV	G*VC961005CNA*	34,600	26,200	15.0	12.5	1,175	7540382
	CA*F3743*6D*+TXV	A*VC80604B*B*	33,600	25,400	14.5	12.2	1,220	7540309
	CA*F3743*6D*+TXV	A*VM970803BNA*	34,400	26,000	14.5	12.2	1,250	7540592
	CA*F3743*6D*+TXV	A*VM971005CNA*	34,600	26,200	15.0	12.5	1,175	7540625
	CA*F3743*6D*+TXV	A*VC960804CNA*	34,600	26,200	15.0	12.5	1,190	7540452
	CA*F3743*6D*+TXV	G*VM971005CNA*	34,600	26,200	15.0	12.5	1,175	7540548
	CA*F3743*6D*+TXV	G*VM970803BNA*	34,400	26,000	14.5	12.2	1,250	7540515
	CA*F3743*6D*+TXV	G*E80603B*B*	33,400	25,200	14.5	12.2	1,225	7540225
	CA*F3743*6D*+TXV	G*VM970603BNA*	34,200	25,800	14.5	12.2	1,250	7540504
	CA*F3743*6D*+TXV	G*VC80805C*B*	33,600	25,400	15.0	12.5	1,200	7540281
	CA*F3743*6D*+TXV	G*E81005C*B*	34,000	25,800	15.0	12.5	1,200	7540250
	CA*F3743*6D*+TXV	G*VC960803BNA*	34,400	26,000	14.5	12.2	1,250	7540358
	CA*F3743*6D*+TXV	G*VC960603BNA*	34,400	26,000	14.5	12.2	1,250	7540351
	CA*F3743*6D*+TXV	A*VC81005C*B*	33,400	25,200	15.0	12.5	1,200	7540332
	CA*F3743*6D*+TXV	G*VC960804CNA*	34,600	26,200	15.0	12.5	1,190	7540369
	CA*F3743*6D*+TXV	A*VM970603BNA*	34,200	25,800	14.5	12.2	1,250	7540581
	CA*F3743*6D*+TXV	A*VM970804CNA*	34,600	26,200	15.0	12.5	1,190	7540607
	CA*F3743*6D*+TXV	G*VM971205DNA*	34,600	26,200	15.0	12.5	1,200	7540567
	CA*F3743*6D*+TXV	G*VC81005C*B*	33,400	25,200	15.0	12.5	1,200	7540299
	CA*F3743*6D*+TXV	A*VC960603BNA*	34,400	26,000	14.5	12.2	1,250	7540426
	CA*F3743*6D*+TXV	A*EC961004CNA*	34,600	26,200	15.0	12.5	1,250	7540698
	CA*F3743*6D*+TXV	A*VM971205DNA*	34,600	26,200	15.0	12.5	1,200	7540643
	CA*F3743*6D*+TXV	G*VC961205DNA*	34,600	26,200	15.0	12.5	1,200	7540399
	CA*F3743*6D*+TXV	A*VC961005CNA*	34,600	26,200	15.0	12.5	1,175	7540471
	CA*F3743*6D*+TXV	A*EC961205DNA*	34,400	26,000	15.0	12.5	1,075	7540716
	CA*F3743*6D*+TXV	G*E80805C*B*	33,600	25,400	15.0	12.5	1,210	7540233
	CA*F3743*6D*+TXV	G*VC960403BNA*	34,000	25,800	14.5	12.2	1,200	7540343
	CA*F3743*6D*+TXV	A*VC961205DNA*	34,600	26,200	15.0	12.5	1,200	7540490
	CA*F3743*6D*+TXV	G*EC961004CNA*	34,600	26,200	15.0	12.5	1,250	7540661
	CA*F3743*6D*+TXV	G*VM970804CNA*	34,600	26,200	15.0	12.5	1,190	7540529
	CA*F3743*6D*+TXV	A*VC960803BNA*	34,400	26,000	14.5	12.2	1,250	7540437
	CA*F3743*6D*+TXV	G*EC961205DNA*	34,400	26,000	15.0	12.5	1,075	7540679
	CA*F3743*6D*+TXV	A*VC960403BNA*	34,000	25,800	14.5	12.2	1,200	7540414
	CA*F3743*6D*+TXV	A*VC80805C*B*	33,600	25,400	15.0	12.5	1,200	7540320
	CAPT3743*4A*	A*VC80603B*B*	33,600	26,200	15.0	12.2	1100	9947481
	CAPT3743*4A*	A*VC80803B*B*	33,600	26,200	15.0	12.2	1150	9947486
	CAPT3743*4A*	A*VC80804C*B*	33,600	26,200	14.5	12.2	1250	9947490
	CAPT3743*4A*	A*VC80805D*B*	33,600	26,200	15.0	12.2	1200	9947495
CAPT3743*4A*	A*VC80805C*B*	33,600	25,400	15.0	12.2	1,200	7540322	
CAPT3743*4A*	G*VM970603BNA*	34,200	25,800	14.5	12.2	1,250	7540506	
CAPT3743*4A*	A*VM970804CNA*	34,600	26,200	15.0	12.2	1,190	7540609	
CAPT3743*4A*	G*VC960804CNA*	34,600	26,200	15.0	12.2	1,190	7540370	
CAPT3743*4A*	G*VC960603BNA*	34,200	25,800	14.5	12.2	1,250	7540352	
CAPT3743*4A*	G*VC960403BNA*	34,000	25,800	14.5	12.2	1,200	7540345	

See Notes on Page 74.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0371K* (cont.)	CAPT3743*4A*	G*EC961004CNA*	34,600	26,200	14.5	12.2	1,250	7540663
	CAPT3743*4A*	A*EC961205DNA*	34,400	26,000	15.0	12.5	1,075	7540718
	CAPT3743*4A*	A*VM970803BNA*	34,200	25,800	14.5	12.2	1,250	7540594
	CAPT3743*4A*	G*VM970804CNA*	34,600	26,200	15.0	12.2	1,190	7540531
	CAPT3743*4A*	G*VC80805C*B*	33,600	25,400	15.0	12.2	1,200	7540283
	CAPT3743*4A*	A*VC960804CNA*	34,600	26,200	15.0	12.2	1,190	7540455
	CAPT3743*4A*	G*EC961205DNA*	34,400	26,000	15.0	12.5	1,075	7540681
	CAPT3743*4A*	A*VC960603BNA*	34,200	25,800	14.5	12.2	1,250	7540428
	CAPT3743*4A*	A*VC961205DNA*	34,400	26,000	15.0	12.5	1,200	7540492
	CAPT3743*4A*	A*EC961004CNA*	34,600	26,200	14.5	12.2	1,250	7540700
	CAPT3743*4A*	A*VC961005CNA*	34,600	26,200	15.0	12.2	1,175	7540473
	CAPT3743*4A*	G*VC80604B*B*	33,600	25,400	14.5	12.2	1,220	7540267
	CAPT3743*4A*	A*VM971005CNA*	34,600	26,200	15.0	12.2	1,175	7540627
	CAPT3743*4A*	G*VM971205DNA*	34,400	26,000	15.0	12.5	1,200	7540569
	CAPT3743*4A*	G*E81005C*B*	34,000	25,800	14.5	12.2	1,200	7540252
	CAPT3743*4A*	A*VM971205DNA*	34,400	26,000	15.0	12.5	1,200	7540645
	CAPT3743*4A*	A*VC80604B*B*	33,600	25,400	14.5	12.2	1,220	7540311
	CAPT3743*4A*	G*VM971005CNA*	34,600	26,200	15.0	12.2	1,175	7540550
	CAPT3743*4A*	G*VC961205DNA*	34,400	26,000	15.0	12.5	1,200	7540401
	CAPT3743*4A*	G*VM970803BNA*	34,200	25,800	14.5	12.2	1,250	7540517
	CAPT3743*4A*	G*VC81005C*B*	33,400	25,200	15.0	12.2	1,200	7540301
	CAPT3743*4A*	G*E80805C*B*	33,600	25,400	14.5	12.2	1,210	7540235
	CAPT3743*4A*	A*VM970603BNA*	34,200	25,800	14.5	12.2	1,250	7540583
	CAPT3743*4A*	G*VC960803BNA*	34,200	25,800	14.5	12.2	1,250	7540359
	CAPT3743*4A*	A*VC81005C*B*	33,400	25,200	15.0	12.2	1,200	7540334
	CAPT3743*4A*	A*VC960403BNA*	34,000	25,800	14.5	12.2	1,200	7540417
	CAPT3743*4A*	A*VC960803BNA*	34,200	25,800	14.5	12.2	1,250	7540439
	CAPT3743*4A*	G*VC961005CNA*	34,600	26,200	15.0	12.2	1,175	7540384
	CAPT3743*4A*+EFP		34,000	25,800	14.5	12.2	1,200	7540194
	CAPT3743*4A*+MBVC1600**-1A*		34,200	25,800	14.5	12.2	1,200	7540196
	CAPT3743*4A*+MBVC2000**-1A*		34,200	25,800	14.5	12.2	1,200	7540200
	CHPF3642C6C*	G*E80805C*B*	33,600	25,400	14.5	12.2	1,210	7540237
	CHPF3642C6C*	G*E81005C*B*	34,000	25,800	14.5	12.2	1,200	7540254
	CHPF3642C6C*+EFP		34,000	25,800	14.0	12.2	1,150	7540204
	CHPF3642C6C*+EFP+TXV		34,000	25,800	14.0	12.2	1,150	7540206
	CHPF3642C6C*+MBVC1600**-1A*		34,000	25,800	14.5	12.2	1,200	7540208
	CHPF3642C6C*+MBVC1600**-1A*+TXV		34,000	25,800	15.0	12.5	1,200	7540210
	CHPF3642C6C*+TXV	G*E80603B*B*	33,400	25,200	14.5	12.2	1,225	7540227
	CHPF3642C6C*+TXV	G*E80805C*B*	33,600	25,400	15.0	12.5	1,210	7540239
	CHPF3642C6C*+TXV	G*E81005C*B*	34,000	25,800	15.0	12.5	1,200	7540257
	CHPF3743C6B*+MBVC1600**-1A*		34,600	26,200	14.5	12.2	1,200	7540211
	CHPF3743C6B*+MBVC1600**-1A*+TXV		34,600	26,200	15.0	12.5	1,200	7540213
	CHPF3743C6B*+TXV	A*VC80603B*B*	33,600	26,200	15.0	12.5	1,100	9947482
	CHPF3743C6B*+TXV	A*VC80803B*B*	33,600	26,200	15.0	12.5	1,050	9947487
	CHPF3743C6B*+TXV	A*VC80804C*B*	33,600	26,200	14.5	12.2	1,100	9947491
	CHPF3743C6B*+TXV	A*VM970803BNA*	34,400	26,000	14.5	12.2	1,250	7540596
	CHPF3743C6B*+TXV	G*VM970603BNA*	34,400	26,000	14.5	12.2	1,250	7540509
	CHPF3743C6B*+TXV	G*VC960603BNA*	34,400	26,000	14.5	12.2	1,250	7540353
CHPF3743C6B*+TXV	G*VC80604B*B*	33,600	25,400	14.5	12.2	1,220	7540270	
CHPF3743C6B*+TXV	G*VC960803BNA*	34,400	26,000	14.5	12.2	1,250	7540361	
CHPF3743C6B*+TXV	A*VC80604B*B*	33,600	25,400	14.5	12.2	1,220	7540312	
CHPF3743C6B*+TXV	A*VC960403BNA*	34,200	25,800	14.5	12.2	1,200	7540419	
CHPF3743C6B*+TXV	G*VM970803BNA*	34,400	26,000	14.5	12.2	1,250	7540519	
CHPF3743C6B*+TXV	A*VM970603BNA*	34,400	26,000	14.5	12.2	1,250	7540585	
CHPF3743C6B*+TXV	G*VC960403BNA*	34,200	25,800	14.5	12.2	1,200	7540346	

See Notes on Page 74.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0371K* (cont.)	CHPF3743C6B*+TXV	A*VC960603BNA*	34,400	26,000	14.5	12.2	1,250	7540430
	CHPF3743C6B*+TXV	A*VC960803BNA*	34,400	26,000	14.5	12.2	1,250	7540441
	CHPF3743D6B*	A*VC80805D*B*	33,600	26,200	14.5	12.2	1,200	9947496
	CHPF3743D6B*	A*VC961005CNA*	34,600	26,200	14.5	12.2	1,175	7540475
	CHPF3743D6B*	G*VC81005C*B*	33,400	25,200	14.5	12.2	1,200	7540302
	CHPF3743D6B*	G*VC961005CNA*	34,600	26,200	14.5	12.2	1,175	7540385
	CHPF3743D6B*	G*EC961205DNA*	34,200	25,800	15.0	12.5	1,075	7540683
	CHPF3743D6B*	A*VC80805C*B*	33,600	25,400	14.5	12.2	1,200	7540323
	CHPF3743D6B*	A*VM971205DNA*	34,600	26,200	15.0	12.5	1,200	7540647
	CHPF3743D6B*	G*EC961004CNA*	34,600	26,200	14.5	12.2	1,250	7540665
	CHPF3743D6B*	A*EC961004CNA*	34,600	26,200	14.5	12.2	1,250	7540702
	CHPF3743D6B*	G*VM971205DNA*	34,600	26,200	15.0	12.5	1,200	7540571
	CHPF3743D6B*	A*VC961205DNA*	34,600	26,200	15.0	12.5	1,200	7540494
	CHPF3743D6B*	A*VC81005C*B*	33,400	25,200	14.5	12.2	1,200	7540335
	CHPF3743D6B*	G*VM971005CNA*	34,600	26,200	14.5	12.2	1,175	7540552
	CHPF3743D6B*	G*VM970804CNA*	34,600	26,200	14.5	12.2	1,190	7540534
	CHPF3743D6B*	A*VC960804CNA*	34,600	26,200	14.5	12.2	1,190	7540457
	CHPF3743D6B*	A*EC961205DNA*	34,200	25,800	15.0	12.5	1,075	7540720
	CHPF3743D6B*	G*VC961205DNA*	34,600	26,200	15.0	12.5	1,200	7540403
	CHPF3743D6B*	G*VC80805C*B*	33,600	25,400	14.5	12.2	1,200	7540285
	CHPF3743D6B*	G*VC960804CNA*	34,600	26,200	14.5	12.2	1,190	7540371
	CHPF3743D6B*	A*VM971005CNA*	34,600	26,200	14.5	12.2	1,175	7540629
	CHPF3743D6B*	A*VM970804CNA*	34,600	26,200	14.5	12.2	1,190	7540611
	CHPF3743D6B*+EEP		34,600	26,200	14.5	12.2	1,150	7540215
	CHPF3743D6B*+EEP+TXV		34,600	26,200	15.0	12.5	1,150	7540217
	CHPF3743D6B*+TXV	A*VC80805D*B*	33,600	26,200	15.0	12.5	1,200	9947497
	CHPF3743D6B*+TXV	A*VC80805C*B*	33,600	25,400	15.0	12.5	1,200	7540324
	CHPF3743D6B*+TXV	G*VC960804CNA*	34,600	26,200	15.0	12.5	1,190	7540372
	CHPF3743D6B*+TXV	A*VM971005CNA*	34,600	26,200	15.0	12.5	1,175	7540631
	CHPF3743D6B*+TXV	G*EC961004CNA*	34,600	26,200	15.0	12.5	1,250	7540667
	CHPF3743D6B*+TXV	A*EC961004CNA*	34,600	26,200	15.0	12.5	1,250	7540704
	CHPF3743D6B*+TXV	G*VC961205DNA*	34,600	26,200	15.0	12.5	1,200	7540405
	CHPF3743D6B*+TXV	G*VM971005CNA*	34,600	26,200	15.0	12.5	1,175	7540554
	CHPF3743D6B*+TXV	G*VC80805C*B*	33,600	25,400	15.0	12.5	1,200	7540287
	CHPF3743D6B*+TXV	A*VC960804CNA*	34,600	26,200	15.0	12.5	1,190	7540459
	CHPF3743D6B*+TXV	A*VM971205DNA*	34,600	26,200	15.0	12.5	1,200	7540649
	CHPF3743D6B*+TXV	G*VC81005C*B*	33,400	25,200	15.0	12.5	1,200	7540303
	CHPF3743D6B*+TXV	A*VC81005C*B*	33,400	25,200	15.0	12.5	1,200	7540337
	CHPF3743D6B*+TXV	A*VC961005CNA*	34,600	26,200	15.0	12.5	1,175	7540477
	CHPF3743D6B*+TXV	A*VM970804CNA*	34,600	26,200	15.0	12.5	1,190	7540613
	CHPF3743D6B*+TXV	G*VC961005CNA*	34,600	26,200	15.0	12.5	1,175	7540387
	CHPF3743D6B*+TXV	G*VM971205DNA*	34,600	26,200	15.0	12.5	1,200	7540573
	CHPF3743D6B*+TXV	A*VC961205DNA*	34,600	26,200	15.0	12.5	1,200	7540496
	CHPF3743D6B*+TXV	G*VM970804CNA*	34,600	26,200	15.0	12.5	1,190	7540536
	CHPF3743D6B*+TXV	A*EC961205DNA*	34,200	25,800	15.0	12.5	1,075	7540722
	CHPF3743D6B*+TXV	G*EC961205DNA*	34,200	25,800	15.0	12.5	1,075	7540685
	CSCF4860N6D*	A*VC80805D*B*	33,600	26,200	14.5	12.2	1,200	9947498
	CSCF4860N6D*	A*EC961004CNA*	34,600	26,200	14.5	12.2	1,250	7540706
	CSCF4860N6D*	A*VC961005CNA*	34,600	26,200	14.5	12.2	1,175	7540479
	CSCF4860N6D*	A*VM970804CNA*	34,600	26,200	14.5	12.2	1,190	7540615
CSCF4860N6D*	A*VC80805C*B*	33,600	25,400	14.5	12.2	1,200	7540325	
CSCF4860N6D*	A*VC81005C*B*	33,400	25,200	14.5	12.2	1,200	7540339	
CSCF4860N6D*	G*VC961005CNA*	34,600	26,200	14.5	12.2	1,175	7540389	
CSCF4860N6D*	A*VM971205DNA*	34,600	26,200	15.0	12.5	1,200	7540651	
CSCF4860N6D*	G*E81005C*B*	34,000	25,800	14.5	12.2	1,200	7540259	

See Notes on Page 74.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0371K* (cont.)	CSCF4860N6D*	G*VM971005CNA*	34,600	26,200	14.5	12.2	1,175	7540556
	CSCF4860N6D*	G*EC961205DNA*	34,200	25,800	15.0	12.5	1,075	7540687
	CSCF4860N6D*	A*VM971005CNA*	34,600	26,200	14.5	12.2	1,175	7540633
	CSCF4860N6D*	G*VC80805C*B*	33,600	25,400	14.5	12.2	1,200	7540289
	CSCF4860N6D*	G*VC960804CNA*	34,600	26,200	14.5	12.2	1,190	7540374
	CSCF4860N6D*	A*EC961205DNA*	34,200	25,800	15.0	12.5	1,075	7540724
	CSCF4860N6D*	G*EC961004CNA*	34,600	26,200	14.5	12.2	1,250	7540669
	CSCF4860N6D*	G*VM970804CNA*	34,600	26,200	14.5	12.2	1,190	7540538
	CSCF4860N6D*	G*VC961205DNA*	34,600	26,200	15.0	12.5	1,200	7540408
	CSCF4860N6D*	G*VM971205DNA*	34,600	26,200	15.0	12.5	1,200	7540575
	CSCF4860N6D*	G*E80805C*B*	33,600	25,400	14.5	12.2	1,210	7540241
	CSCF4860N6D*	G*VC81005C*B*	33,400	25,200	14.5	12.2	1,200	7540305
	CSCF4860N6D*	A*VC960804CNA*	34,600	26,200	14.5	12.2	1,190	7540461
	CSCF4860N6D*	A*VC961205DNA*	34,600	26,200	15.0	12.5	1,200	7540498
	CSCF4860N6D*+EEP		34,600	26,200	14.0	12.2	1,200	7540219
	CSCF4860N6D*+EEP+TXV		34,600	26,200	14.5	12.2	1,200	7540221
	CSCF4860N6D*+TXV	A*VC80603B*B*	33,400	26,000	14.5	12.2	1,100	9947483
	CSCF4860N6D*+TXV	A*VC80803B*B*	33,400	26,000	14.5	12.2	1,150	9947488
	CSCF4860N6D*+TXV	A*VC80804C*B*	33,600	26,200	14.5	12.2	1,250	9947492
	CSCF4860N6D*+TXV	A*VC80805D*B*	33,600	26,200	15.0	12.5	1,200	9947499
	CSCF4860N6D*+TXV	G*E81005C*B*	34,000	25,800	15.0	12.5	1,200	7540261
	CSCF4860N6D*+TXV	A*VM971005CNA*	34,600	26,200	15.0	12.5	1,175	7540635
	CSCF4860N6D*+TXV	G*EC961205DNA*	34,200	25,800	15.0	12.5	1,075	7540689
	CSCF4860N6D*+TXV	G*VM971005CNA*	34,600	26,200	15.0	12.5	1,175	7540558
	CSCF4860N6D*+TXV	G*VC80805C*B*	33,600	25,400	15.0	12.5	1,200	7540291
	CSCF4860N6D*+TXV	A*VC960403BNA*	34,200	25,800	14.5	12.2	1,200	7540421
	CSCF4860N6D*+TXV	G*E80805C*B*	33,600	25,400	15.0	12.5	1,210	7540243
	CSCF4860N6D*+TXV	A*VC961205DNA*	34,600	26,200	15.0	12.5	1,200	7540500
	CSCF4860N6D*+TXV	A*VM970603BNA*	34,400	26,000	14.5	12.2	1,250	7540588
	CSCF4860N6D*+TXV	G*VC961205DNA*	34,600	26,200	15.0	12.5	1,200	7540410
	CSCF4860N6D*+TXV	G*VM970803BNA*	34,400	26,000	14.5	12.2	1,250	7540521
	CSCF4860N6D*+TXV	G*VC960804CNA*	34,600	26,200	15.0	12.5	1,190	7540376
	CSCF4860N6D*+TXV	A*VC960804CNA*	34,600	26,200	15.0	12.5	1,190	7540463
	CSCF4860N6D*+TXV	G*EC961004CNA*	34,600	26,200	15.0	12.5	1,250	7540671
	CSCF4860N6D*+TXV	G*VC80604B*B*	33,600	25,400	14.5	12.2	1,220	7540272
	CSCF4860N6D*+TXV	G*VC81005C*B*	33,400	25,200	15.0	12.5	1,200	7540307
	CSCF4860N6D*+TXV	G*VM970603BNA*	34,400	26,000	14.5	12.2	1,250	7540511
	CSCF4860N6D*+TXV	G*VC960603BNA*	34,400	26,000	14.5	12.2	1,250	7540355
	CSCF4860N6D*+TXV	G*VM970804CNA*	34,600	26,200	15.0	12.5	1,190	7540540
	CSCF4860N6D*+TXV	A*VC80805C*B*	33,600	25,400	15.0	12.5	1,200	7540327
	CSCF4860N6D*+TXV	A*EC961205DNA*	34,200	25,800	15.0	12.5	1,075	7540726
	CSCF4860N6D*+TXV	A*VC961005CNA*	34,600	26,200	15.0	12.5	1,175	7540481
	CSCF4860N6D*+TXV	A*VM970803BNA*	34,400	26,000	14.5	12.2	1,250	7540598
	CSCF4860N6D*+TXV	G*E80603B*B*	33,400	25,200	14.5	12.2	1,225	7540229
	CSCF4860N6D*+TXV	G*VM971205DNA*	34,600	26,200	15.0	12.5	1,200	7540577
	CSCF4860N6D*+TXV	G*VC960803BNA*	34,400	26,000	14.5	12.2	1,250	7540363
	CSCF4860N6D*+TXV	A*EC961004CNA*	34,600	26,200	15.0	12.5	1,250	7540708
	CSCF4860N6D*+TXV	A*VC81005C*B*	33,400	25,200	15.0	12.5	1,200	7540340
	CSCF4860N6D*+TXV	A*VM971205DNA*	34,600	26,200	15.0	12.5	1,200	7540653
	CSCF4860N6D*+TXV	A*VM970804CNA*	34,600	26,200	15.0	12.5	1,190	7540617
CSCF4860N6D*+TXV	A*VC80604B*B*	33,600	25,400	14.5	12.2	1,220	7540314	
CSCF4860N6D*+TXV	G*VC961005CNA*	34,600	26,200	15.0	12.5	1,175	7540391	
CSCF4860N6D*+TXV	G*VC960403BNA*	34,200	25,800	14.5	12.2	1,200	7540348	
CSCF4860N6D*+TXV	A*VC960603BNA*	34,400	26,000	14.5	12.2	1,250	7540432	
CSCF4860N6D*+TXV	A*VC960803BNA*	34,400	26,000	14.5	12.2	1,250	7540444	

See Notes on Page 74.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0421K*	ARUF43D14A*		37,400	29,600	14.0	11.5	1,270	8171745
	ARUF43D14A*+TXV		37,600	29,800	14.0	11.5	1,270	8171746
	ARUF47D14A*		37,600	29,800	14.0	11.5	1,375	7989019
	ASPT47D14A*		38,000	30,000	14.5	12.2	1,250	8245642
	ASPT49D14A*		39,000	30,800	14.5	12.2	1,425	8245643
	ASPT59C14A*		38,000	30,000	14.0	12.0	1,260	8245645
	AVPTC48D14A*		38,000	30,000	15.0	12.5	1,310	7540732
	AVPTC49D14A*		38,500	30,400	15.0	12.5	1,320	8996367
	AVPTC59C14A*		38,000	30,000	14.0	12.0	1,290	8996366
	CA*F4860*6D*	A*VC80805D*B*	38,000	31,000	14.0	11.5	1,350	9947500
	CA*F4860*6D*	A*VM971205DNA*	38,000	30,000	14.0	11.5	1,300	7541089
	CA*F4860*6D*	G*VC960804CNA*	38,000	30,000	14.0	11.5	1,385	7540892
	CA*F4860*6D*	G*E80805D*A*	38,000	30,000	14.0	11.5	1,425	7540804
	CA*F4860*6D*	A*VC961005CNA*	38,000	30,000	14.0	11.5	1,300	7540964
	CA*F4860*6D*	A*VC961205DNA*	38,000	30,000	14.0	11.5	1,425	7540982
	CA*F4860*6D*	A*VC81005C*B*	38,000	30,000	14.0	11.5	1,370	7540874
	CA*F4860*6D*	G*E81005C*B*	38,000	30,000	14.0	11.5	1,425	7540786
	CA*F4860*6D*	G*VM971205DNA*	38,000	30,000	14.0	11.5	1,300	7541038
	CA*F4860*6D*	G*VC961205DNA*	38,000	30,000	14.0	11.5	1,425	7540928
	CA*F4860*6D*	G*EC961205DNA*	38,000	30,000	14.0	11.5	1,400	7541121
	CA*F4860*6D*	A*EC961004CNA*	38,000	30,000	14.0	11.5	1,275	7541137
	CA*F4860*6D*	G*VC81005C*B*	38,000	30,000	14.0	11.5	1,370	7540838
	CA*F4860*6D*	A*VC80805C*B*	38,000	30,000	14.0	11.5	1,400	7540856
	CA*F4860*6D*	G*VM970804CNA*	38,000	30,000	14.0	11.5	1,425	7541001
	CA*F4860*6D*	G*VC80805C*B*	38,000	30,000	14.0	11.5	1,400	7540820
	CA*F4860*6D*	A*VM971005CNA*	38,000	30,000	14.0	11.5	1,300	7541072
	CA*F4860*6D*	A*EC961205DNA*	38,000	30,000	14.0	11.5	1,400	7541153
	CA*F4860*6D*	G*EC961004CNA*	38,000	30,000	14.0	11.5	1,275	7541106
	CA*F4860*6D*	G*E80805C*B*	38,000	30,000	14.0	11.5	1,425	7540768
	CA*F4860*6D*	G*VM971005CNA*	38,000	30,000	14.0	11.5	1,300	7541021
	CA*F4860*6D*	A*VM970804CNA*	38,000	30,000	14.0	11.5	1,425	7541054
	CA*F4860*6D*	G*VC961005CNA*	38,000	30,000	14.0	11.5	1,300	7540910
	CA*F4860*6D*	A*VC960804CNA*	38,000	30,000	14.0	11.5	1,385	7540946
	CA*F4860*6D*+EEP		38,000	30,000	14.0	11.5	1,400	7540734
	CA*F4860*6D*+EEP+TXV		38,000	30,000	14.0	11.5	1,400	7540736
	CA*F4860*6D*+MBVC1600**-1A*		38,000	30,000	14.5	11.5	1,300	7540738
	CA*F4860*6D*+MBVC2000**-1A*		38,000	30,000	14.5	11.5	1,300	7540740
	CA*F4860*6D*+TXV	A*VC80805D*B*	38,000	31,000	14.5	11.5	1,350	9947501
	CA*F4860*6D*+TXV	A*VC961205DNA*	38,000	30,000	14.5	11.5	1,425	7540984
	CA*F4860*6D*+TXV	G*VM971005CNA*	38,000	30,000	14.5	11.5	1,300	7541023
	CA*F4860*6D*+TXV	A*VM971005CNA*	38,000	30,000	14.5	11.5	1,300	7541074
	CA*F4860*6D*+TXV	G*VC960804CNA*	38,000	30,000	14.5	11.5	1,385	7540894
	CA*F4860*6D*+TXV	G*VC961005CNA*	38,000	30,000	14.5	11.5	1,300	7540912
	CA*F4860*6D*+TXV	A*VC960804CNA*	38,000	30,000	14.5	11.5	1,385	7540948
	CA*F4860*6D*+TXV	G*VM971205DNA*	38,000	30,000	14.5	11.5	1,300	7541039
	CA*F4860*6D*+TXV	G*VC81005C*B*	38,000	30,000	14.5	11.5	1,370	7540840
	CA*F4860*6D*+TXV	A*VC81005C*B*	38,000	30,000	14.5	11.5	1,370	7540876
	CA*F4860*6D*+TXV	A*VC80805C*B*	38,000	30,000	14.5	11.5	1,400	7540858
	CA*F4860*6D*+TXV	A*VM970804CNA*	38,000	30,000	14.5	11.5	1,425	7541056
	CA*F4860*6D*+TXV	A*VM971205DNA*	38,000	30,000	14.5	11.5	1,300	7541091
CA*F4860*6D*+TXV	G*VC80805C*B*	38,000	30,000	14.5	11.5	1,400	7540822	
CA*F4860*6D*+TXV	A*VC961005CNA*	38,000	30,000	14.5	11.5	1,300	7540966	
CA*F4860*6D*+TXV	G*E80805D*A*	38,000	30,000	14.5	11.5	1,425	7540806	

See Notes on Page 74.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0421K* (cont.)	CA*F4860*6D*+TXV	G*EC961205DNA*	38,000	30,000	14.5	11.5	1,400	7541123
	CA*F4860*6D*+TXV	A*EC961004CNA*	38,000	30,000	14.5	11.5	1,275	7541139
	CA*F4860*6D*+TXV	G*EC961004CNA*	38,000	30,000	14.5	11.5	1,275	7541108
	CA*F4860*6D*+TXV	G*VC961205DNA*	38,000	30,000	14.5	11.5	1,425	7540930
	CA*F4860*6D*+TXV	G*E80805C*B*	38,000	30,000	14.5	11.5	1,425	7540770
	CA*F4860*6D*+TXV	G*E81005C*B*	38,000	30,000	14.5	11.5	1,425	7540787
	CA*F4860*6D*+TXV	G*VM970804CNA*	38,000	30,000	14.5	11.5	1,425	7541003
	CA*F4860*6D*+TXV	A*EC961205DNA*	38,000	30,000	14.5	11.5	1,400	7541155
	CA*F4961*6D*	A*VC80805D*B*	39,000	31,800	14.5	12.2	1,350	9947502
	CA*F4961*6D*	A*VC961205DNA*	39,000	30,800	14.5	12.2	1,450	7540986
	CA*F4961*6D*	A*EC961205DNA*	39,000	30,800	14.5	12.2	1,400	7541157
	CA*F4961*6D*	G*VM971205DNA*	39,000	30,800	14.5	12.2	1,300	7541041
	CA*F4961*6D*	A*VM971205DNA*	39,000	30,800	14.5	12.2	1,300	7541092
	CA*F4961*6D*	G*E81005C*B*	39,000	30,800	14.5	12.2	1,425	7540789
	CA*F4961*6D*	G*VC960804CNA*	39,000	30,800	14.5	12.2	1,385	7540896
	CA*F4961*6D*	G*VM970804CNA*	39,000	30,800	14.5	12.2	1,430	7541005
	CA*F4961*6D*	G*EC961004CNA*	39,000	30,800	14.5	12.2	1,275	7541110
	CA*F4961*6D*	G*E80805D*A*	39,000	30,800	14.5	12.2	1,425	7540808
	CA*F4961*6D*	A*VC960804CNA*	39,000	30,800	14.5	12.2	1,385	7540950
	CA*F4961*6D*	A*EC961004CNA*	39,000	30,800	14.5	12.2	1,275	7541141
	CA*F4961*6D*	G*VC80805C*B*	39,000	30,800	14.5	12.2	1,400	7540824
	CA*F4961*6D*	G*EC961205DNA*	39,000	30,800	14.5	12.2	1,400	7541125
	CA*F4961*6D*	A*VM971005CNA*	39,000	30,800	14.5	12.2	1,300	7541076
	CA*F4961*6D*	G*VC961005CNA*	39,000	30,800	14.5	12.2	1,300	7540914
	CA*F4961*6D*	A*VC80805C*B*	39,000	30,800	14.5	12.2	1,400	7540860
	CA*F4961*6D*	G*VC961205DNA*	39,000	30,800	14.5	12.2	1,450	7540932
	CA*F4961*6D*	G*E80805C*B*	39,000	30,800	14.5	12.2	1,425	7540772
	CA*F4961*6D*	A*VM970804CNA*	39,000	30,800	14.5	12.2	1,430	7541058
	CA*F4961*6D*	A*VC81005C*B*	39,000	30,800	14.5	12.2	1,370	7540878
	CA*F4961*6D*	G*VM971005CNA*	39,000	30,800	14.5	12.2	1,300	7541025
	CA*F4961*6D*	G*VC81005C*B*	39,000	30,800	14.5	12.2	1,370	7540842
	CA*F4961*6D*	A*VC961005CNA*	39,000	30,800	14.5	12.2	1,300	7540968
	CA*F4961*6D*+EEP		39,000	30,800	14.0	12.2	1,400	7540742
	CA*F4961*6D*+EEP+TXV		39,000	30,800	14.0	12.2	1,400	7540744
	CA*F4961*6D*+MBVC1600**-1A*		39,000	30,800	14.5	12.2	1,300	7540746
	CA*F4961*6D*+MBVC2000**-1A*		39,000	30,800	14.5	12.2	1,300	7540748
	CA*F4961*6D*+TXV	A*VC80805D*B*	39,000	31,800	14.5	12.2	1,350	9947503
	CA*F4961*6D*+TXV	G*VM971005CNA*	39,000	30,800	14.5	12.2	1,300	7541026
	CA*F4961*6D*+TXV	G*VM970804CNA*	39,000	30,800	14.5	12.2	1,430	7541008
	CA*F4961*6D*+TXV	A*EC961205DNA*	39,000	30,800	14.5	12.2	1,400	7541159
	CA*F4961*6D*+TXV	G*VC961005CNA*	39,000	30,800	14.5	12.2	1,300	7540916
	CA*F4961*6D*+TXV	G*E81005C*B*	39,000	30,800	14.5	12.2	1,425	7540791
	CA*F4961*6D*+TXV	G*VM971205DNA*	39,000	30,800	14.5	12.2	1,300	7541043
	CA*F4961*6D*+TXV	G*E80805C*B*	39,000	30,800	14.5	12.2	1,425	7540774
	CA*F4961*6D*+TXV	A*EC961004CNA*	39,000	30,800	14.5	12.2	1,275	7541143
	CA*F4961*6D*+TXV	A*VC80805C*B*	39,000	30,800	14.5	12.2	1,400	7540862
	CA*F4961*6D*+TXV	A*VM971005CNA*	39,000	30,800	14.5	12.2	1,300	7541078
	CA*F4961*6D*+TXV	A*VC960804CNA*	39,000	30,800	14.5	12.2	1,385	7540952
CA*F4961*6D*+TXV	G*EC961004CNA*	39,000	30,800	14.5	12.2	1,275	7541112	
CA*F4961*6D*+TXV	G*VC81005C*B*	39,000	30,800	14.5	12.2	1,370	7540844	
CA*F4961*6D*+TXV	A*VM971205DNA*	39,000	30,800	14.5	12.2	1,300	7541094	
CA*F4961*6D*+TXV	A*VC81005C*B*	39,000	30,800	14.5	12.2	1,370	7540880	
CA*F4961*6D*+TXV	G*E80805D*A*	39,000	30,800	14.5	12.2	1,425	7540809	

See Notes on Page 74.



OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0421K* (cont.)	CA*F4961*6D*+TXV	G*VC960804CNA*	39,000	30,800	14.5	12.2	1,385	7540898
	CA*F4961*6D*+TXV	A*VM970804CNA*	39,000	30,800	14.5	12.2	1,430	7541060
	CA*F4961*6D*+TXV	G*VC80805C*B*	39,000	30,800	14.5	12.2	1,400	7540826
	CA*F4961*6D*+TXV	G*VC961205DNA*	39,000	30,800	14.5	12.2	1,450	7540934
	CA*F4961*6D*+TXV	G*EC961205DNA*	39,000	30,800	14.5	12.2	1,400	7541127
	CA*F4961*6D*+TXV	A*VC961205DNA*	39,000	30,800	14.5	12.2	1,450	7540988
	CA*F4961*6D*+TXV	A*VC961005CNA*	39,000	30,800	14.5	12.2	1,300	7540970
	CAPT4961*4A*	A*VC80805D*B*	39,000	31,800	14.5	11.5	1,350	9947504
	CAPT4961*4A*	G*VC81005C*B*	39,000	30,800	14.5	11.5	1,370	7540846
	CAPT4961*4A*	G*VM970804CNA*	39,000	30,800	14.5	11.5	1,430	7541010
	CAPT4961*4A*	G*VM971005CNA*	39,000	30,800	14.5	11.5	1,300	7541028
	CAPT4961*4A*	G*VC961005CNA*	39,000	30,800	14.5	11.5	1,300	7540918
	CAPT4961*4A*	A*VC961005CNA*	39,000	30,800	14.5	11.5	1,300	7540972
	CAPT4961*4A*	A*VC960804CNA*	39,000	30,800	14.5	11.5	1,385	7540954
	CAPT4961*4A*	G*E80805C*B*	39,000	30,800	14.5	11.5	1,425	7540776
	CAPT4961*4A*	A*VM971005CNA*	39,000	30,800	14.5	11.5	1,300	7541079
	CAPT4961*4A*	G*E81005C*B*	39,000	30,800	14.5	11.5	1,425	7540793
	CAPT4961*4A*	G*VC960804CNA*	39,000	30,800	14.5	11.5	1,385	7540900
	CAPT4961*4A*	A*VC81005C*B*	39,000	30,800	14.5	11.5	1,370	7540882
	CAPT4961*4A*	A*VC80805C*B*	39,000	30,800	14.5	11.5	1,425	7540864
	CAPT4961*4A*	A*VM971205DNA*	39,000	30,800	14.5	11.5	1,300	7541096
	CAPT4961*4A*	A*VM970804CNA*	39,000	30,800	14.5	11.5	1,430	7541062
	CAPT4961*4A*	G*VM971205DNA*	39,000	30,800	14.5	11.5	1,300	7541045
	CAPT4961*4A*	G*VC961205DNA*	39,000	30,800	14.5	11.5	1,450	7540936
	CAPT4961*4A*	A*VC961205DNA*	39,000	30,800	14.5	11.5	1,450	7540990
	CAPT4961*4A*	G*VC80805C*B*	39,000	30,800	14.5	11.5	1,425	7540828
	CAPT4961*4A*+EPP		39,000	30,800	14.0	11.5	1,275	7540750
	CAPT4961*4A*+MBVC1600**-1A*		39,000	30,800	14.5	12.2	1,300	7540752
	CAPT4961*4A*+MBVC2000**-1A*		39,000	30,800	14.5	12.2	1,300	7540754
	CHPF4860D6D*	A*VC80805D*B*	38,000	31,000	14.5	12.2	1,350	9947505
	CHPF4860D6D*	G*VC80805C*B*	38,000	30,000	14.5	12.2	1,400	7540830
	CHPF4860D6D*	A*VM970804CNA*	38,000	30,000	14.5	12.2	1,425	7541064
	CHPF4860D6D*	G*EC961205DNA*	38,000	30,000	14.5	12.2	1,400	7541129
	CHPF4860D6D*	A*VM971005CNA*	38,000	30,000	14.5	12.2	1,300	7541081
	CHPF4860D6D*	G*VM970804CNA*	38,000	30,000	14.5	12.2	1,425	7541012
	CHPF4860D6D*	A*VC960804CNA*	38,000	30,000	14.5	12.2	1,385	7540956
	CHPF4860D6D*	G*EC961004CNA*	38,000	30,000	14.5	12.2	1,275	7541114
	CHPF4860D6D*	G*VM971005CNA*	38,000	30,000	14.5	12.2	1,300	7541030
	CHPF4860D6D*	G*E80805D*A*	38,000	30,000	14.5	12.2	1,425	7540812
	CHPF4860D6D*	A*EC961004CNA*	38,000	30,000	14.5	12.2	1,275	7541145
	CHPF4860D6D*	A*VM971205DNA*	38,000	30,000	14.5	12.2	1,300	7541098
	CHPF4860D6D*	G*VC960804CNA*	38,000	30,000	14.5	12.2	1,385	7540902
	CHPF4860D6D*	G*VC961005CNA*	38,000	30,000	14.5	12.2	1,300	7540920
	CHPF4860D6D*	A*VC961205DNA*	38,000	30,000	14.5	12.2	1,425	7540992
	CHPF4860D6D*	A*VC961005CNA*	38,000	30,000	14.5	12.2	1,300	7540974
	CHPF4860D6D*	G*VC961205DNA*	38,000	30,000	14.5	12.2	1,425	7540938
	CHPF4860D6D*	G*VM971205DNA*	38,000	30,000	14.5	12.2	1,300	7541047
	CHPF4860D6D*	A*EC961205DNA*	38,000	30,000	14.5	12.2	1,400	7541161
CHPF4860D6D*	A*VC81005C*B*	38,000	30,000	14.5	12.2	1,370	7540884	
CHPF4860D6D*	A*VC80805C*B*	38,000	30,000	14.5	12.2	1,400	7540866	
CHPF4860D6D*	G*VC81005C*B*	38,000	30,000	14.5	12.2	1,370	7540848	
CHPF4860D6D*	G*E81005C*B*	38,000	30,000	14.5	12.2	1,425	7540795	
CHPF4860D6D*	G*E80805C*B*	38,000	30,000	14.5	12.2	1,425	7540778	

See Notes on Page 74.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0421K* (cont.)	CHPF4860D6D*+EEP		38,000	30,000	14.0	12.0	1,425	7540756
	CHPF4860D6D*+EEP+TXV		38,000	30,000	14.0	12.2	1,425	7540758
	CHPF4860D6D*+MBVC1600**-1A*		38,000	30,000	14.5	12.2	1,400	7540760
	CHPF4860D6D*+MBVC2000**-1A*		38,000	30,000	14.5	12.2	1,400	7540762
	CHPF4860D6D*+TXV	A*VC80805D*B*	38,000	31,000	14.5	12.2	1,350	9947506
	CHPF4860D6D*+TXV	G*E80805C*B*	38,000	30,000	14.5	12.2	1,425	7540780
	CHPF4860D6D*+TXV	G*VM971205DNA*	38,000	30,000	14.5	12.2	1,300	7541049
	CHPF4860D6D*+TXV	G*VC960804CNA*	38,000	30,000	14.5	12.2	1,385	7540904
	CHPF4860D6D*+TXV	A*VM971205DNA*	38,000	30,000	14.5	12.2	1,300	7541100
	CHPF4860D6D*+TXV	G*VC81005C*B*	38,000	30,000	14.5	12.2	1,370	7540850
	CHPF4860D6D*+TXV	A*VM970804CNA*	38,000	30,000	14.5	12.2	1,425	7541066
	CHPF4860D6D*+TXV	G*E80805D*A*	38,000	30,000	14.5	12.2	1,425	7540814
	CHPF4860D6D*+TXV	G*VM970804CNA*	38,000	30,000	14.5	12.2	1,425	7541014
	CHPF4860D6D*+TXV	A*VC80805C*B*	38,000	30,000	14.5	12.2	1,400	7540868
	CHPF4860D6D*+TXV	G*E81005C*B*	38,000	30,000	14.5	12.2	1,425	7540797
	CHPF4860D6D*+TXV	G*VC961005CNA*	38,000	30,000	14.5	12.2	1,300	7540922
	CHPF4860D6D*+TXV	G*VC80805C*B*	38,000	30,000	14.5	12.2	1,400	7540832
	CHPF4860D6D*+TXV	A*VC961205DNA*	38,000	30,000	14.5	12.2	1,425	7540994
	CHPF4860D6D*+TXV	A*VC961005CNA*	38,000	30,000	14.5	12.2	1,300	7540976
	CHPF4860D6D*+TXV	A*VC960804CNA*	38,000	30,000	14.5	12.2	1,385	7540958
	CHPF4860D6D*+TXV	A*EC961205DNA*	38,000	30,000	14.5	12.2	1,400	7541163
	CHPF4860D6D*+TXV	A*VC81005C*B*	38,000	30,000	14.5	12.2	1,370	7540886
	CHPF4860D6D*+TXV	A*EC961004CNA*	38,000	30,000	14.5	12.2	1,275	7541147
	CHPF4860D6D*+TXV	G*EC961205DNA*	38,000	30,000	14.5	12.2	1,400	7541131
	CHPF4860D6D*+TXV	A*VM971005CNA*	38,000	30,000	14.5	12.2	1,300	7541083
	CHPF4860D6D*+TXV	G*VC961205DNA*	38,000	30,000	14.5	12.2	1,425	7540940
	CHPF4860D6D*+TXV	G*VM971005CNA*	38,000	30,000	14.5	12.2	1,300	7541032
	CHPF4860D6D*+TXV	G*EC961004CNA*	38,000	30,000	14.5	12.2	1,275	7541116
	CSCF4860N6D*	A*VC80805D*B*	38,000	31,000	14.5	11.5	1,350	9947507
	CSCF4860N6D*	G*E80805D*A*	38,000	30,000	14.5	11.5	1,425	7540816
	CSCF4860N6D*	G*VC960804CNA*	38,000	30,000	14.5	11.5	1,385	7540906
	CSCF4860N6D*	G*VM971005CNA*	38,000	30,000	14.5	11.5	1,300	7541034
	CSCF4860N6D*	G*VM970804CNA*	38,000	30,000	14.5	11.5	1,425	7541016
	CSCF4860N6D*	A*EC961205DNA*	38,000	30,000	14.5	12.2	1,400	7541165
	CSCF4860N6D*	A*VM970804CNA*	38,000	30,000	14.5	11.5	1,425	7541067
	CSCF4860N6D*	A*VC960804CNA*	38,000	30,000	14.5	11.5	1,385	7540960
	CSCF4860N6D*	G*EC961004CNA*	38,000	30,000	14.5	12.2	1,275	7541117
	CSCF4860N6D*	G*VC80805C*B*	38,000	30,000	14.5	11.5	1,400	7540834
	CSCF4860N6D*	A*VM971005CNA*	38,000	30,000	14.5	11.5	1,300	7541085
	CSCF4860N6D*	A*VM971205DNA*	38,000	30,000	14.5	11.5	1,300	7541102
	CSCF4860N6D*	A*VC961005CNA*	38,000	30,000	14.5	11.5	1,300	7540978
	CSCF4860N6D*	A*EC961004CNA*	38,000	30,000	14.5	12.2	1,275	7541150
	CSCF4860N6D*	G*E80805C*B*	38,000	30,000	14.5	11.5	1,425	7540782
	CSCF4860N6D*	G*VC961005CNA*	38,000	30,000	14.5	11.5	1,300	7540924
	CSCF4860N6D*	G*VC961205DNA*	38,000	30,000	14.5	11.5	1,425	7540942
	CSCF4860N6D*	G*EC961205DNA*	38,000	30,000	14.5	12.2	1,400	7541132
CSCF4860N6D*	A*VC80805C*B*	38,000	30,000	14.5	11.5	1,400	7540870	
CSCF4860N6D*	G*VM971205DNA*	38,000	30,000	14.5	11.5	1,300	7541051	
CSCF4860N6D*	G*E81005C*B*	38,000	30,000	14.5	11.5	1,425	7540800	
CSCF4860N6D*	A*VC81005C*B*	38,000	30,000	14.5	11.5	1,370	7540888	
CSCF4860N6D*	A*VC961205DNA*	38,000	30,000	14.5	11.5	1,425	7540997	
CSCF4860N6D*	G*VC81005C*B*	38,000	30,000	14.5	11.5	1,370	7540852	
CSCF4860N6D*+EEP		38,000	30,000	14.0	11.5	1,425	7540764	

See Notes on Page 74.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0421K* (cont.)	CSCF4860N6D*+EEP+TXV		38,000	30,000	14.0	11.5	1,425	7540766
	CSCF4860N6D*+TXV	A*VC80805D*B*	38,000	31,000	14.5	11.5	1,350	9947508
	CSCF4860N6D*+TXV	G*EC961205DNA*	38,000	30,000	14.5	12.2	1,400	7541134
	CSCF4860N6D*+TXV	G*VC961205DNA*	38,000	30,000	14.5	11.5	1,425	7540944
	CSCF4860N6D*+TXV	A*VM971005CNA*	38,000	30,000	14.5	11.5	1,300	7541087
	CSCF4860N6D*+TXV	G*VM971005CNA*	38,000	30,000	14.5	11.5	1,300	7541036
	CSCF4860N6D*+TXV	G*VC80805C*B*	38,000	30,000	14.5	11.5	1,400	7540836
	CSCF4860N6D*+TXV	A*VM970804CNA*	38,000	30,000	14.5	11.5	1,425	7541070
	CSCF4860N6D*+TXV	A*VC80805C*B*	38,000	30,000	14.5	11.5	1,400	7540872
	CSCF4860N6D*+TXV	A*EC961004CNA*	38,000	30,000	14.5	12.2	1,275	7541152
	CSCF4860N6D*+TXV	A*VM971205DNA*	38,000	30,000	14.5	11.5	1,300	7541104
	CSCF4860N6D*+TXV	G*VC960804CNA*	38,000	30,000	14.5	11.5	1,385	7540908
	CSCF4860N6D*+TXV	G*VM971205DNA*	38,000	30,000	14.5	11.5	1,300	7541053
	CSCF4860N6D*+TXV	A*VC961205DNA*	38,000	30,000	14.5	11.5	1,425	7540999
	CSCF4860N6D*+TXV	G*E80805C*B*	38,000	30,000	14.5	11.5	1,425	7540784
	CSCF4860N6D*+TXV	A*VC961005CNA*	38,000	30,000	14.5	11.5	1,300	7540980
	CSCF4860N6D*+TXV	G*EC961004CNA*	38,000	30,000	14.5	12.2	1,275	7541119
	CSCF4860N6D*+TXV	G*VC81005C*B*	38,000	30,000	14.5	11.5	1,370	7540854
	CSCF4860N6D*+TXV	G*VC961005CNA*	38,000	30,000	14.5	11.5	1,300	7540926
	CSCF4860N6D*+TXV	A*EC961205DNA*	38,000	30,000	14.5	12.2	1,400	7541166
	CSCF4860N6D*+TXV	A*VC81005C*B*	38,000	30,000	14.5	11.5	1,370	7540890
	CSCF4860N6D*+TXV	G*E81005C*B*	38,000	30,000	14.5	11.5	1,425	7540802
	CSCF4860N6D*+TXV	G*VM970804CNA*	38,000	30,000	14.5	11.5	1,425	7541018
	CSCF4860N6D*+TXV	G*E80805D*A*	38,000	30,000	14.5	11.5	1,425	7540818
CSCF4860N6D*+TXV	A*VC960804CNA*	38,000	30,000	14.5	11.5	1,385	7540962	
ASX14 0431K*	ASPT47D14A*		38,000	30,000	14.5	12.2	1,250	8245649
	ASPT49D14A*		39,000	30,800	14.5	12.2	1,425	8245650
	ASPT59C14A*		38,000	30,000	14.0	12.2	1,260	8245647
	AVPTC48D14A*		38,000	30,000	15.0	12.5	1,310	8082852
	AVPTC49D14A*		38,000	30,000	15.0	12.5	1,320	8996368
	CA*F4961*6D*	A*VC80805D*B*	39,000	31,800	14.5	12.2	1,350	9947509
	CA*F4961*6D*	G*VC80805C*B*	39,000	30,800	14.5	12.2	1,400	8082899
	CA*F4961*6D*	G*EC961205DNA*	39,000	30,800	14.5	12.2	1,400	8083048
	CA*F4961*6D*	G*VM971205DNA*	39,000	30,800	14.5	12.2	1,300	8082999
	CA*F4961*6D*	A*VM970804CNA*	39,000	30,800	14.5	12.2	1,430	8083008
	CA*F4961*6D*	G*VM971005CNA*	39,000	30,800	14.5	12.2	1,300	8082991
	CA*F4961*6D*	A*EC961004CNA*	39,000	30,800	14.5	12.2	1,275	8083060
	CA*F4961*6D*	G*VC961005CNA*	39,000	30,800	14.5	12.2	1,300	8082940
	CA*F4961*6D*	G*VM970804CNA*	39,000	30,800	14.5	12.2	1,430	8082982
	CA*F4961*6D*	A*VC961005CNA*	39,000	30,800	14.5	12.2	1,300	8082965
	CA*F4961*6D*	A*EC961205DNA*	39,000	30,800	14.5	12.2	1,400	8083069
	CA*F4961*6D*	A*VC961205DNA*	39,000	30,800	14.5	12.2	1,450	8082974
	CA*F4961*6D*	G*VC961205DNA*	39,000	30,800	14.5	12.2	1,450	8082948
	CA*F4961*6D*	A*VM971005CNA*	39,000	30,800	14.5	12.2	1,300	8083017
	CA*F4961*6D*	G*VC960804CNA*	39,000	30,800	14.5	12.2	1,385	8082933
	CA*F4961*6D*	A*VM971205DNA*	39,000	30,800	14.5	12.2	1,300	8083026
	CA*F4961*6D*	G*VC81005C*B*	39,000	30,800	14.5	12.2	1,370	8082907
	CA*F4961*6D*	G*E80805D*A*	39,000	30,800	14.5	12.2	1,425	8082882
	CA*F4961*6D*	G*EC961004CNA*	39,000	30,800	14.5	12.2	1,275	8083034
	CA*F4961*6D*	A*VC960804CNA*	39,000	30,800	14.5	12.2	1,385	8082956
	CA*F4961*6D*	A*VC80805C*B*	39,000	30,800	14.5	12.2	1,400	8082916
	CA*F4961*6D*	G*E81005C*B*	39,000	30,800	14.5	12.2	1,425	8082890
	CA*F4961*6D*	A*VC81005C*B*	39,000	30,800	14.5	12.2	1,370	8082924

See Notes on Page 74.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0431K* (cont.)	CA*F4961*6D*	G*E80805C*B*	39,000	30,800	14.5	12.2	1,425	8082873
	CA*F4961*6D*+EEP		39,000	30,800	14.0	12.2	1,400	8082854
	CA*F4961*6D*+EEP+TXV		39,000	30,800	14.0	12.2	1,400	8082856
	CA*F4961*6D*+MBVC1600**-1A*		39,000	30,800	14.5	12.2	1,300	8082858
	CA*F4961*6D*+MBVC2000**-1A*		39,000	30,800	14.5	12.2	1,300	8082860
	CA*F4961*6D*+TXV	A*VC80805D*B*	39,000	31,800	14.5	12.2	1,350	9947510
	CA*F4961*6D*+TXV	A*EC961205DNA*	39,000	30,800	14.5	12.2	1,400	8083071
	CA*F4961*6D*+TXV	A*VC961005CNA*	39,000	30,800	14.5	12.2	1,300	8082967
	CA*F4961*6D*+TXV	G*E80805D*A*	39,000	30,800	14.5	12.2	1,425	8082884
	CA*F4961*6D*+TXV	G*VM971005CNA*	39,000	30,800	14.5	12.2	1,300	8082993
	CA*F4961*6D*+TXV	A*VM971205DNA*	39,000	30,800	14.5	12.2	1,300	8083028
	CA*F4961*6D*+TXV	G*VC80805C*B*	39,000	30,800	14.5	12.2	1,400	8082901
	CA*F4961*6D*+TXV	G*EC961205DNA*	39,000	30,800	14.5	12.2	1,400	8083050
	CA*F4961*6D*+TXV	A*VC80805C*B*	39,000	30,800	14.5	12.2	1,400	8082918
	CA*F4961*6D*+TXV	A*VC960804CNA*	39,000	30,800	14.5	12.2	1,385	8082959
	CA*F4961*6D*+TXV	A*VC81005C*B*	39,000	30,800	14.5	12.2	1,370	8082927
	CA*F4961*6D*+TXV	A*VM970804CNA*	39,000	30,800	14.5	12.2	1,430	8083010
	CA*F4961*6D*+TXV	A*EC961004CNA*	39,000	30,800	14.5	12.2	1,275	8083061
	CA*F4961*6D*+TXV	G*VC960804CNA*	39,000	30,800	14.5	12.2	1,385	8082935
	CA*F4961*6D*+TXV	A*VC961205DNA*	39,000	30,800	14.5	12.2	1,450	8082975
	CA*F4961*6D*+TXV	G*VC961005CNA*	39,000	30,800	14.5	12.2	1,300	8082942
	CA*F4961*6D*+TXV	G*E81005C*B*	39,000	30,800	14.5	12.2	1,425	8082892
	CA*F4961*6D*+TXV	G*E80805C*B*	39,000	30,800	14.5	12.2	1,425	8082875
	CA*F4961*6D*+TXV	G*VC81005C*B*	39,000	30,800	14.5	12.2	1,370	8082909
	CA*F4961*6D*+TXV	G*EC961004CNA*	39,000	30,800	14.5	12.2	1,275	8083037
	CA*F4961*6D*+TXV	A*VM971005CNA*	39,000	30,800	14.5	12.2	1,300	8083019
	CA*F4961*6D*+TXV	G*VM971205DNA*	39,000	30,800	14.5	12.2	1,300	8083002
	CA*F4961*6D*+TXV	G*VM970804CNA*	39,000	30,800	14.5	12.2	1,430	8082984
	CA*F4961*6D*+TXV	G*VC961205DNA*	39,000	30,800	14.5	12.2	1,450	8082950
	CAPT4961*4A*+MBVC1600**-1A*		39,000	30,800	14.5	12.2	1,300	8082862
	CAPT4961*4A*+MBVC2000**-1A*		39,000	30,800	14.5	12.2	1,300	8082864
	CHPF4860D6D*	A*VC80805D*B*	38,000	31,000	14.5	12.2	1,350	9947511
	CHPF4860D6D*	A*VM971205DNA*	38,000	30,000	14.5	12.2	1,300	8083030
	CHPF4860D6D*	G*VC961005CNA*	38,000	30,000	14.5	12.2	1,300	8082944
	CHPF4860D6D*	A*VC961205DNA*	38,000	30,000	14.5	12.2	1,425	8082978
	CHPF4860D6D*	G*E80805C*B*	38,000	30,000	14.5	12.2	1,425	8082877
	CHPF4860D6D*	G*E81005C*B*	38,000	30,000	14.5	12.2	1,425	8082895
	CHPF4860D6D*	G*EC961004CNA*	38,000	30,000	14.5	12.2	1,275	8083039
	CHPF4860D6D*	A*VC81005C*B*	38,000	30,000	14.5	12.2	1,370	8082929
	CHPF4860D6D*	G*VC960804CNA*	38,000	30,000	14.5	12.2	1,385	8082937
	CHPF4860D6D*	G*E80805D*A*	38,000	30,000	14.5	12.2	1,425	8082886
	CHPF4860D6D*	G*VC81005C*B*	38,000	30,000	14.5	12.2	1,370	8082912
	CHPF4860D6D*	A*VC80805C*B*	38,000	30,000	14.5	12.2	1,400	8082920
	CHPF4860D6D*	G*VC80805C*B*	38,000	30,000	14.5	12.2	1,400	8082903
	CHPF4860D6D*	G*VM971005CNA*	38,000	30,000	14.5	12.2	1,300	8082995
	CHPF4860D6D*	A*EC961205DNA*	38,000	30,000	14.5	12.2	1,400	8083072
	CHPF4860D6D*	A*VM970804CNA*	38,000	30,000	14.5	12.2	1,425	8083013
	CHPF4860D6D*	A*VM971005CNA*	38,000	30,000	14.5	12.2	1,300	8083021
CHPF4860D6D*	G*VM970804CNA*	38,000	30,000	14.5	12.2	1,425	8082986	
CHPF4860D6D*	A*EC961004CNA*	38,000	30,000	14.5	12.2	1,275	8083063	
CHPF4860D6D*	G*VC961205DNA*	38,000	30,000	14.5	12.2	1,425	8082952	
CHPF4860D6D*	G*EC961205DNA*	38,000	30,000	14.5	12.2	1,400	8083052	
CHPF4860D6D*	A*VC960804CNA*	38,000	30,000	14.5	12.2	1,385	8082961	

See Notes on Page 74.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0431K* (cont.)	CHPF4860D6D*	A*VC961005CNA*	38,000	30,000	14.5	12.2	1,300	8082970
	CHPF4860D6D*	G*VM971205DNA*	38,000	30,000	14.5	12.2	1,300	8083004
	CHPF4860D6D*+EEP+TXV		38,000	30,000	14.0	12.2	1,425	8082866
	CHPF4860D6D*+MBVC1600**-1A*		38,000	30,000	14.5	12.2	1,400	8082869
	CHPF4860D6D*+MBVC2000**-1A*		38,000	30,000	14.5	12.2	1,400	8082871
	CHPF4860D6D*+TXV	A*VC80805D*B*	38,000	31,000	14.5	12.2	1,350	9947512
	CHPF4860D6D*+TXV	A*VC960804CNA*	38,000	30,000	14.5	12.2	1,385	8082963
	CHPF4860D6D*+TXV	G*VM971205DNA*	38,000	30,000	14.5	12.2	1,300	8083006
	CHPF4860D6D*+TXV	G*VC80805C*B*	38,000	30,000	14.5	12.2	1,400	8082905
	CHPF4860D6D*+TXV	G*VC960804CNA*	38,000	30,000	14.5	12.2	1,385	8082939
	CHPF4860D6D*+TXV	G*E80805C*B*	38,000	30,000	14.5	12.2	1,425	8082879
	CHPF4860D6D*+TXV	G*EC961004CNA*	38,000	30,000	14.5	12.2	1,275	8083041
	CHPF4860D6D*+TXV	G*EC961205DNA*	38,000	30,000	14.5	12.2	1,400	8083054
	CHPF4860D6D*+TXV	G*VM970804CNA*	38,000	30,000	14.5	12.2	1,425	8082988
	CHPF4860D6D*+TXV	G*VC961005CNA*	38,000	30,000	14.5	12.2	1,300	8082946
	CHPF4860D6D*+TXV	G*VM971005CNA*	38,000	30,000	14.5	12.2	1,300	8082997
	CHPF4860D6D*+TXV	A*VC961205DNA*	38,000	30,000	14.5	12.2	1,425	8082980
	CHPF4860D6D*+TXV	A*VM971005CNA*	38,000	30,000	14.5	12.2	1,300	8083023
	CHPF4860D6D*+TXV	A*VM971205DNA*	38,000	30,000	14.5	12.2	1,300	8083032
	CHPF4860D6D*+TXV	A*VM970804CNA*	38,000	30,000	14.5	12.2	1,425	8083015
	CHPF4860D6D*+TXV	A*VC80805C*B*	38,000	30,000	14.5	12.2	1,400	8082922
	CHPF4860D6D*+TXV	A*EC961205DNA*	38,000	30,000	14.5	12.2	1,400	8083074
	CHPF4860D6D*+TXV	G*E80805D*A*	38,000	30,000	14.5	12.2	1,425	8082888
	CHPF4860D6D*+TXV	G*E81005C*B*	38,000	30,000	14.5	12.2	1,425	8082897
	CHPF4860D6D*+TXV	G*VC81005C*B*	38,000	30,000	14.5	12.2	1,370	8082914
	CHPF4860D6D*+TXV	A*VC961005CNA*	38,000	30,000	14.5	12.2	1,300	8082972
	CHPF4860D6D*+TXV	A*EC961004CNA*	38,000	30,000	14.5	12.2	1,275	8083064
	CHPF4860D6D*+TXV	G*VC961205DNA*	38,000	30,000	14.5	12.2	1,425	8082954
	CHPF4860D6D*+TXV	A*VC81005C*B*	38,000	30,000	14.5	12.2	1,370	8082931
	CSCF4860N6D*	G*EC961205DNA*	38,000	30,000	14.5	12.2	1,400	8083056
	CSCF4860N6D*	A*EC961004CNA*	38,000	30,000	14.5	12.2	1,275	8083066
	CSCF4860N6D*	A*EC961205DNA*	38,000	30,000	14.5	12.2	1,400	8083076
CSCF4860N6D*	G*EC961004CNA*	38,000	30,000	14.5	12.2	1,275	8083043	
CSCF4860N6D*+TXV	A*EC961004CNA*	38,000	30,000	14.5	12.2	1,275	8083067	
CSCF4860N6D*+TXV	A*EC961205DNA*	38,000	30,000	14.5	12.2	1,400	8083077	
CSCF4860N6D*+TXV	G*EC961205DNA*	38,000	30,000	14.5	12.2	1,400	8083058	
CSCF4860N6D*+TXV	G*EC961004CNA*	38,000	30,000	14.5	12.2	1,275	8083045	
ASX14 0481K*	ARUF61D14A*		45,500	32,200	14.0	11.7	1,520	7989020
	ASPT59C14A*		45,500	32,200	14.0	12.0	1,430	8245652
	ASPT61D14A*		47,000	33,200	14.5	12.2	1,630	8245654
	AVPTC48D14A*		46,000	32,600	14.5	11.7	1,550	7541172
	AVPTC59C14A*		45,500	32,200	14.0	12.0	1,485	8996369
	AVPTC60D14A*		46,000	32,600	14.5	11.7	1,590	7541173
	AVPTC61D14A*		46,500	32,800	14.5	12.2	1,455	8996370
	CA*F4860*6D*	A*VM970804CNA*	45,000	31,800	14.5	11.7	1,385	7541338
	CA*F4860*6D*	A*VM971005CNA*	45,500	32,200	14.5	11.7	1,450	7541352
	CA*F4860*6D*	G*VC961005CNA*	45,500	32,200	14.5	11.7	1,450	7541252
	CA*F4860*6D*	G*VM971205DNA*	45,500	32,200	14.5	11.7	1,450	7541326
	CA*F4860*6D*	A*VC961205DNA*	45,500	32,200	14.5	11.7	1,450	7541289
	CA*F4860*6D*	G*VC961205DNA*	45,500	32,200	14.5	11.7	1,450	7541264
	CA*F4860*6D*	A*VC961005CNA*	45,500	32,200	14.5	11.7	1,450	7541281
	CA*F4860*6D*	A*VM971205DNA*	45,500	32,200	14.5	11.7	1,450	7541365
	CA*F4860*6D*	G*VC960804CNA*	45,000	31,800	14.5	11.7	1,385	7541239

See Notes on Page 74.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0481K* (cont.)	CA*F4860*6D*	G*VM970804CNA*	45,000	31,800	14.5	11.7	1,385	7541299
	CA*F4860*6D*	A*VC960804CNA*	45,000	31,800	14.5	11.7	1,385	7541272
	CA*F4860*6D*	G*VM971005CNA*	45,500	32,200	14.5	11.7	1,450	7541313
	CA*F4860*6D*+EEP		45,500	32,200	14.0	11.7	1,550	7541175
	CA*F4860*6D*+EEP+TXV		45,500	32,200	14.0	11.7	1,550	7541177
	CA*F4860*6D*+MBVC2000**-1A*+TXV		46,000	32,600	14.5	12.0	1,600	7541179
	CA*F4860*6D*+TXV	A*VC80805D*B*	45,500	35,000	14.5	11.7	1,500	9947513
	CA*F4860*6D*+TXV	G*EC961004CNA*	45,000	31,800	14.5	11.7	1,525	7541378
	CA*F4860*6D*+TXV	G*VC961205DNA*	45,500	32,200	14.5	12.0	1,450	7541265
	CA*F4860*6D*+TXV	A*EC961004CNA*	45,000	31,800	14.5	11.7	1,525	7541387
	CA*F4860*6D*+TXV	A*VC961205DNA*	45,500	32,200	14.5	12.0	1,450	7541291
	CA*F4860*6D*+TXV	G*VC80805C*B*	45,500	32,200	14.5	11.7	1,510	7541212
	CA*F4860*6D*+TXV	G*VM971005CNA*	45,500	32,200	14.5	12.0	1,450	7541315
	CA*F4860*6D*+TXV	G*VC960804CNA*	45,000	31,800	14.5	12.0	1,385	7541241
	CA*F4860*6D*+TXV	G*VC961005CNA*	45,500	32,200	14.5	12.0	1,450	7541254
	CA*F4860*6D*+TXV	G*EC961205DNA*	45,000	31,800	14.5	12.0	1,525	7541382
	CA*F4860*6D*+TXV	A*EC961205DNA*	45,000	31,800	14.5	12.0	1,525	7541392
	CA*F4860*6D*+TXV	A*VC960804CNA*	45,000	31,800	14.5	12.0	1,385	7541274
	CA*F4860*6D*+TXV	A*VC80805C*B*	45,500	32,200	14.5	11.7	1,510	7541225
	CA*F4860*6D*+TXV	G*E80805C*B*	45,000	31,800	14.5	11.7	1,480	7541199
	CA*F4860*6D*+TXV	G*E81005C*B*	45,500	32,200	14.5	11.7	1,570	7541205
	CA*F4860*6D*+TXV	A*VM971005CNA*	45,500	32,200	14.5	12.0	1,450	7541354
	CA*F4860*6D*+TXV	A*VC81005C*B*	45,500	32,200	14.5	11.7	1,530	7541232
	CA*F4860*6D*+TXV	G*VC81005C*B*	45,500	32,200	14.5	11.7	1,530	7541218
	CA*F4860*6D*+TXV	A*VM970804CNA*	45,000	31,800	14.5	12.0	1,385	7541340
	CA*F4860*6D*+TXV	A*VM971205DNA*	45,500	32,200	14.5	12.0	1,450	7541367
	CA*F4860*6D*+TXV	G*VM970804CNA*	45,000	31,800	14.5	12.0	1,385	7541302
	CA*F4860*6D*+TXV	G*VM971205DNA*	45,500	32,200	14.5	12.0	1,450	7541328
	CA*F4860*6D*+TXV	A*VC961005CNA*	45,500	32,200	14.5	12.0	1,450	7541282
	CA*F4961*6D*+EEP		46,000	32,600	14.0	11.7	1,550	7541180
	CA*F4961*6D*+EEP+TXV		46,000	32,600	14.0	11.7	1,550	7541182
	CA*F4961*6D*+MBVC2000**-1A*+TXV		46,000	32,600	14.5	12.0	1,600	7541183
	CAPT4961*4A*	A*VC80805D*B*	45,500	35,000	14.5	11.7	1,500	9947514
	CAPT4961*4A*	G*VC80805C*B*	45,500	32,200	14.5	11.7	1,510	7547538
	CAPT4961*4A*	G*VC961005CNA*	45,500	32,200	14.5	11.7	1,450	7547543
	CAPT4961*4A*	G*VC961205DNA*	45,500	32,200	14.5	11.7	1,450	7547544
	CAPT4961*4A*	G*VM971205DNA*	45,500	32,200	14.5	11.7	1,450	7547550
	CAPT4961*4A*	G*E80805C*B*	45,000	31,800	14.5	11.7	1,480	7547536
	CAPT4961*4A*	A*EC961004CNA*	45,000	31,800	14.5	11.7	1,525	7547556
	CAPT4961*4A*	A*VC80805C*B*	45,500	32,200	14.5	11.7	1,510	7547540
	CAPT4961*4A*	G*VM971005CNA*	45,500	32,200	14.5	11.7	1,450	7547549
	CAPT4961*4A*	G*E81005C*B*	45,500	32,200	14.5	11.7	1,570	7547537
	CAPT4961*4A*	A*VM971205DNA*	45,500	32,200	14.5	11.7	1,450	7547553
	CAPT4961*4A*	G*VM970804CNA*	45,000	31,800	14.5	11.7	1,385	7547548
	CAPT4961*4A*	A*VC81005C*B*	45,500	32,200	14.5	11.7	1,530	7547541
	CAPT4961*4A*	A*VC961205DNA*	45,500	32,200	14.5	11.7	1,450	7547547
	CAPT4961*4A*	G*EC961004CNA*	45,000	31,800	14.5	11.7	1,525	7547554
	CAPT4961*4A*	A*VC960804CNA*	45,000	31,800	14.5	11.7	1,385	7547545
CAPT4961*4A*	A*VM970804CNA*	45,000	31,800	14.5	11.7	1,385	7547551	
CAPT4961*4A*	A*EC961205DNA*	45,000	31,800	14.5	12.0	1,525	7547557	
CAPT4961*4A*	G*VC960804CNA*	45,000	31,800	14.5	11.7	1,385	7547542	
CAPT4961*4A*	A*VM971005CNA*	45,500	32,200	14.5	11.7	1,450	7547552	
CAPT4961*4A*	A*VC961005CNA*	45,500	32,200	14.5	11.7	1,450	7547546	

See Notes on Page 74.

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0481K* (cont.)	CAPT4961*4A*	G*EC961205DNA*	45,000	31,800	14.5	12.0	1,525	7547555
	CAPT4961*4A*	G*VC81005C*B*	45,500	32,200	14.5	11.7	1,530	7547539
	CAPT4961*4A*+EEP		46,000	32,600	14.0	11.7	1,550	7541185
	CAPT4961*4A*+MBVC2000**-1A*		45,000	31,800	14.5	11.7	1,595	7541187
	CHPF4860D6D*	A*VM971005CNA*	45,500	32,200	14.5	11.7	1,450	7541356
	CHPF4860D6D*	G*VC960804CNA*	45,000	31,800	14.5	11.7	1,385	7541244
	CHPF4860D6D*	G*VC961205DNA*	45,500	32,200	14.5	11.7	1,450	7541267
	CHPF4860D6D*	A*VC961005CNA*	45,500	32,200	14.5	11.7	1,450	7541284
	CHPF4860D6D*	A*VM971205DNA*	45,500	32,200	14.5	11.7	1,450	7541369
	CHPF4860D6D*	A*VM970804CNA*	45,000	31,800	14.5	11.7	1,385	7541343
	CHPF4860D6D*	G*VM971205DNA*	45,500	32,200	14.5	11.7	1,450	7541330
	CHPF4860D6D*	G*VC961005CNA*	45,500	32,200	14.5	11.7	1,450	7541257
	CHPF4860D6D*	A*VC961205DNA*	45,500	32,200	14.5	11.7	1,450	7541292
	CHPF4860D6D*	G*VM970804CNA*	45,000	31,800	14.5	11.7	1,385	7541304
	CHPF4860D6D*	A*VC960804CNA*	45,000	31,800	14.5	11.7	1,385	7541275
	CHPF4860D6D*	G*VM971005CNA*	45,500	32,200	14.5	11.7	1,450	7541318
	CHPF4860D6D*+EEP		46,000	32,600	14.0	11.7	1,550	7541189
	CHPF4860D6D*+EEP+TXV		46,000	32,600	14.0	11.7	1,550	7541191
	CHPF4860D6D*+MBVC2000**-1A*+TXV		46,000	32,600	14.5	12.0	1,600	7541193
	CHPF4860D6D*+TXV	A*VC80805D*B*	45,500	35,000	14.5	11.7	1,500	9947515
	CHPF4860D6D*+TXV	A*VC81005C*B*	45,500	32,200	14.5	11.7	1,530	7541235
	CHPF4860D6D*+TXV	A*VM971005CNA*	45,500	32,200	14.5	12.0	1,450	7541358
	CHPF4860D6D*+TXV	G*VC961205DNA*	45,500	32,200	14.5	12.0	1,450	7541268
	CHPF4860D6D*+TXV	A*EC961205DNA*	45,000	31,800	14.5	12.0	1,525	7541394
	CHPF4860D6D*+TXV	G*E80805C*B*	45,000	31,800	14.5	11.7	1,480	7541201
	CHPF4860D6D*+TXV	A*VC961205DNA*	45,500	32,200	14.5	12.0	1,450	7541294
	CHPF4860D6D*+TXV	G*VM970804CNA*	45,000	31,800	14.5	12.0	1,385	7541307
	CHPF4860D6D*+TXV	A*EH800805C*A*	45,000	31,800	14.5	11.7	1,480	8953012
	CHPF4860D6D*+TXV	A*VM970804CNA*	45,000	31,800	14.5	12.0	1,385	7541345
	CHPF4860D6D*+TXV	G*E81005C*B*	45,500	32,200	14.5	11.7	1,570	7541208
	CHPF4860D6D*+TXV	G*EC961205DNA*	45,000	31,800	14.5	12.0	1,525	7541385
	CHPF4860D6D*+TXV	A*VC961005CNA*	45,500	32,200	14.5	12.0	1,450	7541285
	CHPF4860D6D*+TXV	A*VC960804CNA*	45,000	31,800	14.5	12.0	1,385	7541277
	CHPF4860D6D*+TXV	G*VM971205DNA*	45,500	32,200	14.5	12.0	1,450	7541332
	CHPF4860D6D*+TXV	A*VC80805C*B*	45,500	32,200	14.5	11.7	1,510	7541227
	CHPF4860D6D*+TXV	A*EH801005C*A*	45,500	32,200	14.5	11.7	1,570	8953014
	CHPF4860D6D*+TXV	G*VC960804CNA*	45,000	31,800	14.5	12.0	1,385	7541246
	CHPF4860D6D*+TXV	A*VM971205DNA*	45,500	32,200	14.5	12.0	1,450	7541371
	CHPF4860D6D*+TXV	G*VM971005CNA*	45,500	32,200	14.5	12.0	1,450	7541320
	CHPF4860D6D*+TXV	G*VC81005C*B*	45,500	32,200	14.5	11.7	1,530	7541221
	CHPF4860D6D*+TXV	G*VC80805C*B*	45,500	32,200	14.5	11.7	1,510	7541214
	CHPF4860D6D*+TXV	G*VC961005CNA*	45,500	32,200	14.5	12.0	1,450	7541259
CHPF4860D6D*+TXV	A*EC961004CNA*	45,000	31,800	14.5	11.7	1,525	7541390	
CHPF4860D6D*+TXV	G*EC961004CNA*	45,000	31,800	14.5	11.7	1,525	7541380	
CSCF4860N6D*	G*VM970804CNA*	45,000	31,800	14.5	11.7	1,385	7541309	
CSCF4860N6D*	A*VC961205DNA*	45,500	32,200	14.5	11.7	1,450	7541295	
CSCF4860N6D*	A*VC960804CNA*	45,000	31,800	14.5	11.7	1,385	7541278	
CSCF4860N6D*	A*VM971205DNA*	45,500	32,200	14.5	11.7	1,450	7541374	
CSCF4860N6D*	G*VC961005CNA*	45,500	32,200	14.5	11.7	1,450	7541262	
CSCF4860N6D*	A*VM971005CNA*	45,500	32,200	14.5	11.7	1,450	7541361	
CSCF4860N6D*	A*VC961005CNA*	45,500	32,200	14.5	11.7	1,450	7541287	
CSCF4860N6D*	G*VM971205DNA*	45,500	32,200	14.5	11.7	1,450	7541334	
CSCF4860N6D*	G*VC961205DNA*	45,500	32,200	14.5	11.7	1,450	7541269	

See Notes on Page 74.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0481K* (cont.)	CSCF4860N6D*	G*VC960804CNA*	45,000	31,800	14.5	11.7	1,385	7541248
	CSCF4860N6D*	A*VM970804CNA*	45,000	31,800	14.5	11.7	1,385	7541347
	CSCF4860N6D*	G*VM971005CNA*	45,500	32,200	14.5	11.7	1,450	7541322
	CSCF4860N6D*+EEP		45,500	32,200	14.0	11.7	1,550	7541195
	CSCF4860N6D*+EEP+TXV		45,500	32,200	14.0	11.7	1,550	7541197
	CSCF4860N6D*+TXV	A*VC80805D*B*	45,500	35,000	14.5	11.7	1,500	9947516
	CSCF4860N6D*+TXV	A*VC961205DNA*	45,500	32,200	14.5	11.7	1,450	7541297
	CSCF4860N6D*+TXV	G*VC81005C*B*	45,500	32,200	14.5	11.7	1,530	7541223
	CSCF4860N6D*+TXV	A*VC80805C*B*	45,500	32,200	14.5	11.7	1,510	7541230
	CSCF4860N6D*+TXV	A*VM971205DNA*	45,500	32,200	14.5	11.7	1,450	7541376
	CSCF4860N6D*+TXV	G*VM971005CNA*	45,500	32,200	14.5	11.7	1,450	7541324
	CSCF4860N6D*+TXV	A*VC81005C*B*	45,500	32,200	14.5	11.7	1,530	7541236
	CSCF4860N6D*+TXV	G*VC80805C*B*	45,500	32,200	14.5	11.7	1,510	7541216
	CSCF4860N6D*+TXV	A*VC961005CNA*	45,500	32,200	14.5	11.7	1,450	7541288
	CSCF4860N6D*+TXV	G*VC961005CNA*	45,500	32,200	14.5	11.7	1,450	7541263
	CSCF4860N6D*+TXV	G*VC960804CNA*	45,000	31,800	14.5	12.0	1,385	7541250
	CSCF4860N6D*+TXV	G*E81005C*B*	45,000	31,800	14.5	11.7	1,570	7541210
	CSCF4860N6D*+TXV	A*VM970804CNA*	45,000	31,800	14.5	11.7	1,385	7541349
	CSCF4860N6D*+TXV	G*VM971205DNA*	45,500	32,200	14.5	11.7	1,450	7541336
	CSCF4860N6D*+TXV	G*E80805C*B*	45,000	31,800	14.5	11.7	1,480	7541203
CSCF4860N6D*+TXV	G*VM970804CNA*	45,000	31,800	14.5	11.7	1,385	7541311	
CSCF4860N6D*+TXV	A*VM971005CNA*	45,500	32,200	14.5	11.7	1,450	7541363	
CSCF4860N6D*+TXV	A*VC960804CNA*	45,000	31,800	14.5	12.0	1,385	7541279	
CSCF4860N6D*+TXV	G*VC961205DNA*	45,500	32,200	14.5	11.7	1,450	7541271	
ASX14 0601K*	ASPT61D14A*		57,000	40,000	14.0	11.7	1,645	7989021
	AVPTC60D14A*		57,000	40,000	14.0	11.7	1,620	7541398
	AVPTC61D14A*		57,000	40,000	14.5	12.0	1,775	8996371
	CA*F4961*6D*	A*VM971205DNA*	56,500	40,000	14.0	11.7	1,575	7541541
	CA*F4961*6D*	A*VC961205DNA*	56,500	40,000	14.0	11.7	1,575	7541495
	CA*F4961*6D*	G*VM971205DNA*	56,500	40,000	14.0	11.7	1,575	7541518
	CA*F4961*6D*	G*VC961205DNA*	56,500	40,000	14.0	11.7	1,575	7541472
	CA*F4961*6D*+EEP+TXV		57,000	40,000	14.0	11.7	1,545	7541400
	CA*F4961*6D*+MBVC2000**-1A*+TXV		57,000	40,000	14.5	12.0	1,620	7541402
	CA*F4961*6D*+TXV	A*VC80805D*B*	57,000	41,500	14.5	11.7	1,650	9947517
	CA*F4961*6D*+TXV	G*VC961005CNA*	57,000	40,000	14.0	11.7	1,525	7541464
	CA*F4961*6D*+TXV	G*VC80805C*B*	57,000	40,000	14.5	11.7	1,560	7541436
	CA*F4961*6D*+TXV	G*VC961205DNA*	57,000	40,000	14.5	12.0	1,575	7541474
	CA*F4961*6D*+TXV	G*EC961205DNA*	57,000	40,000	14.0	11.7	1,525	7541555
	CA*F4961*6D*+TXV	A*VM971205DNA*	57,000	40,000	14.5	12.0	1,575	7541543
	CA*F4961*6D*+TXV	A*VC961205DNA*	57,000	40,000	14.5	12.0	1,575	7541497
	CA*F4961*6D*+TXV	A*VC81005C*B*	57,000	40,000	14.5	11.7	1,525	7541457
	CA*F4961*6D*+TXV	A*EC961205DNA*	57,000	40,000	14.0	11.7	1,525	7541563
	CA*F4961*6D*+TXV	A*VC961005CNA*	57,000	40,000	14.0	11.7	1,525	7541486
	CA*F4961*6D*+TXV	G*VM971005CNA*	57,000	40,000	14.0	11.7	1,525	7541510
	CA*F4961*6D*+TXV	G*E81005C*B*	57,000	40,000	14.5	11.7	1,600	7541429
	CA*F4961*6D*+TXV	A*VM971005CNA*	57,000	40,000	14.0	11.7	1,525	7541532
	CA*F4961*6D*+TXV	A*VC80805C*B*	57,000	40,000	14.5	11.7	1,560	7541450
	CA*F4961*6D*+TXV	G*E80805C*B*	57,000	40,000	14.5	11.7	1,525	7541414
	CA*F4961*6D*+TXV	G*E80805D*A*	57,000	40,000	14.5	12.0	1,500	7541422

See Notes on Page 74.



OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0601K* (cont.)	CA*F4961*6D*+TXV	G*VM971205DNA*	57,000	40,000	14.5	12.0	1,575	7541520
	CA*F4961*6D*+TXV	G*VC81005C*B*	57,000	40,000	14.5	11.7	1,525	7541443
	CAPT4961*4A*	A*VC80805D*B*	57,000	41,500	14.0	11.7	1,650	9947518
	CAPT4961*4A*	G*VC80805C*B*	57,000	40,000	14.0	11.7	1,560	7547561
	CAPT4961*4A*	A*VC961005CNA*	57,000	40,000	14.0	11.7	1,525	7541488
	CAPT4961*4A*	A*VC961205DNA*	56,500	40,000	14.0	11.7	1,575	7541499
	CAPT4961*4A*	A*VC81005C*B*	57,000	40,000	14.0	11.7	1,525	7547564
	CAPT4961*4A*	A*VM971205DNA*	56,500	40,000	14.0	11.7	1,575	7541545
	CAPT4961*4A*	G*E81005C*B*	57,000	40,000	14.0	11.7	1,600	7547560
	CAPT4961*4A*	G*E80805D*A*	57,000	40,000	14.0	12.0	1,500	7547559
	CAPT4961*4A*	A*EC961205DNA*	56,500	40,000	14.0	11.7	1,525	7541566
	CAPT4961*4A*	G*VC961005CNA*	57,000	40,000	14.0	11.7	1,525	7541466
	CAPT4961*4A*	G*VC961205DNA*	56,500	40,000	14.0	11.7	1,575	7541476
	CAPT4961*4A*	A*VM971005CNA*	57,000	40,000	14.0	11.7	1,525	7541534
	CAPT4961*4A*	G*VM971005CNA*	57,000	40,000	14.0	11.7	1,525	7541512
	CAPT4961*4A*	G*VM971205DNA*	56,500	40,000	14.0	11.7	1,575	7541522
	CAPT4961*4A*	G*VC81005C*B*	57,000	40,000	14.0	11.7	1,525	7547562
	CAPT4961*4A*	G*E80805C*B*	57,000	40,000	14.0	11.7	1,525	7547558
	CAPT4961*4A*	G*EC961205DNA*	56,500	40,000	14.0	11.7	1,525	7541557
	CAPT4961*4A*	A*VC80805C*B*	57,000	40,000	14.0	11.7	1,560	7547563
	CAPT4961*4A*+EEP		57,000	40,000	14.0	11.7	1,545	7541404
	CHPF4860D6D*	G*VC961205DNA*	56,500	40,000	14.0	11.7	1,575	7541478
	CHPF4860D6D*	G*VM971205DNA*	56,500	40,000	14.0	11.7	1,575	7541524
	CHPF4860D6D*	A*VM971205DNA*	56,500	40,000	14.0	11.7	1,575	7541547
	CHPF4860D6D*	A*VC961205DNA*	56,500	40,000	14.0	11.7	1,575	7541501
	CHPF4860D6D*+EEP+TXV		57,000	40,000	14.0	11.7	1,545	7541406
	CHPF4860D6D*+MBVC2000**-1A*+TXV		57,000	40,000	14.5	12.0	1,620	7541408
	CHPF4860D6D*+TXV	A*VC80805D*B*	57,000	41,500	14.5	11.7	1,650	9947519
	CHPF4860D6D*+TXV	A*VC961205DNA*	57,000	40,000	14.5	12.0	1,575	7541503
	CHPF4860D6D*+TXV	G*E81005C*B*	57,000	40,000	14.5	11.7	1,600	7541432
	CHPF4860D6D*+TXV	G*VC80805C*B*	57,000	40,000	14.5	11.7	1,560	7541439
	CHPF4860D6D*+TXV	A*VC80805C*B*	57,000	40,000	14.5	11.7	1,560	7541453
	CHPF4860D6D*+TXV	A*VM971005CNA*	57,000	40,000	14.0	11.7	1,525	7541537
	CHPF4860D6D*+TXV	G*EC961205DNA*	57,000	40,000	14.0	11.7	1,525	7541559
	CHPF4860D6D*+TXV	G*E80805D*A*	57,000	40,000	14.5	12.0	1,500	7541424
	CHPF4860D6D*+TXV	A*EC961205DNA*	57,000	40,000	14.0	11.7	1,525	7541568
	CHPF4860D6D*+TXV	A*VM971205DNA*	57,000	40,000	14.5	12.0	1,575	7541549
	CHPF4860D6D*+TXV	G*VC961005CNA*	57,000	40,000	14.0	11.7	1,525	7541468
	CHPF4860D6D*+TXV	A*VC81005C*B*	57,000	40,000	14.5	11.7	1,525	7541459
	CHPF4860D6D*+TXV	A*VC961005CNA*	57,000	40,000	14.0	11.7	1,525	7541490
	CHPF4860D6D*+TXV	G*VC81005C*B*	57,000	40,000	14.5	11.7	1,525	7541446
	CHPF4860D6D*+TXV	G*VC961205DNA*	57,000	40,000	14.5	12.0	1,575	7541480
CHPF4860D6D*+TXV	A*EH801005C*A*	57,000	40,000	14.5	11.7	1,600	8953018	
CHPF4860D6D*+TXV	G*VM971205DNA*	57,000	40,000	14.5	12.0	1,575	7541526	
CHPF4860D6D*+TXV	G*E80805C*B*	57,000	40,000	14.5	11.7	1,525	7541417	
CHPF4860D6D*+TXV	G*VM971005CNA*	57,000	40,000	14.0	11.7	1,525	7541514	
CHPF4860D6D*+TXV	A*EH800805C*A*	57,000	40,000	14.5	11.7	1,525	8953016	
CSCF4860N6D*	A*VM971205DNA*	56,500	40,000	14.0	11.7	1,575	7541551	
CSCF4860N6D*	G*VC961205DNA*	56,500	40,000	14.0	11.7	1,575	7541482	

See Notes on Page 74.

AHRI RATINGS (CONT.)

OUTDOOR UNIT	INDOOR UNITS		COOLING RATINGS				CFM	AHRI #
	COILS/AIR HANDLERS	FURNACES	TOTAL <sup>1</sup>	SENS. <sup>1</sup>	SEER <sup>2</sup>	EER <sup>3</sup>		
ASX14 0601K* (cont.)	CSCF4860N6D*	G*VM971205DNA*	56,500	40,000	14.0	11.7	1,575	7541528
	CSCF4860N6D*	A*VC961205DNA*	56,500	40,000	14.0	11.7	1,575	7541506
	CSCF4860N6D*+EEP+TXV		57,000	40,000	14.0	11.7	1,545	7541410
	CSCF4860N6D*+MBVC2000**-1A*+TXV		57,000	40,000	14.5	12.0	1,620	7541412
	CSCF4860N6D*+TXV	A*VC80805D*B*	57,000	41,500	14.5	11.7	1,650	9947520
	CSCF4860N6D*+TXV	G*VC80805C*B*	57,000	40,000	14.5	11.7	1,560	7541441
	CSCF4860N6D*+TXV	G*VC81005C*B*	57,000	40,000	14.5	11.7	1,525	7541448
	CSCF4860N6D*+TXV	G*E81005C*B*	57,000	40,000	14.5	11.7	1,600	7541434
	CSCF4860N6D*+TXV	G*VM971005CNA*	57,000	40,000	14.0	11.7	1,525	7541516
	CSCF4860N6D*+TXV	G*VC961205DNA*	57,000	40,000	14.5	12.0	1,575	7541484
	CSCF4860N6D*+TXV	A*VC81005C*B*	57,000	40,000	14.5	11.7	1,525	7541462
	CSCF4860N6D*+TXV	A*VC961005CNA*	57,000	40,000	14.0	11.7	1,525	7541492
	CSCF4860N6D*+TXV	A*EC961205DNA*	57,000	40,000	14.0	11.7	1,525	7541570
	CSCF4860N6D*+TXV	G*E80805C*B*	57,000	40,000	14.5	11.7	1,525	7541420
	CSCF4860N6D*+TXV	A*VM971205DNA*	57,000	40,000	14.5	12.0	1,575	7541553
	CSCF4860N6D*+TXV	G*VM971205DNA*	57,000	40,000	14.5	12.0	1,575	7541530
	CSCF4860N6D*+TXV	G*VC961005CNA*	57,000	40,000	14.0	11.7	1,525	7541470
	CSCF4860N6D*+TXV	G*EC961205DNA*	57,000	40,000	14.0	11.7	1,525	7541561
	CSCF4860N6D*+TXV	G*E80805D*A*	57,000	40,000	14.5	12.0	1,500	7541426
	CSCF4860N6D*+TXV	A*VM971005CNA*	57,000	40,000	14.0	11.7	1,525	7541539
CSCF4860N6D*+TXV	A*VC961205DNA*	57,000	40,000	14.5	12.0	1,575	7541508	
CSCF4860N6D*+TXV	A*VC80805C*B*	57,000	40,000	14.5	11.7	1,560	7541455	


<sup>1</sup> BTU/h

<sup>2</sup> Seasonal Energy Efficiency Ratio; Certified per AHRI 210/240 @ 80°F/ 67°F/ 95°F

<sup>3</sup> Energy Efficiency Ratio @ 80°F/ 67°F/ 95°F

**NOTES**

- Always check the S&R plate for electrical data on the unit being installed.
- When matching the outdoor unit to the indoor unit, use the piston supplied with the outdoor unit or that specified on the piston kit chart supplied with the indoor unit.
- EEP - Order from Service Dept. Part No. B13707-38 or new Solid State Board B13707-35S. Part No. B13707-38 is not interchangeable with B13707-35S. The Amana brand Gas Furnace contains the EEP cooling time delay.
- HSK - Hard Start Kit: This is an additional capacitor to assist with compressor start-up, used with the standard "run" capacitor that is supplied in the unit. Order from an Amana® brand distributor or service department.

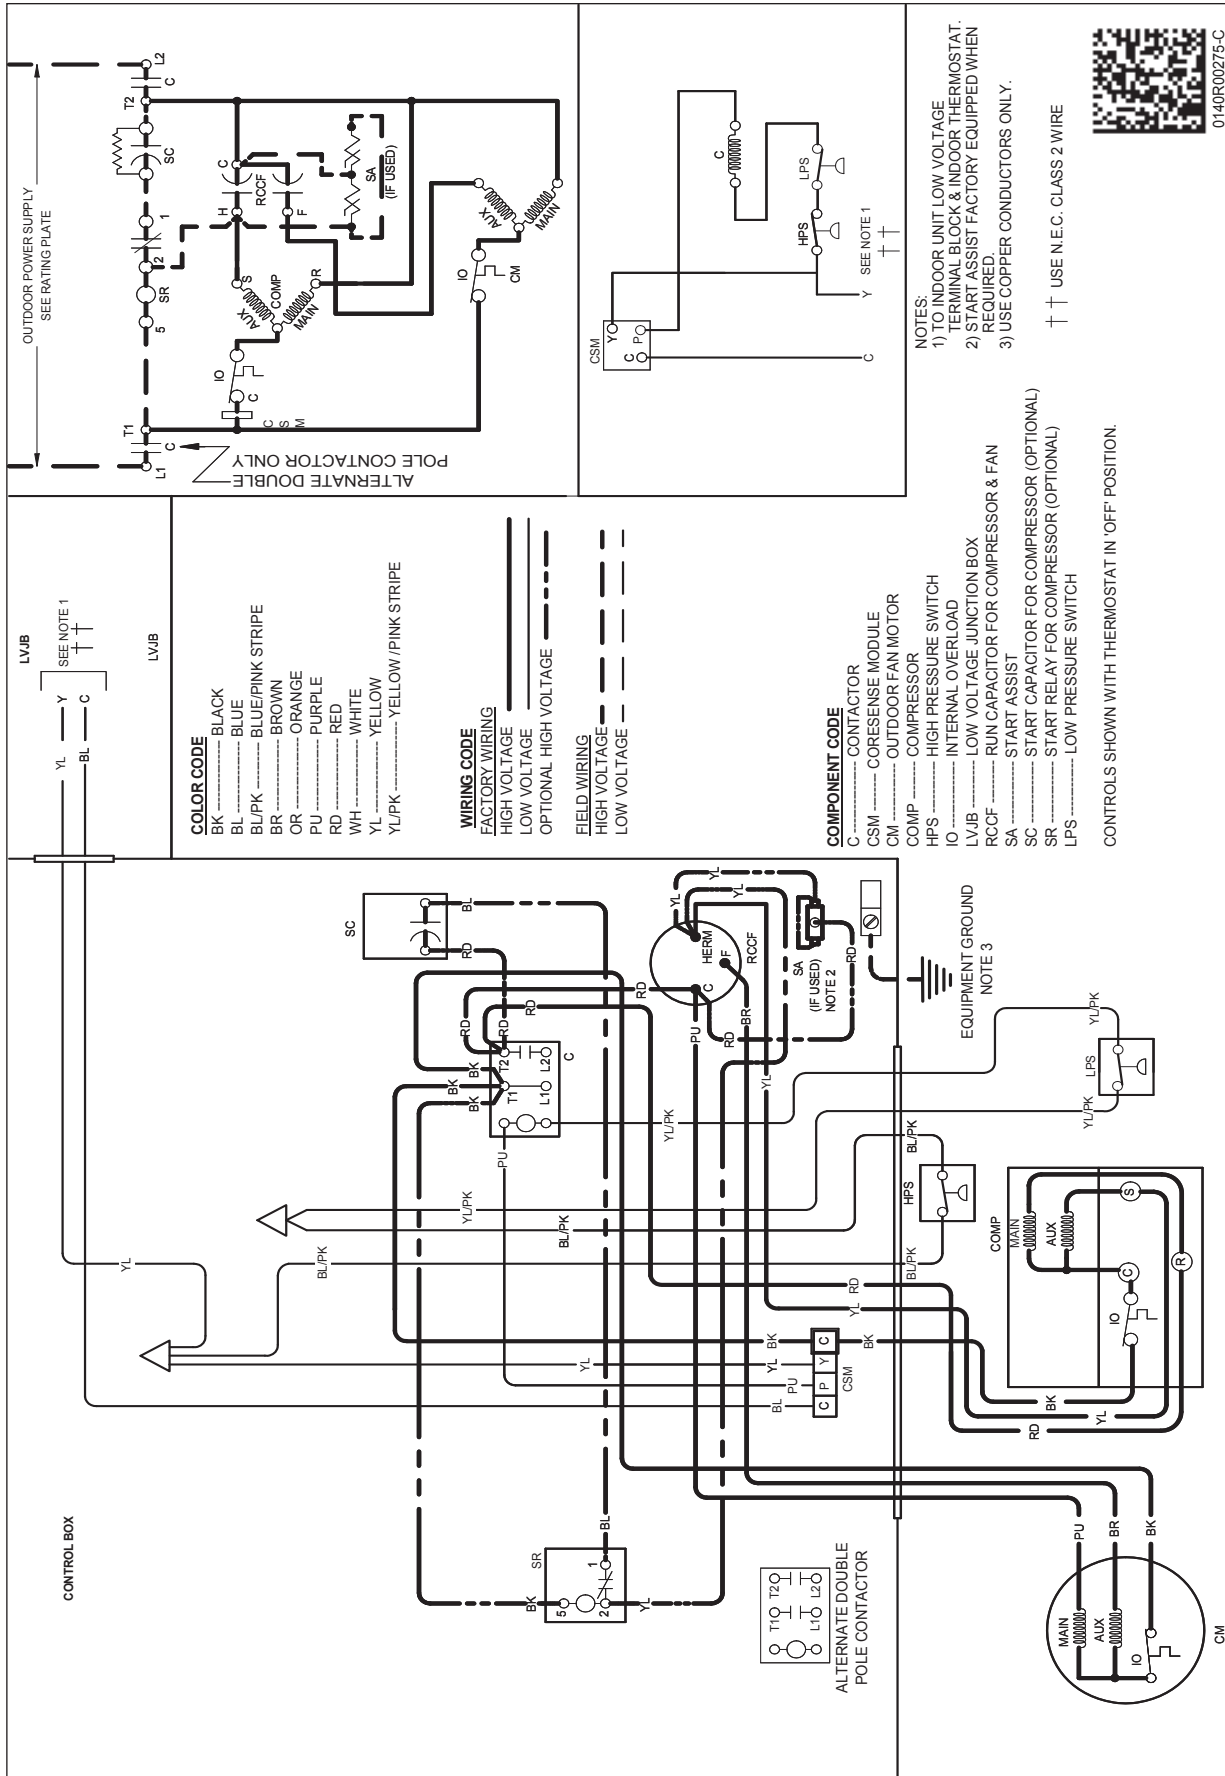

# DIMENSIONS

MODEL	DIMENSIONS		
	W"	D"	H"
ASX140181/191**	26	26	27½
ASX140241*/251*	26	26	32½
ASX140301**	29	29	32½
ASX140311**	29	29	32½
ASX140361/371**	29	29	32½
ASX140421**	29	29	36½
ASX140431**	29	29	36½
ASX140481**	35½	35½	36½
ASX140601**	35½	35½	38½

The Goodman Company, L.P.  
ASX14

SPECIAL CHARACTERISTICS:  
 ○ = ES/DMA    ◊ = CRITICAL CHARACTERISTIC    ⊕ = SIGNIFICANT CHARACTERISTIC

COMPONENTS AND MATERIALS SPECIFIED HEREIN WILL ALSO CONFORM TO THE APPLICABLE SECTION OF GOODMAN MSP 624 01 WORKMANSHIP STANDARD FOR FIT, FEEL, AND FINISH.

CONFIDENTIAL PROPERTY OF THE GOODMAN MANUFACTURING COMPANY, L.P. NOT TO BE DISCLOSED TO OTHERS, COPIED, OR USED FOR ANY PURPOSE EXCEPT AS AUTHORIZED IN WRITING. MUST BE RETURNED UPON DEMAND, ON COMPLETION OF ORDER, OR OTHER PURPOSE FOR WHICH IT WAS LENT.

# ACCESSORIES

Model #	Description	ASX14	ASX14	ASX14	ASX14	ASX14	ASX14	ASX14
		018/19	024/25	030/31	036/37	042/43	048	060
ABK-20	Anchor Bracket Kit ◊			X	X	X	X	X
ABK-21	Anchor Bracket Kit ◊	X	X					
ASC-01	Anti-Short Cycle Kit	X	X	X	X	X	X	X
CSR-U-1	Hard-start Kit	X	X	X	X			
CSR-U-2	Hard-start Kit					X	X	X
CSR-U-3	Hard-start Kit						X	X
FSK01A <sup>1</sup>	Freeze Protection Kit	X	X	X	X	X	X	X
LSK02A <sup>2</sup>	Liquid Line Solenoid Kit	X	X	X	X	X	X	X
LAKT01A	Low-Ambient Kit	X	X	X	X	X	X	X
TX2N4 <sup>2</sup>	TXV Kit	X						
TX2N4A <sup>2</sup>	TXV Kit	X	X					
TX3N4 <sup>2</sup>	TXV Kit			X	X			
TX5N4 <sup>2</sup>	TXV Kit					X	X	X

<sup>0</sup> Contains 20 brackets; four brackets needed to anchor unit to pad

<sup>1</sup> Installed on indoor coil

<sup>2</sup> Field-installed, non-bleed, expansion valve kit — Condensing units and heat pumps with rotary compressors require the use of start-assist components when used in conjunction with an indoor coil using a non-bleed thermal expansion valve refrigerant metering device or liquid line solenoid kit. The TXV should always be sized based on the tonnage of the outdoor unit.